SIEMENS

Data sheet

3RB3046-1XB0



Overload relay 32...115 A Electronic For motor protection Size S3, Class 10E Contactor mounting Main circuit: Screw Auxiliary circuit: Screw Manual-Automatic-Reset

product brand name	SIRIUS
product designation	solid-state overload relay
product type designation	3RB3
General technical data	
size of overload relay	S3
size of contactor can be combined company-specific	S3
power loss [W] for rated value of the current at AC in hot operating state	4.6 W
• per pole	1.53 W
insulation voltage with degree of pollution 3 at AC rated value	1 000 V
surge voltage resistance rated value	8 kV
maximum permissible voltage for protective separation in networks with grounded star point	
 between auxiliary and auxiliary circuit 	300 V
 between auxiliary and auxiliary circuit 	300 V
 between main and auxiliary circuit 	600 V
 between main and auxiliary circuit 	690 V
shock resistance	8g / 11 ms
 according to IEC 60068-2-27 	15g / 11 ms; Signaling contact 97 / 98 in position "Tripped": 8g / 11 ms
vibration resistance	1-6 Hz, 15 mm; 6-500 Hz, 20 m/s²; 10 cycles
thermal current	115 A
type of protection according to ATEX directive 2014/34/EU	Ex II (2) G [Ex e] [Ex d] [Ex px] ; Ex II (2) D [Ex t] [Ex p]
certificate of suitability according to ATEX directive 2014/34/EU	PTB 09 ATEX 3001
reference code according to IEC 81346-2	F
Substance Prohibitance (Date)	03/01/2017
Ambient conditions	
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
during operation	-25 +60 °C
during storage	-40 +80 °C
during transport	-40 +80 °C
temperature compensation	-25 +60 °C
relative humidity during operation	10 95 %
Main circuit	
number of poles for main current circuit	3
adjustable current response value current of the current- dependent overload release	32 115 A
operating voltage	
rated value	1 000 V
• at AC-3e rated value maximum	1 000 V
operating frequency rated value	50 60 Hz

operational current rated value	115 A
operational current at AC-3e at 400 V rated value	115 A
operating power	
 for 3-phase motors at 400 V at 50 Hz 	18.5 55 kW
 for AC motors at 500 V at 50 Hz 	22 75 kW
● for AC motors at 690 V at 50 Hz	30 90 kW
Auxiliary circuit	
design of the auxiliary switch	integrated
number of NC contacts for auxiliary contacts	1
• note	for contactor disconnection
number of NO contacts for auxiliary contacts	1
• note	for message "tripped"
number of CO contacts for auxiliary contacts	0
operational current of auxiliary contacts at AC-15	
• at 24 V	4 A
• at 110 V	4 A
• at 120 V	4 A
• at 125 V	4 A
• at 230 V	3 A
operational current of auxiliary contacts at DC-13	
• at 24 V	2 A
• at 60 V	0.55 A
• at 110 V	0.3 A
• at 125 V	0.3 A
• at 220 V	0.11 A
Protective and monitoring functions	
trip class	CLASS 10E
design of the overload release	electronic
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	
at 480 V rated value	115 A
 at 600 V rated value 	115 A
contact rating of auxiliary contacts according to UL	B600 / R300
Short-circuit protection	
design of the fuse link	
 for short-circuit protection of the main circuit 	
- with type of coordination 1 required	gG: 315 A
— with type of assignment 2 required	gG: 315 A
 for short-circuit protection of the auxiliary switch required 	fuse gG: 6 A
Installation/ mounting/ dimensions	
mounting position	any
fastening method	Contactor mounting
height	106 mm
width	70 mm
depth	124 mm
Connections/ Terminals	
product component removable terminal for auxiliary and	Yes
control circuit	
type of electrical connection	
• for main current circuit	screw-type terminals
 for auxiliary and control circuit 	screw-type terminals
arrangement of electrical connectors for main current	Top and bottom
circuit	
type of connectable conductor cross-sections for main contacts	
• solid	2x (2.5 16 mm²)
stranded	2x 16 mm ²
 solid or stranded 	1x (2,5 70 mm²), 2x (2,5 50 mm²)
 finely stranded with core end processing 	1x (2,5 50 mm²), 2x (2,5 35 mm²)
type of connectable conductor cross-sections	
 for auxiliary contacts 	
— solid	1x (0.5 4 mm²), 2x (0.5 2.5 mm²)

— solid or stranded	1x (0,5 4 mm ²), 2x (0,5 2,5 mm ²)
— finely stranded with core end processing	1x (0.5 2.5 mm ²), 2x (0.5 1.5 mm ²)
for AWG cables for auxiliary contacts	2x (20 14)
tightening torque	
for main contacts with screw-type terminals	4.5 6 N·m
for auxiliary contacts with screw-type terminals	0.8 1.2 N·m
design of screwdriver shaft	Diameter 5 to 6 mm
size of the screwdriver tip	Pozidriv PZ 2
design of the thread of the connection screw	
for main contacts	M6
 of the auxiliary and control contacts 	M3
Safety related data	
protection class IP on the front according to IEC 60529	IP20
touch protection on the front according to IEC 60529	finger-safe, for vertical contact from the front
Communication/ Protocol	
type of voltage supply via input/output link master	No
Electromagnetic compatibility	
conducted interference	
 due to burst according to IEC 61000-4-4 	2 kV (power ports), 1 kV (signal ports) corresponds to degree of severity 3
 due to conductor-earth surge according to IEC 61000-4-5 	2 kV (line to earth) corresponds to degree of severity 3
• due to conductor-conductor surge according to IEC	1 kV (line to line) corresponds to degree of severity 3
61000-4-5	
 due to high-frequency radiation according to IEC 61000- 4-6 	10 V in frequency range 0.15 to 80 MHz, modulation 80 % AM with 1 kHz
field-based interference according to IEC 61000-4-3	10 V/m
electrostatic discharge according to IEC 61000-4-3	6 kV contact discharge / 8 kV air discharge
Display	o kv contact discharge / o kv an discharge
	Slide switch
display version for switching status	Silde Switch
Certificates/ approvals	
General Product Approval	EMC
Confirmation	
For use in hazard- ous locations Declaration of Conformity	Test Certificates Marine / Shipping
Declaration of Conformity	E Special Test Certific- ate Attack A
Version of Conformity	E Special Test Certific- ate Attack A
Version of Conformity	E Special Test Certific- ate Attack A
UK ATEX UK CA CA CA CA CA CA CA CA CA CA	Special Test Certific- ate Type Test Certific- ates/Test Report
UK ATEX UK CA CA CA CA CA CA CA CA CA CA	Special Test Certific- ate Type Test Certific- ates/Test Report
UK ATEX UK CA CA CA CA CA CA CA CA CA CA	Special Test Certific- ate Type Test Certific- ates/Test Report
UK ATEX UK CA CA CA CA CA CA CA CA CA CA	Special Test Certific- ate Type Test Certific- ates/Test Report
Outs locations Declaration of Conformity UK UK UK C EG-Ko Marine / Shipping Image: Shipping	Special Test Certific- ate Type Test Certific- ates/Test Report
Outs locations Declaration of Conformity UK UK UK UK Image: Control of Conformity Image: Control of	Special Test Certific- ate Type Test Certific- ates/Test Report
Outs locations Declaration of Conformity UK UK ATEX UK Marine / Shipping Image: Control of Conformity	Special Test Certific- ate Type Test Certific- ates/Test Report
Outs locations Declaration of Conformity UK UK VECA EG-Ko Marine / Shipping Image: Conformity Image: Conformity	Special Test Certific- ate Type Test Certific- ates/Test Report
Outs locations Declaration of Conformity UK UK C Marine / Shipping C C Marine / Shipping C C Wither information C C Siemens has decided to exit the Russian market (see here) C C Siemens has decided to exit the Russian market (see here) C C Siemens is working on the renewal of the current EAC cert C C	Special Test Certific- ate Type Test Certific- ates/Test Report
Outs locations Declaration of Conformity Declaration of Conformity UK UK UK UK Marine / Shipping EG-Ko Marine / Shipping UK UK With the second s	Special Test Certific: ate Type Test Certific: ates/Test Report UNICOUNT UNICOUNT Confirmation
Outs locations Declaration of Conformity Image: State of the state o	Special Test Certific: ate Type Test Certific: ates/Test Report UNICOUNT UNICOUNT Confirmation
Outs locations Declaration of Conformity Image: Stress of the	Special Test Certific: ate Type Test Certific: ates/Test Report UNICOUNT UNICOUNT Confirmation
Outs locations Declaration of Conformity Declaration of Conformity UK UK UK Marine / Shipping EG-Ko Marine / Shipping UK UK UK <td< td=""><td>Special Test Certific: ate Special Test Certific: ates/Test Report Image: Confirmation Confirmation States: Image: Confirmation <t< td=""></t<></td></td<>	Special Test Certific: ate Special Test Certific: ates/Test Report Image: Confirmation Confirmation States: Image: Confirmation Image: Confirmation <t< td=""></t<>
Outs locations Declaration of Conformity USE USE USE Marine / Shipping USE USE Marine / Shipping USE USE Marine / Shipping USE USE With the state of t	Special Test Certific: ate Special Test Certific: ates/Test Report Image: Confirmation Confirmation States: Image: Confirmation Image: Confirmation <t< td=""></t<>

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RB3046-1XB0

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

https://support.industry.siemens.com/cs/ww/en/ps/3RB3046-12

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RB3046-1XB0&lang=en

Characteristic: Tripping characteristics, I2t, Let-through current

https://support.industry.siemens.com/cs/ww/en/ps/3RB3046-1XB0/char

0

 \bigcirc

2/T1

90 89.1 \cap

_∐ " A


0


4/T2

N ARESI

Further characteristics (e.g. electrical endurance, switching frequency)

http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RB3046-1XB0&objecttype=14&gridview=view1

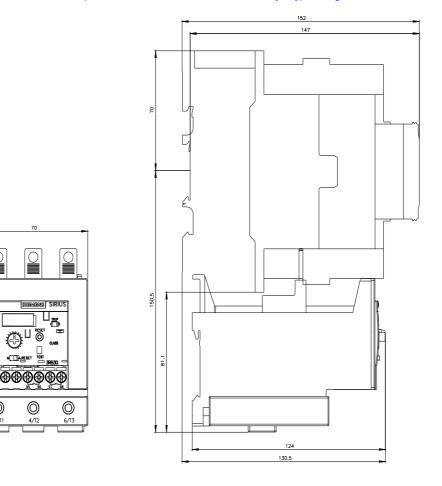

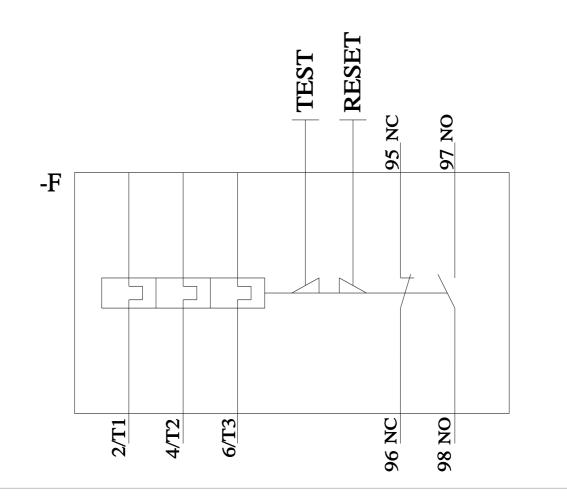

last modified:

2/9/2022 🖸

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Siemens: 3RB30461XB0