SIEMENS

Data sheet

3RT2035-1AH00



power contactor, AC-3e/AC-3, 41 A, 18.5 kW / 400 V, 3-pole, 48 V AC, 50 Hz, auxiliary contacts: 1 NO + 1 NC, screw terminal, size: S2 $\,$

product brand name SIRUS product designation Power contactor product version SRT2 size of contactor S2 product version No • function module for communication No • auxiliary switch Yes power loss [W] for rated value of the current 6.6 W • at AC in hot operating state 6.6 W • at AC in hot operating state per pole 2.2 W • without load current share by local 600 V • of main circuit with degree of pollution 3 rated value 680 V surger voltage resistance 6 kV • of main circuit with degree of pollution 3 rated value 680 V surger voltage resistance 6 kV • of main circuit rated value 6 kV • of auxiliary circuit with degree of pollution 3 rated value 6 kV • at AC 11 8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 10 000 000 • at AC 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 00		
product type designation 3RT2 General technical data size of contactor S2 product extension No size of contactor S2 power loss [W] for rated value of the current 6.5 W size of contactor S2 power loss [W] for rated value of the current 6.5 W size of contactor S2 e at AC in hot operating state 6.5 W size of contactor S2 e at AC in hot operating state per pole 2.2 W without load current share typical 600 V e of main circult with degree of pollution 3 rated value 690 V 600 V 600 V e of auxillary circuit rated value 6 kV 6 kV 6 kV 6 kV e of auxillary circuit rated value 6 kV 6 k	product brand name	SIRIUS
General technical data S2 size of contactor S2 product extension • function module for communication No • auxiliary switch Yes power loss [W] for rated value of the current • al AC in hot operating state 0.6 W • at AC in hot operating state per pole 2.2 W • without load current share typical 68 W insulation voltage 690 V • of main circuit with degree of pollution 3 rated value 690 V • of main circuit with degree of pollution 3 rated value 690 V • of main circuit rated value 64 KV • of main circuit rated value 64 KV • of auxiliary circuit rated value 61 KV • of contactor strige for protective separation between coll and main contacts according to EN 60947-1 400 V shock resistance at rectangular impulse 11.8g / 5 ms, 7.4g / 10 ms • at AC 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxilia	product designation	Power contactor
size of contactor S2 product extension No • function module for communication No • auxiliary switch Yes power loss [W] for rated value of the current 6.6 W • at AC in hot operating state per pole 2.2 W • without load current share typical 6W Insulation voltage 690 V • of main circuit with degree of pollution 3 rated value 690 V • of auxiliary circuit with degree of pollution 3 rated value 690 V • of auxiliary circuit with degree of pollution 3 rated value 690 V • of auxiliary circuit ated value 6 kV • of main circuit with degree of pollution 3 rated value 6 kV • of auxiliary circuit rated value 6 kV • of auxiliary circuit rated value 6 kV • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 11.8g / 5 ms, 7.4g / 10 ms • at AC 10 000 000 • of the contactor with added electronically optimized 10 000 000 • of the contactor with added electronically optimized 10 000 000 • of the contactor with added electronically optimized <t< td=""><td>product type designation</td><td>3RT2</td></t<>	product type designation	3RT2
product extension No • function module for communication No • auxiliary switch Yes power loss [W] for rated value of the current 6.6 W • at AC in hot operating state 6.6 W • at AC in hot operating state per pole 2.2 W • withoot load current share typical 6W insulation voltage 690 V • of main circuit with degree of pollution 3 rated value 690 V • of main dircuit rated value 6 kV • of auxillary circuit rated value 6 kV • of the contactor typical 10.	General technical data	
• function module for communication No • auxiliary switch Yes power loss [W] for rated value of the current 6.6 W • at AC in hot operating state 6.6 W • at AC in hot operating state per pole 2.2 W • without load current share typical 6W insultation voltage 6W • of main circuit with degree of pollution 3 rated value 690 V • of main circuit with degree of pollution 3 rated value 690 V • of main circuit rated value 6 kV • of main circuit rated value 6 kV • of auxiliary circuit rated value 6 kV • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 11.8g / 5 ms, 7.4g / 10 ms • at AC 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical <	size of contactor	S2
• auxiliary switch Yes power loss [W] for rated value of the current 6.6 W • at AC in hot operating state 6.6 W • at AC in hot operating state per pole 2.2 W • without load current share typical 6 W insuliation voltage 690 V • of main circuit with degree of pollution 3 rated value 690 V • of main circuit rated value 690 V • of auxiliary circuit with degree of pollution 3 rated value 690 V • of auxiliary circuit with degree of pollution 3 rated value 64V • of auxiliary circuit with degree of pollution 3 rated value 64V • of auxiliary circuit with degree of pollution 3 rated value 64V • of auxiliary circuit rated value 64V • at AC 11.8g / 5 ms, 7.4g / 10 ms mechanical service life (operating cycles) 10 000 000 • of contactor typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary sw	product extension	
power loss [W] for rated value of the current 6.6 W • et AC in hot operating state per pole 2.2 W • without load current share typical 6 W insulation voltage 6 W • of main circuit with degree of pollution 3 rated value 690 V • of auxiliary circuit with degree of pollution 3 rated value 690 V surge voltage resistance 6 kV • of main circuit rated value 6 kV • of auxiliary circuit rated value 6 kV • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance at rectangular impulse 11.8g / 5 ms, 7.4g / 10 ms • at AC 11.8g / 5 ms, 7.4g / 10 ms mechanical service life (operating cycles) 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 <tr< td=""><td> function module for communication </td><td>No</td></tr<>	 function module for communication 	No
• at AC in hot operating state 6.6 W • at AC in hot operating state per pole 2.2 W • without load current share typical 6 W insultation voltage 6 W • of main circuit with degree of pollution 3 rated value 690 V • of auxiliary circuit with degree of pollution 3 rated value 690 V • of auxiliary circuit rated value 6 kV • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 10 000 000 • at AC 10 000 000 • of the contactor with added electronically optimized 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added selectronically optimized	auxiliary switch	Yes
• at AC in hot operating state per pole 2.2 W • withbut load current share typical 6 W insulation voltage 6 W • of main circuit with degree of pollution 3 rated value 690 V surge voltage resistance 6 kV • of auxiliary circuit with degree of pollution 3 rated value 690 V surge voltage resistance 6 kV • of auxiliary circuit rated value 6 kV • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance at rectangular impulse 10 000 000 • at AC 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) 10 000 000 • of contactor typical 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81345-2	power loss [W] for rated value of the current	
• without load current share typical 6 W insulation voltage 6 W • of main circuit with degree of pollution 3 rated value 690 V surge voltage resistance 690 V • of auxiliary circuit with degree of pollution 3 rated value 690 V surge voltage resistance 6 kV • of auxiliary circuit rated value 6 kV • of auxiliary circuit rated value 6 kV maximum permissible voltage for protective separation between coll and main contacts according to EN 60947-1 400 V shock resistance at rectangular impulse 400 V • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 11.8g / 5 ms, 7.4g / 10 ms • of contactor typical 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to EIC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions -25 +60 °C installation altitude at height above sea level maximum 2 000 m ambient temperature -55 +80 °C • during sorage	 at AC in hot operating state 	6.6 W
Insulation voltage 600 V • of main circuit with degree of pollution 3 rated value 600 V • of auxiliary circuit with degree of pollution 3 rated value 600 V surge voltage resistance 600 V • of main circuit rated value 6 kV • of auxiliary circuit rated value 6 kV maximum permissible voltage for protective separation between 400 V coil and main contacts according to EN 60947-1 500K resistance at rectangular impulse • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 18.5g / 5 ms, 11.6g / 10 ms • of contactor typical 10 000 000 • of the contactor with added electronically optimized 5000 000 auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient temperature 60 °C • during operation	 at AC in hot operating state per pole 	2.2 W
• of main circuit with degree of pollution 3 rated value 690 V • of auxiliary circuit with degree of pollution 3 rated value 690 V surge voltage resistance 6 • of main circuit rated value 6 kV maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1 400 V shock resistance at rectangular impulse 400 V • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 1 • at AC 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions -25 +60 °C • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity minimum 10 % relative humidity minimum	 without load current share typical 	6 W
• of auxiliary circuit with degree of pollution 3 rated value 690 V surge voltage resistance 6 kV • of main circuit rated value 6 kV • of auxiliary circuit rated value 6 kV maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1 400 V shock resistance at rectangular impulse 400 V • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 11.8g / 5 ms, 11.6g / 10 ms • of contactor typical 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 5 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Amblent conditions 2 000 m installation altitude at height above sea level maximum 2 000 m amblemt temperature -45 +60 °C • during storage -55 +80 °C relative humidity at 55 °C according to IEC 60068-2-30 maximum 95 %	insulation voltage	
surge voltage resistance 6 kV • of main circuit rated value 6 kV • of auxiliary circuit rated value 6 kV maximum permissible voltage for protective separation between coll and main contacts according to EN 60947-1 400 V shock resistance at rectangular impulse 400 V • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 18.5g / 5 ms, 11.6g / 10 ms • at AC 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) 10 000 000 • of the contactor typical 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 100/1/2014 Ambient conditions 2000 m ambient temperature -55 +60 °C • during operation -25 +60 °C • during strage -55 °C according to IEC 60068-2-30 maximum 20 %	 of main circuit with degree of pollution 3 rated value 	690 V
• of main circuit rated value 6 kV • of auxiliary circuit rated value 6 kV maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1 400 V shock resistance at rectangular impulse 400 V • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse 18.5g / 5 ms, 11.6g / 10 ms • at AC 10 000 000 • of the contactor typical 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions 2 000 m ambient temperature -25 +60 °C • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % 95 % 95 %	 of auxiliary circuit with degree of pollution 3 rated value 	690 V
• of auxiliary circuit rated value 6 kV maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1 400 V shock resistance at rectangular impulse 400 V • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse • • at AC 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) • • of contactor typical 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 5 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions 2 000 m installation altitude at height above sea level maximum 2 000 m ambient temperature -25 +60 °C • during operation -25 +80 °C relative humidity minimum 10 % 95 % 95 %	surge voltage resistance	
maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1 400 V shock resistance at rectangular impulse at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse at AC 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) of contactor typical 10 000 000 of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 e of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions 2 000 m installation altitude at height above sea level maximum 2 000 m ambient temperature during operation -25 +60 °C etative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum 	 of main circuit rated value 	6 kV
coil and main contacts according to EN 60947-1 shock resistance at rectangular impulse • at AC 11.8g / 5 ms, 7.4g / 10 ms shock resistance with sine pulse • at AC 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) 10 000 000 • of contactor typical 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions 2 000 m ambient temperature -25 +60 °C • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 95 % Main circuit 95 %	 of auxiliary circuit rated value 	6 kV
• at AC11.8g / 5 ms, 7.4g / 10 msshock resistance with sine pulse		400 V
shock resistance with sine pulse 18.5g / 5 ms, 11.6g / 10 ms mechanical service life (operating cycles) 10 000 000 • of contactor typical 10 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 5 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions 2 000 m installation altitude at height above sea level maximum 2 000 m ambient temperature -25 +60 °C • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % Main circuit Main circuit	shock resistance at rectangular impulse	
• at AC18.5g / 5 ms, 11.6g / 10 msmechanical service life (operating cycles)0• of contactor typical10 000 000• of the contactor with added electronically optimized auxiliary switch block typical5 000 000• of the contactor with added auxiliary switch block typical10 000 000• of the contactor with added auxiliary switch block typical10 000 000• of the contactor with added auxiliary switch block typical10 000 000• of the contactor with added auxiliary switch block typical10 000 000• of the contactor with added auxiliary switch block typical10 000 000• of the contactor with added auxiliary switch block typical10 000 000• of the contactor with added auxiliary switch block typical10 000 000• of the contactor with added auxiliary switch block typical000 000• of the contactor with added auxiliary switch block typical10 000 000• of the contactor with added auxiliary switch block typical000 000• during torace (Date)10/01/2014Ambient temperature • during operation • during storage-25 +60 °C• during storage-55 +80 °Crelative humidity minimum10 %relative humidity at 55 °C according to IEC 60068-2-30 maximum95 %Main circuit	• at AC	11.8g / 5 ms, 7.4g / 10 ms
mechanical service life (operating cycles) 10 000 000 • of contactor typical 5 000 000 • of the contactor with added electronically optimized auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 • of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions 2 000 m installation altitude at height above sea level maximum 2 000 m ambient temperature -25 +60 °C • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 95 % Main circuit Main circuit	shock resistance with sine pulse	
 of contactor typical of the contactor with added electronically optimized auxiliary switch block typical of the contactor with added auxiliary switch block typical of the contactor with added auxiliary switch block typical of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions installation altitude at height above sea level maximum 2 000 m ambient temperature during operation 25 +60 °C during storage 55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 95 % 	• at AC	18.5g / 5 ms, 11.6g / 10 ms
of the contactor with added electronically optimized auxiliary switch block typical of the contactor with added auxiliary switch block typical of the contactor with added auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions installation altitude at height above sea level maximum 2 000 m ambient temperature oduring operation -25 +60 °C -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum Main circuit	mechanical service life (operating cycles)	
auxiliary switch block typical 10 000 000 reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions 2 000 m installation altitude at height above sea level maximum 2 000 m ambient temperature -25 +60 °C • during operation -25 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 95 % Main circuit	 of contactor typical 	10 000 000
reference code according to IEC 81346-2 Q Substance Prohibitance (Date) 10/01/2014 Ambient conditions 2 000 m installation altitude at height above sea level maximum 2 000 m ambient temperature -25 +60 °C • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum 95 %		5 000 000
Substance Prohibitance (Date) 10/01/2014 Ambient conditions installation altitude at height above sea level maximum 2 000 m ambient temperature 2 000 m • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum 95 % Main circuit	 of the contactor with added auxiliary switch block typical 	10 000 000
Ambient conditions installation altitude at height above sea level maximum 2 000 m ambient temperature -25 +60 °C • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum 95 % Main circuit	reference code according to IEC 81346-2	Q
installation altitude at height above sea level maximum 2 000 m ambient temperature -25 +60 °C • during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum 95 % Main circuit	Substance Prohibitance (Date)	10/01/2014
ambient temperature • during operation • during storage -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum Main circuit	Ambient conditions	
• during operation -25 +60 °C • during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum 95 % Main circuit	installation altitude at height above sea level maximum	2 000 m
• during storage -55 +80 °C relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum 95 % Main circuit	ambient temperature	
relative humidity minimum 10 % relative humidity at 55 °C according to IEC 60068-2-30 maximum 95 % Main circuit 95 %	 during operation 	-25 +60 °C
relative humidity at 55 °C according to IEC 60068-2-30 95 % maximum 95 % Main circuit 95 %	during storage	-55 +80 °C
maximum Main circuit	relative humidity minimum	10 %
		95 %
	Main circuit	
number of poles for main current circuit 3	number of poles for main current circuit	3

number of NO contacts for main contacts	3
operating voltage	
at AC-3 rated value maximum	690 V
 at AC-3e rated value maximum 	690 V
operational current	
• at AC-1 at 400 V at ambient temperature 40 °C rated	60 A
value	
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated value	60 A
— up to 690 V at ambient temperature 60 °C rated	55 A
value	
● at AC-3	
— at 400 V rated value	41 A
— at 500 V rated value	41 A
— at 690 V rated value	24 A
• at AC-3e	
— at 400 V rated value	41 A
— at 500 V rated value	41 A
— at 690 V rated value	24 A
at AC-4 at 400 V rated value	35 A
at AC-5a up to 690 V rated value	52.8 A
 at AC-5b up to 400 V rated value at AC-6a 	33.2 A
	36.5 A
— up to 230 V for current peak value n=20 rated value	
 — up to 400 V for current peak value n=20 rated value — up to 500 V for current peak value n=20 rated value 	36.5 A 36.5 A
— up to 500 V for current peak value n=20 rated value	24 A
• at AC-6a	24 A
 up to 230 V for current peak value n=30 rated value 	24.2 A
— up to 200 V for current peak value n=30 rated value	24.2 A
— up to 500 V for current peak value n=30 rated value	24.2 A
— up to 690 V for current peak value n=30 rated value	24 A
minimum cross-section in main circuit at maximum AC-1 rated	16 mm ²
value	
operational current for approx. 200000 operating cycles at AC-4	
at 400 V rated value	22 A
at 690 V rated value	18.5 A
operational current	
 at 1 current path at DC-1 	
— at 24 V rated value	55 A
— at 60 V rated value	23 A
— at 110 V rated value	4.5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.4 A
— at 600 V rated value	0.25 A
 with 2 current paths in series at DC-1 	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	45 A
— at 220 V rated value	5 A
— at 440 V rated value	1 A
— at 600 V rated value	0.8 A
 with 3 current paths in series at DC-1 	
— at 24 V rated value	55 A
— at 60 V rated value	55 A
— at 110 V rated value	55 A
— at 220 V rated value	45 A
— at 440 V rated value	2.9 A
— at 600 V rated value	1.4 A
 at 1 current path at DC-3 at DC-5 	

— at 24 V rated value	35 A
— at 60 V rated value	6 A
— at 220 V rated value	1 A
— at 440 V rated value	0.1 A
— at 600 V rated value	0.06 A
 with 2 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	25 A
— at 220 V rated value	5 A
— at 440 V rated value	0.27 A
— at 600 V rated value	0.16 A
 with 3 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	55 A
— at 60 V rated value	55 A
— at 110 V rated value	55 A
— at 220 V rated value	25 A
— at 440 V rated value	0.6 A
— at 600 V rated value	0.35 A
operating power	
• at AC-2 at 400 V rated value	18.5 kW
• at AC-3	
— at 230 V rated value	11 kW
— at 400 V rated value	18.5 kW
— at 500 V rated value	22 kW
— at 690 V rated value	22 kW
• at AC-3e	
— at 230 V rated value	11 kW
— at 400 V rated value	18.5 kW
— at 500 V rated value	22 kW
— at 690 V rated value	22 kW
operating power for approx. 200000 operating cycles at AC-	ZZ KVV
4	
 at 400 V rated value 	11.6 kW
 at 690 V rated value 	16.8 kW
operating apparent power at AC-6a	
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value 	14.5 kVA
• up to 230 V for current peak value n=20 rated value	14.5 kVA 25.2 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value 	
• up to 230 V for current peak value n=20 rated value	25.2 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value 	25.2 kVA 31.6 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value 	25.2 kVA 31.6 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value Operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for switching at zero current maximum limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value n=30 rated value up to 690 V for current p	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum no-load switching frequency at AC operating frequency 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value the 690 V for current peak value n=30 rated value a AC operating frequency at AC-1 maximum at AC-2 maximum 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 1 200 1/h
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 1 200 1/h
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC-1 maximum at AC-3 maximum <li< td=""><td>25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 1 200 1/h 1 000 1/h 1 000 1/h</td></li<>	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 1 200 1/h 1 000 1/h 1 000 1/h
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 100 1/h

type of voltage of the control supply voltage	AC
control supply voltage at AC	
• at 50 Hz rated value	48 V
operating range factor control supply voltage rated value of magnet coil at AC	
● at 50 Hz	0.8 1.1
apparent pick-up power of magnet coil at AC • at 50 Hz	190 VA
inductive power factor with closing power of the coil	
• at 50 Hz	0.72
apparent holding power of magnet coil at AC	
• at 50 Hz	16 VA
inductive power factor with the holding power of the coil	
● at 50 Hz	0.37
closing delay	
• at AC	10 80 ms
opening delay	
• at AC	10 18 ms
arcing time	10 20 ms
control version of the switch operating mechanism	Standard A1 - A2
Auxiliary circuit	4
number of NC contacts for auxiliary contacts instantaneous contact	1
number of NO contacts for auxiliary contacts instantaneous contact	1
operational current at AC-12 maximum	10 A
operational current at AC-15	
at 230 V rated value	10 A
• at 400 V rated value	3 A
at 500 V rated value	2 A
at 690 V rated value	1 A
operational current at DC-12	
• at 24 V rated value	10 A
• at 48 V rated value	6 A
 at 60 V rated value at 110 V rated value 	6 A 3 A
at 125 V rated value	2 A
at 220 V rated value	1A
at 600 V rated value	0.15 A
operational current at DC-13	0.10 A
at 24 V rated value	10 A
at 48 V rated value	2 A
• at 60 V rated value	2 A
at 110 V rated value	1A
• at 125 V rated value	0.9 A
• at 220 V rated value	0.3 A
• at 600 V rated value	0.1 A
contact reliability of auxiliary contacts	1 faulty switching per 100 million (17 V, 1 mA)
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	
• at 480 V rated value	40 A
• at 600 V rated value	41 A
yielded mechanical performance [hp]	
 for single-phase AC motor 	
— at 110/120 V rated value	3 hp
— at 230 V rated value	7.5 hp
 for 3-phase AC motor 	
— at 200/208 V rated value	10 hp
— at 220/230 V rated value	15 hp
— at 460/480 V rated value	30 hp
— at 575/600 V rated value	40 hp

contact rating of auxiliary contacts according to UL	A600 / P600		
Short-circuit protection			
design of the fuse link			
for short-circuit protection of the main circuit			
- with type of coordination 1 required	gG: 160 A (690 V, 100 kA), aM: 80 A (690 V, 100 kA), BS88: 125 A (415 V, 80		
with type of ocordination in required	kA)		
 — with type of assignment 2 required 	gG: 80A (690V,100kA), aM: 50A (690V,100kA), BS88: 63A (415V,80kA)		
 for short-circuit protection of the auxiliary switch required 	gG: 10 A (500 V, 1 kA)		
Installation/ mounting/ dimensions			
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and		
	backward by +/- 22.5° on vertical mounting surface		
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715		
side-by-side mounting	Yes		
height	114 mm		
width	55 mm		
depth	130 mm		
required spacing			
 with side-by-side mounting 			
— forwards	10 mm		
— upwards	10 mm		
— downwards	10 mm		
— at the side	0 mm		
 for grounded parts 			
— forwards	10 mm		
— upwards	10 mm		
— at the side	6 mm		
— downwards	10 mm		
for live parts			
— forwards	10 mm		
— upwards	10 mm		
— downwards	10 mm		
— at the side	6 mm		
Connections/ Terminals			
type of electrical connection			
for main current circuit	screw-type terminals		
 for auxiliary and control circuit 	screw-type terminals		
 at contactor for auxiliary contacts 	Screw-type terminals		
• of magnet coil	Screw-type terminals		
type of connectable conductor cross-sections for main contacts			
 solid or stranded 	2x (1 35 mm²), 1x (1 50 mm²)		
 finely stranded with core end processing 	2x (1 25 mm²), 1x (1 35 mm²)		
connectable conductor cross-section for main contacts			
 finely stranded with core end processing 	1 35 mm²		
connectable conductor cross-section for auxiliary contacts			
 solid or stranded 	0.5 2.5 mm ²		
 finely stranded with core end processing 	0.5 2.5 mm²		
type of connectable conductor cross-sections			
 for auxiliary contacts 			
— solid or stranded	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)		
 finely stranded with core end processing 	2x (0.5 1.5 mm ²), 2x (0.75 2.5 mm ²)		
 for AWG cables for auxiliary contacts 	2x (20 16), 2x (18 14)		
AWG number as coded connectable conductor cross section			
• for main contacts	18 1		
 for auxiliary contacts 	20 14		
Safety related data			
product function			
 mirror contact according to IEC 60947-4-1 	Yes		
 positively driven operation according to IEC 60947-5-1 	No		
suitability for use safety-related switching OFF	Yes		
B10 value with high demand rate according to SN 31920	1 000 000		
J			

proportion of danger	ous failures					
 with low demand rate according to SN 31920 		20	40 %			
 with high demand rate according to SN 31920 		20	73 %			
ailure rate [FIT] with lo	ow demand rate according	o SN 31920	100 FIT			
T1 value for proof test 61508	interval or service life acco	rding to IEC	20 a			
protection class IP on the front according to IEC 60529		EC 60529	IP20			
ouch protection on t	the front according to IEC	60529	finger-safe, for vertical contact	from the front		
ertificates/ approvals						
General Product App	proval					
SP SA		<u>Confirmation</u>		KC	EHC	
EMC	Functional Safety/Safety of Ma- chinery	Declaration of C	conformity	Test Certificates		
RCM	<u>Type Examination Cer-</u> tificate	UK CA	CE EG-Konf.	Special Test Certific- ate	Type Test Certific ates/Test Report	
Marine / Shipping						
ABS	B U REAU VERITAS		Llovd's Register LRs	PRS	RINA	
Marine / Shipping	other		Railway	Dangerous Good	Environment	
KMRS	<u>Confirmation</u>	<u>Confirmation</u>	Vibration and Shock	Transport Information	<u>Environmental Co</u> <u>firmations</u>	
urther information						

https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business

Siemens is working on the renewal of the current EAC certificates.

Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

Information on the packaging

https://support.industry.siemens.com/cs/ww/en/view/109813875 Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system)

https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RT2035-1AH00

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RT2035-1AH00

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

https://support.industry.siemens.com/cs/ww/en/ps/3RT2035-1AH00


Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)


http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RT2035-1AH00&lang=en

Characteristic: Tripping characteristics, I²t, Let-through current

https://support.industry.siemens.com/cs/ww/en/ps/3RT2035-1AH00/char Further characteristics (e.g. electrical endurance, switching frequency)

http://www.automation.siemens.com/bilddb/index.aspx?view=Search&mlfb=3RT2035-1AH00&objecttype=14&gridview=view1

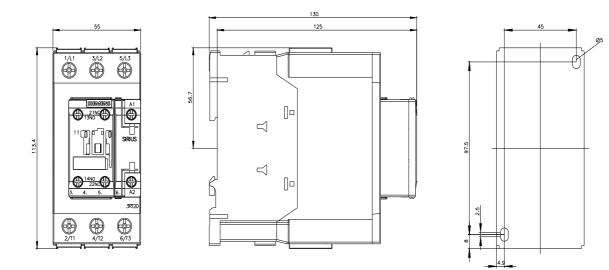

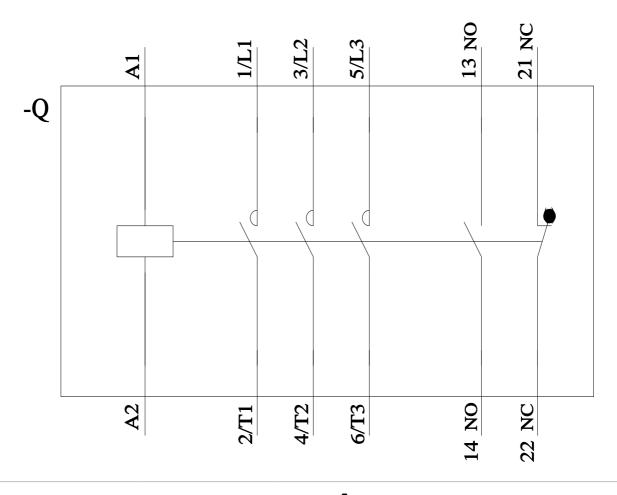

last modified:

8/15/2023 🖸

3RT20351AH00 Page 7/8

8/17/2023

Subject to change without notice © Copyright Siemens

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Siemens: 3RT20351AH00