SIEMENS

Data sheet

3RT2035-3AH00



power contactor, AC-3e/AC-3, 41 A, 18.5 kW / 400 V, 3-pole, 48 V AC, 50 Hz, auxiliary contacts: 1 NO + 1 NC, main circuit: screw terminal, control and auxiliary circuit: spring-loaded terminal, size: S2

product brand nameSIRIUSproduct designationPower contactorproduct type designation3RT2General technical dataS2size of contactorS2product extensionNo• function module for communicationNo• auxiliary switchYes
product type designation 3RT2 General technical data
General technical data size of contactor S2 product extension No
size of contactor S2 product extension No
product extension • function module for communication No
function module for communication No
auxiliary switch Yes
power loss [W] for rated value of the current
• at AC in hot operating state 6.6 W
• at AC in hot operating state per pole 2.2 W
without load current share typical 6 W
insulation voltage
• of main circuit with degree of pollution 3 rated value 690 V
of auxiliary circuit with degree of pollution 3 rated value 690 V
surge voltage resistance
of main circuit rated value 6 kV
of auxiliary circuit rated value 6 kV
maximum permissible voltage for protective separation between 400 V coil and main contacts according to EN 60947-1 400 V
shock resistance at rectangular impulse
• at AC 11.8g / 5 ms, 7.4g / 10 ms
shock resistance with sine pulse
• at AC 18.5g / 5 ms, 11.6g / 10 ms
mechanical service life (operating cycles)
of contactor typical 10 000 000
of the contactor with added electronically optimized auxiliary switch block typical 5000 000
of the contactor with added auxiliary switch block typical 10 000 000
reference code according to IEC 81346-2 Q
Substance Prohibitance (Date) 10/01/2014
Ambient conditions
installation altitude at height above sea level maximum 2 000 m
ambient temperature
• during operation -25 +60 °C
• during storage -55 +80 °C
relative humidity minimum 10 %
relative humidity at 55 °C according to IEC 60068-2-30 95 % maximum
Main circuit
number of poles for main current circuit 3


number of NO contacts for main contacts	3
	3
 operating voltage at AC-3 rated value maximum 	690 V
at AC-3 rated value maximum at AC-3e rated value maximum	690 V
operational current	
at AC-1 at 400 V at ambient temperature 40 °C rated	60 A
value	
• at AC-1	
— up to 690 V at ambient temperature 40 °C rated	60 A
value	
— up to 690 V at ambient temperature 60 °C rated value	55 A
• at AC-3	
— at 400 V rated value	41 A
— at 500 V rated value	41 A
— at 690 V rated value	24 A
• at AC-3e	
— at 400 V rated value	41 A
— at 500 V rated value	41 A
— at 690 V rated value	24 A
at AC-4 at 400 V rated value	35 A
• at AC-5a up to 690 V rated value	52.8 A
• at AC-5b up to 400 V rated value	33.2 A
● at AC-6a	
— up to 230 V for current peak value n=20 rated value	36.5 A
— up to 400 V for current peak value n=20 rated value	36.5 A
— up to 500 V for current peak value n=20 rated value	36.5 A
— up to 690 V for current peak value n=20 rated value	24 A
● at AC-6a	
 — up to 230 V for current peak value n=30 rated value 	24.2 A
 — up to 400 V for current peak value n=30 rated value 	24.2 A
 — up to 500 V for current peak value n=30 rated value 	24.2 A
 — up to 690 V for current peak value n=30 rated value 	24 A
minimum cross-section in main circuit at maximum AC-1 rated value	16 mm ²
operational current for approx. 200000 operating cycles at AC-4	
• at 400 V rated value	22 A
• at 690 V rated value	18.5 A
operational current	
 at 1 current path at DC-1 	
— at 24 V rated value	55 A
— at 60 V rated value	23 A
— at 110 V rated value	4.5 A
— at 220 V rated value	1 A
— at 440 V rated value	0.4 A
— at 600 V rated value	0.25 A
• with 2 current paths in series at DC-1	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	45 A
— at 220 V rated value	5 A
— at 440 V rated value	1 A
— at 600 V rated value	0.8 A
with 3 current paths in series at DC-1	
— at 24 V rated value	55 A
— at 60 V rated value	55 A
- at 110 V rated value	55 A
- at 220 V rated value	45 A
— at 440 V rated value	2.9 A
— at 600 V rated value	1.4 A
 at 1 current path at DC-3 at DC-5 	


— at 24 V rated value	35 A
— at 60 V rated value	6 A
— at 220 V rated value	1 A
— at 440 V rated value	0.1 A
— at 600 V rated value	0.06 A
 with 2 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	55 A
— at 60 V rated value	45 A
— at 110 V rated value	25 A
— at 220 V rated value	5 A
— at 440 V rated value	0.27 A
— at 600 V rated value	0.16 A
 with 3 current paths in series at DC-3 at DC-5 	
— at 24 V rated value	55 A
— at 60 V rated value	55 A
— at 110 V rated value	55 A
— at 220 V rated value	25 A
— at 440 V rated value	0.6 A
— at 600 V rated value	0.35 A
operating power	
• at AC-2 at 400 V rated value	18.5 kW
• at AC-3	
— at 230 V rated value	11 kW
— at 400 V rated value	18.5 kW
— at 500 V rated value	22 kW
— at 690 V rated value	22 kW
• at AC-3e	
— at 230 V rated value	11 kW
— at 400 V rated value	18.5 kW
— at 500 V rated value	22 kW
— at 690 V rated value	22 kW
operating power for approx. 200000 operating cycles at AC-	ZZ KVV
4	
 at 400 V rated value 	11.6 kW
 at 690 V rated value 	16.8 kW
operating apparent power at AC-6a	
 operating apparent power at AC-6a up to 230 V for current peak value n=20 rated value 	14.5 kVA
• up to 230 V for current peak value n=20 rated value	14.5 kVA 25.2 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value 	
• up to 230 V for current peak value n=20 rated value	25.2 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value 	25.2 kVA 31.6 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value 	25.2 kVA 31.6 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value Operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for switching at zero current maximum limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value n=30 rated value up to 690 V for current p	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value short-time withstand current in cold operating state up to 40 °C limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum no-load switching frequency at AC operating frequency 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value up to 690 V for current peak value n=30 rated value up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value the 690 V for current peak value n=30 rated value a AC operating frequency at AC-1 maximum at AC-2 maximum 	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 1 200 1/h
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 1 200 1/h
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 30 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC-1 maximum at AC-3 maximum <li< td=""><td>25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 1 200 1/h 1 000 1/h 1 000 1/h</td></li<>	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 5 000 1/h 1 200 1/h 1 000 1/h 1 000 1/h
 up to 230 V for current peak value n=20 rated value up to 400 V for current peak value n=20 rated value up to 500 V for current peak value n=20 rated value up to 690 V for current peak value n=20 rated value operating apparent power at AC-6a up to 230 V for current peak value n=30 rated value up to 400 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 500 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value up to 690 V for current peak value n=30 rated value limited to 1 s switching at zero current maximum limited to 10 s switching at zero current maximum limited to 60 s switching at zero current maximum at AC operating frequency at AC	25.2 kVA 31.6 kVA 28.6 kVA 9.6 kVA 16.8 kVA 21 kVA 28.6 kVA 28.6 kVA 843 A; Use minimum cross-section acc. to AC-1 rated value 596 A; Use minimum cross-section acc. to AC-1 rated value 400 A; Use minimum cross-section acc. to AC-1 rated value 241 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 196 A; Use minimum cross-section acc. to AC-1 rated value 100 1/h

type of voltage of the control supply voltage	AC
control supply voltage at AC	
• at 50 Hz rated value	48 V
operating range factor control supply voltage rated value of magnet coil at AC	
● at 50 Hz	0.8 1.1
apparent pick-up power of magnet coil at AC • at 50 Hz	190 VA
inductive power factor with closing power of the coil	
• at 50 Hz	0.72
apparent holding power of magnet coil at AC	
• at 50 Hz	16 VA
inductive power factor with the holding power of the coil	
● at 50 Hz	0.37
closing delay	
• at AC	10 80 ms
opening delay	
• at AC	10 18 ms
arcing time	10 20 ms
control version of the switch operating mechanism	Standard A1 - A2
Auxiliary circuit	4
number of NC contacts for auxiliary contacts instantaneous contact	1
number of NO contacts for auxiliary contacts instantaneous contact	1
operational current at AC-12 maximum	10 A
operational current at AC-15	
at 230 V rated value	10 A
• at 400 V rated value	3 A
at 500 V rated value	2 A
at 690 V rated value	1 A
operational current at DC-12	
• at 24 V rated value	10 A
• at 48 V rated value	6 A
 at 60 V rated value at 110 V rated value 	6 A 3 A
at 125 V rated value	2 A
at 220 V rated value	1A
at 600 V rated value	0.15 A
operational current at DC-13	0.10 A
at 24 V rated value	10 A
at 48 V rated value	2 A
• at 60 V rated value	2 A
• at 110 V rated value	1A
• at 125 V rated value	0.9 A
• at 220 V rated value	0.3 A
• at 600 V rated value	0.1 A
contact reliability of auxiliary contacts	1 faulty switching per 100 million (17 V, 1 mA)
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	
• at 480 V rated value	40 A
• at 600 V rated value	41 A
yielded mechanical performance [hp]	
 for single-phase AC motor 	
— at 110/120 V rated value	3 hp
— at 230 V rated value	7.5 hp
 for 3-phase AC motor 	
— at 200/208 V rated value	10 hp
— at 220/230 V rated value	15 hp
— at 460/480 V rated value	30 hp
— at 575/600 V rated value	40 hp

contact rating of auxiliary contacts according to UL	A600 / P600
Short-circuit protection	
design of the fuse link	
 for short-circuit protection of the main circuit 	
- with type of coordination 1 required	gG: 160 A (690 V, 100 kA), aM: 80 A (690 V, 100 kA), BS88: 125 A (415 V, 80 kA)
 — with type of assignment 2 required 	gG: 80A (690V,100kA), aM: 50A (690V,100kA), BS88: 63A (415V,80kA)
 for short-circuit protection of the auxiliary switch required 	gG: 10 A (500 V, 1 kA)
Installation/ mounting/ dimensions	
mounting position	+/-180° rotation possible on vertical mounting surface; can be tilted forward and
	backward by +/- 22.5° on vertical mounting surface
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715
side-by-side mounting	Yes
height	114 mm
width	55 mm
depth	130 mm
required spacing	
with side-by-side mounting forwards	10 mm
— forwards	10 mm
— upwards	10 mm
— downwards	10 mm
— at the side	0 mm
for grounded parts for used	10 mm
— forwards	10 mm
— upwards	10 mm
— at the side	6 mm
— downwards	10 mm
for live parts	
— forwards	10 mm
— upwards	10 mm
— downwards	10 mm
— at the side	6 mm
Connections/ Terminals	
type of electrical connection	
for main current circuit	screw-type terminals
for auxiliary and control circuit	spring-loaded terminals
at contactor for auxiliary contacts	Spring-type terminals
of magnet coil	Spring-type terminals
type of connectable conductor cross-sections for main contacts	
solid or stranded	2x (1 35 mm ²), 1x (1 50 mm ²)
finely stranded with core end processing	2x (1 25 mm²), 1x (1 35 mm²)
connectable conductor cross-section for main contacts	
finely stranded with core end processing	1 35 mm²
connectable conductor cross-section for auxiliary contacts	
solid or stranded	0.5 2.5 mm ²
 finely stranded with core end processing 	0.5 1.5 mm²
finely stranded without core end processing	0.5 2.5 mm²
type of connectable conductor cross-sections	
for auxiliary contacts	
— solid or stranded	2x (0.5 2.5 mm ²)
 finely stranded with core end processing 	2x (0.5 1.5 mm²)
 finely stranded without core end processing 	2x (0.5 2.5 mm²)
for AWG cables for auxiliary contacts	2x (20 14)
AWG number as coded connectable conductor cross section	
 for main contacts 	18 1
for auxiliary contacts	20 14
Safety related data	
product function	
 mirror contact according to IEC 60947-4-1 	Yes
 positively driven operation according to IEC 60947-5-1 	No

suitability for use safe	ty-related switching OFF	Yes	3		
B10 value with high de	emand rate according to SN	31920 1 00	00 000		
proportion of danger					
	nd rate according to SN 3192				
	nd rate according to SN 319				
	ow demand rate according t) FIT		
T1 value for proof test 61508	t interval or service life accor	rding to IEC 20 a	а		
	on the front according to IE	C 60529 IP2	0		
•	the front according to IEC		er-safe, for vertical contact	from the front	
ertificates/ approvals	5				
General Product Ap	proval				
SP	<u>Confirmation</u>			KC	EHC
EMC	Functional Safety/Safety of Ma- chinery	Declaration of Confe	ormity	Test Certificates	
RCM	<u>Type Examination Cer-</u> tificate	CE EG-Konf.	UK CA	Special Test Certific- ate	Type Test Certific- ates/Test Report
Marine / Shipping					
ABS			Llovd's Register uts	PRS	RINA
Marine / Shipping	other		Railway	Dangerous Good	Environment
Æ	Confirmation	Confirmation	Vibration and Shock	Transport Information	Environmental Con firmations
RMRS					
RMRS					
Siemens has decide	d to exit the Russian mark				
https://press.siemens. Siemens is working Please contact your lo EAC relevant market (Information on the p https://support.industr Information- and Dov	com/global/en/pressrelease on the renewal of the curre ocal Siemens office on the st (other than the sanctioned E backaging y.siemens.com/cs/ww/en/vie wnloadcenter (Catalogs, B	/siemens-wind-down-ru ent EAC certificates. atus of validity of the E AEU member states Ru w/109813875	AC certification if you intend	d to import or offer to supp	bly these products to a
Siemens has decided https://press.siemens. Siemens is working Please contact your lo EAC relevant market (Information on the p https://support.industry information- and Dow https://www.siemens.co ndustry Mall (Online https://mall.industry.sie	com/global/en/pressrelease on the renewal of the curre ocal Siemens office on the st (other than the sanctioned E vackaging y.siemens.com/cs/ww/en/vie wnloadcenter (Catalogs, B com/ic10 e ordering system) iemens.com/mall/en/en/Cata	/siemens-wind-down-ru ent EAC certificates. atus of validity of the E AEU member states Ru ew/109813875 rochures,)	AC certification if you intendusia or Belarus).	d to import or offer to supp	bly these products to a
Siemens has decide https://press.siemens. Siemens is working Please contact your lo EAC relevant market (nformation on the p https://support.industry nformation- and Do nttps://www.siemens.c ndustry Mall (Online nttps://mall.industry.sic Cax online generatom http://support.automat Service&Support (Mis	com/global/en/pressrelease on the renewal of the curro ocal Siemens office on the st (other than the sanctioned E ackaging y.siemens.com/cs/ww/en/vie wnloadcenter (Catalogs, B com/ic10 e ordering system) iemens.com/mall/en/en/Cata r tion.siemens.com/WW/CAXe anuals, Certificates, Chara	/siemens-wind-down-ru ent EAC certificates. atus of validity of the E AEU member states Ru ew/109813875 rochures,) log/product?mlfb=3RT2 prder/default.aspx?lang icteristics, FAQs,)	AC certification if you intendusia or Belarus). 2035-3AH00		bly these products to a
Siemens has decide https://press.siemens. Siemens is working Please contact your lo EAC relevant market (information on the p https://support.industry information- and Dow https://www.siemens.co ndustry Mall (Online ndustry Mall (Online cax online generator https://support.automat Service&Support (Ma https://support.industry	com/global/en/pressrelease on the renewal of the curro ocal Siemens office on the st (other than the sanctioned E ackaging y.siemens.com/cs/ww/en/vie wnloadcenter (Catalogs, B com/ic10 a ordering system) emens.com/mall/en/en/Cata r tion.siemens.com/WW/CAXe anuals, Certificates, Chara y.siemens.com/cs/ww/en/ps	/siemens-wind-down-ru ent EAC certificates. (atus of validity of the E AEU member states Ru ew/109813875 (rochures,) (ag/product?mlfb=3RT2 (prder/default.aspx?lang (acteristics, FAQs,) (3RT2035-3AH00	AC certification if you intend ussia or Belarus). 2035-3AH00 u=en&mlfb=3RT2035-3AH00	2	bly these products to a
Siemens has decided https://press.siemens. Siemens is working of Please contact your loc EAC relevant market (Information on the p https://support.industry Information- and Dow https://www.siemens.co Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automat Service&Support (Ma https://support.industry Image database (pro http://www.automation Characteristic: Tripp	com/global/en/pressrelease on the renewal of the curro ocal Siemens office on the st (other than the sanctioned E ackaging y.siemens.com/cs/ww/en/vie wnloadcenter (Catalogs, B com/ic10 e ordering system) iemens.com/mall/en/en/Cata r tion.siemens.com/WW/CAXe anuals, Certificates, Chara	/siemens-wind-down-ru ent EAC certificates. atus of validity of the E AEU member states Ru ew/109813875 rochures,) //////////////////////////////////	AC certification if you intend ussia or Belarus). 2035-3AH00 =en&mlfb=3RT2035-3AH00 Is, device circuit diagram -3AH00⟨=en	2	bly these products to a

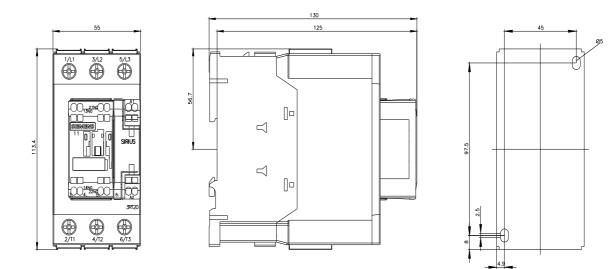

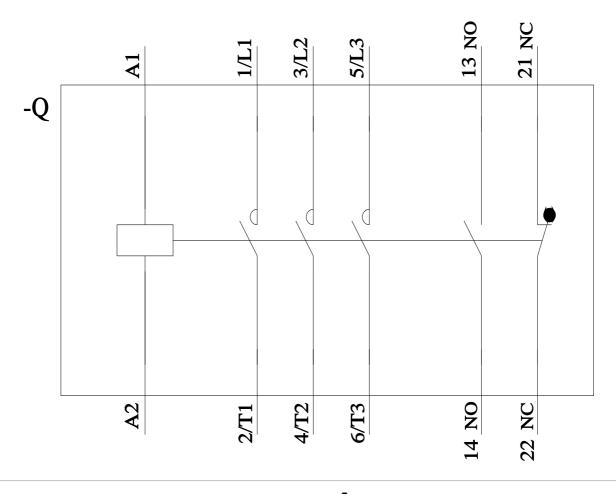

last modified:

8/15/2023 🖸

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Siemens: 3RT20353AH00