SIEMENS

Data sheet

3RT2037-1KB40



power contactor, AC-3e/AC-3, 65 A, 30 kW / 400 V, 3-pole, 24 V DC, 0.8-1.2* Us, with integrated varistor, auxiliary contacts: 1 NO + 1 NC, screw terminal, size: S2, suitable for PLC outputs

| product brand name | SIRIUS |
|---|--|
| • | Coupling contactor |
| product designation product type designation | 3RT2 |
| General technical data | JR12 |
| | <u></u> |
| size of contactor | S2 |
| product extension | |
| function module for communication | No |
| auxiliary switch | Yes |
| power loss [W] for rated value of the current | |
| at AC in hot operating state | 11.4 W |
| at AC in hot operating state per pole | 3.8 W |
| without load current share typical | 1 W |
| insulation voltage | |
| of main circuit with degree of pollution 3 rated value | 690 V |
| of auxiliary circuit with degree of pollution 3 rated value | 690 V |
| surge voltage resistance | |
| of main circuit rated value | 6 kV |
| of auxiliary circuit rated value | 6 kV |
| maximum permissible voltage for protective separation between coil and main contacts according to EN 60947-1 | 400 V |
| shock resistance at rectangular impulse | |
| • at DC | 7.7g / 5 ms, 4.5g / 10 ms |
| shock resistance with sine pulse | |
| • at DC | 12g / 5 ms, 7g / 10 ms |
| mechanical service life (operating cycles) | |
| of contactor typical | 10 000 000 |
| of the contactor with added electronically optimized auxiliary switch block typical | 5 000 000 |
| of the contactor with added auxiliary switch block typical | 10 000 000 |
| reference code according to IEC 81346-2 | Q |
| Substance Prohibitance (Date) | 10/01/2014 |
| SVHC substance name | Blei - 7439-92-1 Bleimonoxid (Bleioxid) - 1317-36-8 |
| Ambient conditions | |
| installation altitude at height above sea level maximum | 2 000 m |
| ambient temperature | |
| during operation | -25 +60 °C |
| during storage | -55 +80 °C |
| relative humidity minimum | 10 % |
| relative humidity at 55 °C according to IEC 60068-2-30 maximum | 95 % |


| Main circuit | |
|---|------------------|
| number of poles for main current circuit | 3 |
| number of NO contacts for main contacts | 3 |
| operating voltage | |
| • at AC-3 rated value maximum | 690 V |
| • at AC-3e rated value maximum | 690 V |
| operational current | |
| at AC-1 at 400 V at ambient temperature 40 °C rated value | 80 A |
| • at AC-1 | |
| — up to 690 V at ambient temperature 40 °C rated value | 80 A |
| — up to 690 V at ambient temperature 60 °C rated value | 70 A |
| • at AC-3 | |
| — at 400 V rated value | 65 A |
| — at 500 V rated value | 65 A |
| — at 690 V rated value | 47 A |
| • at AC-3e | 05 A |
| - at 400 V rated value | 65 A |
| - at 500 V rated value | 65 A |
| — at 690 V rated value | 47 A |
| at AC-4 at 400 V rated value | 55 A 70.4 A |
| at AC-5a up to 690 V rated value | 70.4 A 53.9 A |
| at AC-5b up to 400 V rated value at AC-6a | 55.9 A |
| up to 230 V for current peak value n=20 rated value | 56.9 A |
| — up to 400 V for current peak value n=20 rated value | 56.9 A |
| — up to 500 V for current peak value n=20 rated value | 56.9 A |
| — up to 690 V for current peak value n=20 rated value | 47 A |
| • at AC-6a | |
| — up to 230 V for current peak value n=30 rated value | 38 A |
| — up to 400 V for current peak value n=30 rated value | 38 A |
| — up to 500 V for current peak value n=30 rated value | 38 A |
| — up to 690 V for current peak value n=30 rated value | 38 A |
| minimum cross-section in main circuit at maximum AC-1 rated value | 25 mm² |
| operational current for approx. 200000 operating cycles at AC-4 | |
| • at 400 V rated value | 28 A |
| • at 690 V rated value | 22 A |
| operational current | |
| • at 1 current path at DC-1 | |
| — at 24 V rated value | 55 A |
| — at 60 V rated value | 23 A |
| — at 110 V rated value | 4.5 A |
| — at 220 V rated value | 1 A |
| — at 440 V rated value | 0.4 A |
| — at 600 V rated value | 0.25 A |
| with 2 current paths in series at DC-1 | |
| — at 24 V rated value | 55 A |
| — at 60 V rated value | 45 A |
| — at 110 V rated value | 45 A |
| — at 220 V rated value | 5 A |
| — at 440 V rated value | 1 A |
| — at 600 V rated value | 0.8 A |
| with 3 current paths in series at DC-1 | |
| — at 24 V rated value | 55 A |
| — at 60 V rated value | 55 A |
| — at 110 V rated value | 55 A |
| — at 220 V rated value | 45 A |
| — at 440 V rated value | 2.9 A |


| — at 600 V rated value | 1.4 A |
|--|---|
| at 1 current path at DC-3 at DC-5 | |
| — at 24 V rated value | 35 A |
| — at 60 V rated value | 6 A |
| — at 220 V rated value | 1 A |
| — at 440 V rated value | 0.1 A |
| — at 600 V rated value | 0.06 A |
| with 2 current paths in series at DC-3 at DC-5 | |
| — at 24 V rated value | 55 A |
| — at 60 V rated value | 45 A |
| — at 110 V rated value | 25 A |
| — at 220 V rated value | 5 A |
| — at 440 V rated value | 0.27 A |
| — at 600 V rated value | 0.16 A |
| with 3 current paths in series at DC-3 at DC-5 | |
| — at 24 V rated value | 55 A |
| — at 60 V rated value | 55 A |
| — at 110 V rated value | 55 A |
| — at 220 V rated value | 25 A |
| — at 440 V rated value | 0.6 A |
| — at 600 V rated value | 0.35 A |
| operating power | |
| at AC-2 at 400 V rated value | 30 kW |
| • at AC-3 | |
| — at 230 V rated value | 18.5 kW |
| — at 400 V rated value | 30 kW |
| — at 500 V rated value | 37 kW |
| — at 690 V rated value | 37 kW |
| • at AC-3e | |
| — at 230 V rated value | 18.5 kW |
| — at 400 V rated value | 30 kW |
| — at 500 V rated value | 37 kW |
| — at 690 V rated value | 37 kW |
| operating power for approx. 200000 operating cycles at AC- 4 | |
| at 400 V rated value | 14.7 kW |
| at 690 V rated value | 20 kW |
| operating apparent power at AC-6a | |
| up to 230 V for current peak value n=20 rated value | 22.6 kVA |
| • up to 400 V for current peak value n=20 rated value | 39.4 kVA |
| • up to 500 V for current peak value n=20 rated value | 49.2 kVA |
| • up to 690 V for current peak value n=20 rated value | 56.1 kVA |
| operating apparent power at AC-6a | |
| up to 230 V for current peak value n=30 rated value | 15.1 kVA |
| • up to 400 V for current peak value n=30 rated value | 26.2 kVA |
| up to 500 V for current peak value n=30 rated value | 32.8 kVA |
| up to 690 V for current peak value n=30 rated value | 45.3 kVA |
| short-time withstand current in cold operating state up to 40 $^{\circ}\mathrm{C}$ | |
| limited to 1 s switching at zero current maximum | 1 055 A; Use minimum cross-section acc. to AC-1 rated value |
| limited to 5 s switching at zero current maximum | 730 A; Use minimum cross-section acc. to AC-1 rated value |
| limited to 10 s switching at zero current maximum | 520 A; Use minimum cross-section acc. to AC-1 rated value |
| limited to 30 s switching at zero current maximum | 336 A; Use minimum cross-section acc. to AC-1 rated value |
| limited to 60 s switching at zero current maximum | 272 A; Use minimum cross-section acc. to AC-1 rated value |
| no-load switching frequency | |
| • at DC | 1 500 1/h |
| operating frequency | |
| • at AC-1 maximum | 800 1/h |
| • at AC-2 maximum | 400 1/h |
| • at AC-3 maximum | 700 1/h |
| • at AC-3e maximum | 700 1/h |

| • at AC-4 maximum | 200 1/h |
|---|---|
| Control circuit/ Control | |
| | DC |
| type of voltage of the control supply voltage | DC |
| control supply voltage at DC rated value | 24 V |
| operating range factor control supply voltage rated value of | |
| magnet coil at DC | |
| initial value | 0.8 |
| full-scale value | 1.2 |
| design of the surge suppressor | with varistor |
| inrush current peak | 2.6 A |
| duration of inrush current peak | 50 µs |
| locked-rotor current mean value | 0.9 A |
| locked-rotor current peak | 2.1 A |
| duration of locked-rotor current | 230 ms |
| holding current mean value | 40 mA |
| closing power of magnet coil at DC | 21.5 W |
| holding power of magnet coil at DC | 1 W |
| closing delay | |
| • at DC | 35 80 ms |
| opening delay | |
| • at DC | 30 55 ms |
| arcing time | 10 20 ms |
| control version of the switch operating mechanism | Standard A1 - A2 |
| Auxiliary circuit | |
| number of NC contacts for auxiliary contacts instantaneous contact | 1 |
| number of NO contacts for auxiliary contacts instantaneous contact | 1 |
| operational current at AC-12 maximum | 10 A |
| operational current at AC-15 | |
| at 230 V rated value | 10 A |
| • at 400 V rated value | 3 A |
| • at 500 V rated value | 2 A |
| • at 690 V rated value | 1 A |
| operational current at DC-12 | |
| at 24 V rated value | 10 A |
| at 48 V rated value | 6 A |
| • at 60 V rated value | 6 A |
| • at 110 V rated value | 3 A |
| • at 125 V rated value | 2 A |
| at 220 V rated value | 1 A |
| • at 600 V rated value | 0.15 A |
| operational current at DC-13 | |
| • at 24 V rated value | 10 A |
| • at 48 V rated value | 2 A |
| • at 60 V rated value | 2 A |
| • at 110 V rated value | 1 A |
| • at 125 V rated value | 0.9 A |
| • at 220 V rated value | 0.3 A |
| • at 600 V rated value | 0.1 A |
| contact reliability of auxiliary contacts | 1 faulty switching per 100 million (17 V, 1 mA) |
| UL/CSA ratings | |
| full-load current (FLA) for 3-phase AC motor | |
| • at 480 V rated value | 65 A |
| • at 600 V rated value | 52 A |
| yielded mechanical performance [hp] | |
| for single-phase AC motor | |
| — at 110/120 V rated value | 5 hp |
| — at 230 V rated value | 10 hp |
| • for 3-phase AC motor | |
| P | |

| — at 200/208 V rated value | 20 hp | | |
|---|--|--|--|
| — at 220/230 V rated value | 20 hp | | |
| — at 460/480 V rated value | 50 hp | | |
| — at 575/600 V rated value | 50 hp | | |
| contact rating of auxiliary contacts according to UL | A600 / P600 | | |
| Short-circuit protection | | | |
| design of the fuse link | | | |
| for short-circuit protection of the main circuit | | | |
| — with type of coordination 1 required | gG: 250 A (690 V, 100 kA), aM: 160 A (690 V, 100 kA), BS88: 200 A (415 V, 80 kA) | | |
| — with type of assignment 2 required | gG: 125A (690V,100kA), aM: 63A (690V,100kA), BS88: 100A (415V,80kA) | | |
| for short-circuit protection of the auxiliary switch required | gG: 10 A (500 V, 1 kA) | | |
| Installation/ mounting/ dimensions | | | |
| mounting position | +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface | | |
| fastening method | screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715 | | |
| side-by-side mounting | Yes | | |
| height | 114 mm | | |
| width | 55 mm | | |
| depth | 130 mm | | |
| required spacing | | | |
| with side-by-side mounting | | | |
| — forwards | 10 mm | | |
| — upwards | 10 mm | | |
| — downwards | 10 mm | | |
| — at the side | 0 mm | | |
| for grounded parts | | | |
| — forwards | 10 mm | | |
| — upwards | 10 mm | | |
| — at the side | 6 mm | | |
| — downwards | 10 mm | | |
| for live parts | | | |
| — forwards | 10 mm | | |
| — upwards | 10 mm | | |
| — downwards | 10 mm | | |
| — at the side | 6 mm | | |
| Connections/ Terminals | | | |
| type of electrical connection | | | |
| • for main current circuit | screw-type terminals | | |
| for auxiliary and control circuit | screw-type terminals | | |
| at contactor for auxiliary contacts | Screw-type terminals | | |
| of magnet coil | Screw-type terminals | | |
| type of connectable conductor cross-sections for main contacts | | | |
| solid or stranded | 2x (1 35 mm²), 1x (1 50 mm²) | | |
| finely stranded with core end processing | 2x (1 25 mm²), 1x (1 35 mm²) | | |
| connectable conductor cross-section for main contacts | | | |
| finely stranded with core end processing | 1 35 mm² | | |
| connectable conductor cross-section for auxiliary contacts | | | |
| solid or stranded | 0.5 2.5 mm ² | | |
| finely stranded with core end processing | 0.5 2.5 mm² | | |
| type of connectable conductor cross-sections | | | |
| for auxiliary contacts | | | |
| — solid or stranded | 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²) | | |
| - finely stranded with core end processing | 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²) | | |
| for AWG cables for auxiliary contacts | 2x (20 16), 2x (18 14) | | |
| AWG number as coded connectable conductor cross section | | | |
| • for main contacts | 18 1 | | |
| for auxiliary contacts | 20 14 | | |
| Safety related data | | | |
| product function | | | |

| 10 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 | ccording to IEC 60947-4-1 | Yes | | | |
|---|---|---|--|---|--|
| positively driven operation according to IEC 60947-5-1 | | | | | |
| suitability for use safety-related switching OFF B10 value with high demand rate according to SN 31920 | | Yes | 0.000 | | |
| | | 1 00 | 0 000 | | |
| proportion of dangero | | | | | |
| with low demand rate according to SN 31920 | | | | | |
| with high demand rate according to SN 31920 | | | | | |
| failure rate [FIT] with low demand rate according to SN 31920 | | | FIT | | |
| T1 value for proof test i 61508 | interval or service life acco | ording to IEC 20 a | | | |
| - | n the front according to I the front according to IEC | | er-safe, for vertical conta | ct from the front | |
| ertificates/ approvals | | in ge | | | |
| General Product App | | | | | |
| () M | Confirmation | | | KC | EAC |
| EMC | Functional Safety/Safety of Ma- chinery | Declaration of Confo | rmity | Test Certificates | |
| RCM | <u>Type Examination Cer-</u> <u>tificate</u> | UK CA | CE EG-Konf. | <u>Special Test Certific-</u> <u>ate</u> | <u>Type Test Certific-</u> ates/Test Report |
| Marine / Shipping | | | | | |
| ABS | BUREAU VERITAS | | Lloyd's Register uts | PRS | RINA |
| Marine / Shipping | other | Railway | Environment | | |
| | <u>Confirmation</u> | Vibration and Shock | Environmental Con- firmations | | |
| RMRS | | | | | |
| RMRS | | | | | |
| | to exit the Russian mar | ket (see here). | _ | | |
| Siemens has decided | I to exit the Russian mar | ket (see here). e/siemens-wind-down-rus | ssian-business | | |
| Siemens has decided https://press.siemens.cc Siemens is working o Please contact your loc EAC relevant market (cc Information on the pa | com/global/en/pressrelease on the renewal of the currical Siemens office on the softice on the softice on the softer than the sanctioned lackaging | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru | C certification if you inte | nd to import or offer to supp | ly these products to an |
| Siemens has decided https://press.siemens.c Siemens is working o Please contact your loc EAC relevant market (c Information on the pa https://support.industry Information- and Dow | com/global/en/pressrelease on the renewal of the curr cal Siemens office on the s other than the sanctioned l ackaging v.siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 | C certification if you inte | nd to import or offer to supp | ly these products to an |
| Siemens has decided https://press.siemens.cc Siemens is working o Please contact your loc EAC relevant market (c Information on the pa https://support.industry Information- and Dow https://www.siemens.cc Industry Mall (Online | com/global/en/pressrelease on the renewal of the currical Siemens office on the so other than the sanctioned lackaging v.siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I om/ic10 | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 Brochures,) | ∖C certification if you inte ssia or Belarus). | nd to import or offer to supp | ly these products to an |
| Siemens has decided https://press.siemens.cc Siemens is working o Please contact your loo EAC relevant market (o Information on the pa https://support.industry Information- and Dow https://www.siemens.cc Industry Mall (Online https://mall.industry.sie Cax online generator | com/global/en/pressrelease on the renewal of the curr cal Siemens office on the s other than the sanctioned I ackaging v.siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I om/ic10 ordering system) emens.com/mall/en/en/Cat | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RT20 | AC certification if you inte ssia or Belarus). 037-1KB40 | | ly these products to an |
| Siemens has decided https://press.siemens.c Siemens is working o Please contact your loc EAC relevant market (c Information on the pa https://support.industry Information- and Dow https://www.siemens.cc Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automatic | com/global/en/pressrelease on the renewal of the curr cal Siemens office on the s other than the sanctioned I ackaging v.siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I om/ic10 ordering system) emens.com/mall/en/en/Cat | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RT20 iorder/default.aspx?lang= | AC certification if you inte ssia or Belarus). 037-1KB40 | | ly these products to an |
| Siemens has decided https://press.siemens.cc Siemens is working o Please contact your loc EAC relevant market (c Information on the pa https://support.industry Information- and Dow https://www.siemens.cc Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automatic Service&Support (Ma | com/global/en/pressrelease on the renewal of the curr cal Siemens office on the s other than the sanctioned I ackaging v.siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I om/ic10 ordering system) emens.com/mall/en/en/Cat | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RT20 corder/default.aspx?lang= acteristics, FAQs,) | AC certification if you inte ssia or Belarus). 037-1KB40 | | ly these products to an |
| Siemens has decided https://press.siemens.cc Siemens is working o Please contact your loc EAC relevant market (c Information on the pa https://support.industry Information- and Dow https://www.siemens.cc Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automatic Service&Support.industry Image database (prod | com/global/en/pressrelease on the renewal of the curr cal Siemens office on the s other than the sanctioned I ackaging v.siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I om/ic10 ordering system) emens.com/mall/en/en/Cat on.siemens.com/WW/CAX nuals, Certificates, Char v.siemens.com/cs/ww/en/p duct images, 2D dimensio | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RT20 forder/default.aspx?lang= acteristics, FAQs,) s/3RT2037-1KB40 on drawings, 3D models | AC certification if you inte ssia or Belarus). 037-1KB40 een&mlfb=3RT2037-1KB s, device circuit diagram | <u>40</u> | ly these products to an |
| https://press.siemens.cc Siemens is working o Please contact your loc EAC relevant market (cc Information on the pa https://support.industry Information- and Dow https://www.siemens.cc Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automatic Service&Support (Ma https://support.industry Image database (proc http://www.automation. Characteristic: Trippi | com/global/en/pressrelease on the renewal of the curr cal Siemens office on the s other than the sanctioned I ackaging v.siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I om/ic10 ordering system) emens.com/mall/en/en/Cat on.siemens.com/WW/CAX nuals, Certificates, Char v.siemens.com/cs/ww/en/p duct images, 2D dimensio siemens.com/bilddb/cax of ing characteristics, I ² t, Le | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RT20 forder/default.aspx?lang= acteristics, FAQs,) s/3RT2037-1KB40 on drawings, 3D models de.aspx?mlfb=3RT2037-7 et-through current | AC certification if you inte ssia or Belarus). 037-1KB40 een&mlfb=3RT2037-1KB s, device circuit diagram | <u>40</u> | ly these products to an |
| Siemens has decided https://press.siemens.co Siemens is working o Please contact your loc EAC relevant market (or Information on the pa https://support.industry Information- and Dow https://www.siemens.co Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automatio Service&Support (Ma https://support.industry Image database (proor http://www.automation. Characteristic: Trippi https://support.industry | com/global/en/pressrelease on the renewal of the curr cal Siemens office on the s other than the sanctioned I ackaging siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I om/ic10 ordering system) emens.com/mall/en/en/Cat on.siemens.com/WW/CAX nuals, Certificates, Char siemens.com/cs/ww/en/p duct images, 2D dimensio siemens.com/bilddb/cax siemens.com/bilddb/cax | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RT24 forder/default.aspx?lang= acteristics, FAQs,) s/3RT2037-1KB40 on drawings, 3D models de.aspx?mlfb=3RT2037-7 et-through current s/3RT2037-1KB40/char | AC certification if you inte ssia or Belarus). 037-1KB40 een&mlfb=3RT2037-1KB s, device circuit diagram | <u>40</u> | ly these products to an |
| Siemens has decided https://press.siemens.c Siemens is working o Please contact your loc EAC relevant market (c Information on the pa https://support.industry Information- and Dow https://www.siemens.cc Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automatic Service&Support (Ma https://support.industry Image database (prood http://support.industry Characteristic: Trippi https://support.industry Further characteristic | com/global/en/pressrelease on the renewal of the curr cal Siemens office on the s other than the sanctioned I ackaging siemens.com/cs/ww/en/vi vnloadcenter (Catalogs, I om/ic10 ordering system) emens.com/mall/en/en/Cat on.siemens.com/cs/ww/en/p duct images, 2D dimensi siemens.com/bilddb/cax (ing characteristics, I²t, Le siemens.com/cs/ww/en/p cs (e.g. electrical endurai | e/siemens-wind-down-rus rent EAC certificates. tatus of validity of the EA EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RT20 corder/default.aspx?lang= acteristics, FAQs,) s/3RT2037-1KB40 on drawings, 3D models de.aspx?mlfb=3RT2037- et-through current s/3RT2037-1KB40/char nce, switching frequence | AC certification if you inte ssia or Belarus). 037-1KB40 een&mlfb=3RT2037-1KB s, device circuit diagrau 1KB40⟨=en | <u>40</u> | ly these products to an |

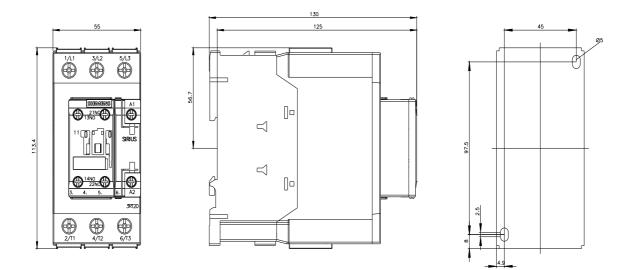

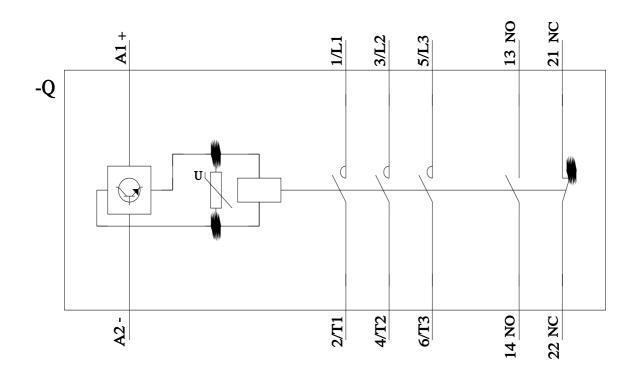

8/15/2023 🖸

8/16/2023

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Siemens: 3RT20371KB40