## SIEMENS

## Data sheet

## 3RV2011-0GA15




Circuit breaker size S00 for motor protection, CLASS 10 A-release 0.45...0.63 A N-release 8.2 A screw terminal Standard switching capacity with transverse auxiliary switches 1 NO+1 NC


6/73 E/73	
product brand name	SIRIUS
product designation	Circuit breaker
design of the product	For motor protection
product type designation	3RV2
General technical data	
size of the circuit-breaker	S00
size of contactor can be combined company-specific	S00, S0
product extension auxiliary switch	Yes
power loss [W] for rated value of the current	
<ul> <li>at AC in hot operating state</li> </ul>	5.5 W
<ul> <li>at AC in hot operating state per pole</li> </ul>	1.8 W
insulation voltage with degree of pollution 3 at AC rated value	690 V
surge voltage resistance rated value	6 kV
shock resistance according to IEC 60068-2-27	25g / 11 ms
mechanical service life (operating cycles)	
<ul> <li>of the main contacts typical</li> </ul>	100 000
<ul> <li>of auxiliary contacts typical</li> </ul>	100 000
electrical endurance (operating cycles) typical	100 000
type of protection according to ATEX directive 2014/34/EU	Ex II (2) GD
certificate of suitability according to ATEX directive 2014/34/EU	DMT 02 ATEX F 001
reference code according to IEC 81346-2	Q
Substance Prohibitance (Date)	10/01/2009
Ambient conditions	
installation altitude at height above sea level maximum	2 000 m
ambient temperature	
<ul> <li>during operation</li> </ul>	-20 +60 °C
during storage	-50 +80 °C
during transport	-50 +80 °C
relative humidity during operation	10 95 %
Main circuit	
number of poles for main current circuit	3
adjustable current response value current of the current- dependent overload release	0.45 0.63 A
operating voltage	
rated value	20 690 V
<ul> <li>at AC-3 rated value maximum</li> </ul>	690 V
<ul> <li>at AC-3e rated value maximum</li> </ul>	690 V
operating frequency rated value	50 60 Hz
operational current rated value	0.63 A
operational current	


<ul> <li>at AC-3 at 400 V rated value</li> </ul>	0.63 A
• at AC-3e at 400 V rated value	0.63 A
operating power	
• at AC-3	
— at 230 V rated value	0.1 kW
— at 400 V rated value	0.18 kW
— at 500 V rated value	0.2 kW
— at 690 V rated value	0.3 kW
• at AC-3e	
— at 230 V rated value	0.1 kW
— at 400 V rated value	0.18 kW
— at 500 V rated value	0.2 kW
— at 690 V rated value	0.3 kW
operating frequency	
• at AC-3 maximum	15 1/h
• at AC-3e maximum	15 1/h
Auxiliary circuit	
	transverse
design of the auxiliary switch	transverse
number of NC contacts for auxiliary contacts	1
number of NO contacts for auxiliary contacts	1
number of CO contacts for auxiliary contacts	0
operational current of auxiliary contacts at AC-15	
• at 24 V	2 A
• at 120 V	0.5 A
• at 125 V	0.5 A
• at 230 V	0.5 A
operational current of auxiliary contacts at DC-13	
• at 24 V	1 A
• at 60 V	0.15 A
Protective and monitoring functions	
product function	
<ul> <li>ground fault detection</li> </ul>	No
phase failure detection	Yes
trip class	CLASS 10
design of the overload release	thermal
maximum short-circuit current breaking capacity (Icu)	
<ul> <li>at AC at 240 V rated value</li> </ul>	100 kA
• at AC at 400 V rated value	100 kA
<ul> <li>at AC at 500 V rated value</li> </ul>	100 kA
<ul> <li>at AC at 690 V rated value</li> </ul>	100 kA
operating short-circuit current breaking capacity (Ics) at AC	
• at 240 V rated value	100 kA
• at 400 V rated value	100 kA
at 500 V rated value	100 kA
at 690 V rated value	100 kA
response value current of instantaneous short-circuit trip unit	8.2 A
UL/CSA ratings	
full-load current (FLA) for 3-phase AC motor	0.02.4
at 480 V rated value	0.63 A
at 600 V rated value	0.63 A
contact rating of auxiliary contacts according to UL	C300 / R300
Short-circuit protection	
product function short circuit protection	Yes
design of the short-circuit trip	magnetic
design of the fuse link	
<ul> <li>for short-circuit protection of the auxiliary switch required</li> </ul>	Fuse gL/gG: 10 A, miniature circuit breaker C 6 A (short-circuit current lk < 400
design of the fuse link for IT network for short-circuit	A)
protection of the main circuit	A)
protection of the main circuit ● at 690 V	gL/gG 6 A

mounting position	any
fastening method	screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715
height	97 mm
width	45 mm
depth	97 mm
required spacing	
with side-by-side mounting at the side	0 mm
<ul> <li>for grounded parts at 400 V</li> </ul>	
— downwards	30 mm
— upwards	30 mm
— at the side	9 mm
• for live parts at 400 V	3 1111
	20 mm
— downwards	30 mm
— upwards	30 mm
— at the side	9 mm
<ul> <li>for grounded parts at 500 V</li> </ul>	
— downwards	30 mm
— upwards	30 mm
— at the side	9 mm
• for live parts at 500 V	
— downwards	30 mm
— upwards	30 mm
— at the side	9 mm
<ul> <li>for grounded parts at 690 V</li> </ul>	
— downwards	50 mm
— upwards	50 mm
— backwards	0 mm
— at the side	30 mm
— forwards	0 mm
<ul> <li>for live parts at 690 V</li> </ul>	
— downwards	50 mm
— upwards	50 mm
— backwards	0 mm
— at the side	30 mm
— forwards	0 mm
onnections/ Terminals	
type of electrical connection	
for main current circuit	screw-type terminals
	screw-type terminals
for auxiliary and control circuit arrangement of electrical connectors for main current	Top and bottom
circuit	Top and boltom
type of connectable conductor cross-sections	
for main contacts	
- solid or stranded	2x (0,75 2,5 mm²), 2x 4 mm²
— finely stranded with core end processing	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)
for AWG cables for main contacts	2x (18 14), 2x 12
type of connectable conductor cross-sections	
<ul> <li>for auxiliary contacts</li> </ul>	
— solid or stranded	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)
<ul> <li>finely stranded with core end processing</li> </ul>	2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²)
<ul> <li>for AWG cables for auxiliary contacts</li> </ul>	2x (20 16), 2x (18 14)
tightening torque	
<ul> <li>for main contacts with screw-type terminals</li> </ul>	0.8 1.2 N·m
<ul> <li>for auxiliary contacts with screw-type terminals</li> </ul>	0.8 1.2 N·m
design of screwdriver shaft	Diameter 5 to 6 mm
size of the screwdriver tip	Pozidriv size 2
•	I UZIUTIV SIZE Z
design of the thread of the connection screw	
	M3
for main contacts	
<ul> <li>for main contacts</li> <li>of the auxiliary and control contacts</li> <li>afety related data</li> </ul>	M3

proportion of depart	nd rate according to SN 3192	.0	5 000			
	ous failures					
	d rate according to SN 31920		50 %			
<b>T</b>	nd rate according to SN 3192	:0 E	50 %			
failure rate [FIT]						
with low demand rate according to SN 31920			50 FIT			
T1 value for proof test interval or service life according to IEC 61508			10 a			
protection class IP on the front according to IEC 60529			IP20			
touch protection on t	the front according to IEC 6	6 <b>0529</b> f	finger-safe, for vertical contact from the front			
display version for swit	tching status	ŀ	Handle			
ertificates/ approvals	;					
General Product App	proval				For use in hazard- ous locations	
<u>Confirmation</u>			KC	EHC	IECEx	
For use in hazard- ous locations	Declaration of Conform	ity	Test Certificates		Marine / Shipping	
K ATEX	CE EG-Konf.	UK CA	Special Test Certific- ate	Type Test Certific- ates/Test Report	ABS	
Marine / Shipping					other	
BUREAU VERITAS		Lloyd's Register uis	PRS	RINA	<u>Confirmation</u>	
other	Railway					
other	Railway Vibration and Shock	<u>Confirmation</u>				
other		<u>Confirmation</u>				
urther information Siemens has decided	<u>Vibration and Shock</u>	t (see here).				
urther information Siemens has decided https://press.siemens.co Siemens is working of Please contact your loo EAC relevant market (in Information on the pa	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curren cal Siemens office on the sta other than the sanctioned EA	t (see here). siemens-wind-down nt EAC certificates tus of validity of the LEU member states	<b>s.</b> e EAC certification if you intend	to import or offer to supp	oly these products to an	
urther information Siemens has decided https://press.siemens.co Siemens is working of Please contact your loo EAC relevant market (in Information on the pa https://support.industry Information- and Dow https://www.siemens.co	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curren cal Siemens office on the sta other than the sanctioned EA ackaging y.siemens.com/cs/ww/en/view wnloadcenter (Catalogs, Br com/ic10	t (see here). siemens-wind-down nt EAC certificates tus of validity of the EU member states v/109813875	<b>s.</b> e EAC certification if you intend	to import or offer to supp	oly these products to an	
urther information Siemens has decided https://press.siemens.co Siemens is working of Please contact your loo EAC relevant market (in Information on the pa https://support.industry Information- and Dow https://www.siemens.co	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curren cal Siemens office on the sta other than the sanctioned EA ackaging y.siemens.com/cs/ww/en/view wnloadcenter (Catalogs, Br com/ic10	t (see here). siemens-wind-down nt EAC certificates tus of validity of the EU member states v/109813875 ochures,)	<b>s.</b> e EAC certification if you intend e Russia or Belarus).	to import or offer to sup	oly these products to an	
urther information Siemens has decided https://press.siemens.or Siemens is working of Please contact your lo EAC relevant market (in Information on the pa https://support.industry Information - and Dow https://wall.industry.sie Industry Mall (Online https://mall.industry.sie Cax online generator	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curren cal Siemens office on the sta other than the sanctioned EA ackaging y.siemens.com/cs/ww/en/view wnloadcenter (Catalogs, Bri com/ic10 ordering system) emens.com/mall/en/en/Catalog	t (see here). siemens-wind-down nt EAC certificates tus of validity of the LEU member states v/109813875 ochures,) pg/product?mlfb=3F	<b>s.</b> e EAC certification if you intend s Russia or Belarus). RV2011-0GA15		oly these products to an	
urther information Siemens has decided https://press.siemens.cc Siemens is working of Please contact your low EAC relevant market (in Information on the pa https://support.industry Information- and Dow https://wall.industry.sie Cax online generator http://support.automati	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curren cal Siemens office on the sta other than the sanctioned EA ackaging y.siemens.com/cs/ww/en/view wnloadcenter (Catalogs, Bri com/ic10 ordering system) emens.com/mall/en/en/Catalog ion.siemens.com/WW/CAXor	t (see here). siemens-wind-down nt EAC certificates tus of validity of the EU member states v/109813875 ochures,) pg/product?mlfb=3f der/default.aspx?la	s. e EAC certification if you intend Russia or Belarus). RV2011-0GA15 ang=en&mlfb=3RV2011-0GA15		bly these products to an	
urther information Siemens has decided https://press.siemens.c Siemens is working of Please contact your loc EAC relevant market (c Information on the pa https://support.industry Information- and Dow https://www.siemens.c Industry Mall (Online https://mall.industry.sie Cax online generator http://support.automati Service&Support (Ma https://support.industry	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curren cal Siemens office on the sta other than the sanctioned EA ackaging v.siemens.com/cs/ww/en/view wnloadcenter (Catalogs, Br com/ic10 ordering system) emens.com/mall/en/en/Catalo ion.siemens.com/WW/CAXor anuals, Certificates, Characo v.siemens.com/cs/ww/en/ps/s	t (see here). siemens-wind-down nt EAC certificates tus of validity of the EU member states v/109813875 ochures,) pg/product?mlfb=3f cder/default.aspx?la teristics, FAQs, 3RV2011-0GA15	s. e EAC certification if you intend s Russia or Belarus). <u>RV2011-0GA15</u> ang=en&mlfb=3RV2011-0GA15 )	i	bly these products to an	
Inter information Siemens has decided https://press.siemens.or Siemens is working of Please contact your low EAC relevant market (of Information on the pa https://support.industry Information- and Dow https://www.siemens.or Industry Mall (Online https://support.industry.sie Cax online generator https://support.automati Service&Support (Ma https://support.industry Image database (proo	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curren cal Siemens office on the stat ackaging y.siemens.com/cs/ww/en/view wnloadcenter (Catalogs, Br com/ic10 ordering system) emens.com/mall/en/en/Cataloc ion.siemens.com/WW/CAXor anuals, Certificates, Characo y.siemens.com/cs/ww/en/ps/2 duct images, 2D dimension	t (see here). siemens-wind-dowr nt EAC certificates tus of validity of the EU member states w/109813875 ochures,) pg/product?mlfb=3f der/default.aspx?la iteristics, FAQs, 3RV2011-0GA15 o drawings, 3D mo	s. e EAC certification if you intend Russia or Belarus). RV2011-0GA15 ang=en&mlfb=3RV2011-0GA15 ) odels, device circuit diagrams	i	oly these products to an	
Inther information Siemens has decided https://press.siemens.or Please contact your loo EAC relevant market (information on the pa https://support.industry Information- and Dow https://www.siemens.or Industry Mall (Online https://support.automation Service&Support (Ma https://support.industry Service&Support (Ma https://support.industry Image database (proo http://www.automation Characteristic: Trippi	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curren cal Siemens office on the sta other than the sanctioned EA ackaging y.siemens.com/cs/ww/en/view wnloadcenter (Catalogs, Br com/ic10 ordering system) emens.com/mall/en/en/Cataloc ion.siemens.com/WW/CAXor anuals, Certificates, Characo y.siemens.com/cs/ww/en/ps// duct images, 2D dimension .siemens.com/bilddb/cax_de ing characteristics, I²t, Let-	t (see here). siemens-wind-dowr nt EAC certificates tus of validity of the EU member states w/109813875 ochures,) pg/product?mlfb=3f der/default.aspx?la steristics, FAQs, 3gN/2011-0GA15 odrawings, 3D mo .aspx?mlfb=3RV20 through current	s. e EAC certification if you intend Russia or Belarus). RV2011-0GA15 ang=en&mlfb=3RV2011-0GA15 ) odels, device circuit diagrams	i	bly these products to an	
urther information Siemens has decided https://press.siemens.or Please contact your loo EAC relevant market (information on the pa https://support.industry Information- and Dow https://www.siemens.or Industry Mall (Online https://support.industry.sie Cax online generator http://support.industry.sie Service&Support (Ma https://support.industry Image database (proor http://www.automation Characteristic: Trippi https://support.industry	Vibration and Shock d to exit the Russian marke com/global/en/pressrelease/s on the renewal of the curred cal Siemens office on the stat other than the sanctioned EA ackaging y.siemens.com/cs/ww/en/view wnloadcenter (Catalogs, Bri- com/ic10 e ordering system) emens.com/mall/en/en/Catalog ion.siemens.com/WW/CAXor anuals, Certificates, Characo y.siemens.com/cs/ww/en/ps/3 duct images, 2D dimension .siemens.com/bilddb/cax_de	t (see here). siemens-wind-dowr nt EAC certificates tus of validity of the EU member states w/109813875 ochures,) pg/product?mlfb=3f der/default.aspx?la teristics, FAQs, 3RV2011-0GA15 o drawings, 3D mo .aspx?mlfb=3RV20 through current 3RV2011-0GA15/cf	s. e EAC certification if you intend Russia or Belarus). RV2011-0GA15 ang=en&mlfb=3RV2011-0GA15 ) dels, device circuit diagrams 111-0GA15⟨=en har	i	bly these products to an	

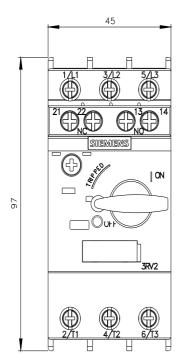


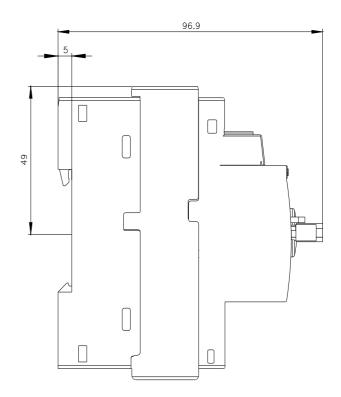

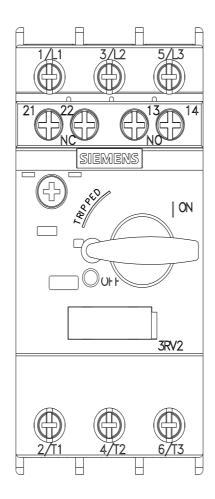

8/17/2023

Subject to change without notice © Copyright Siemens

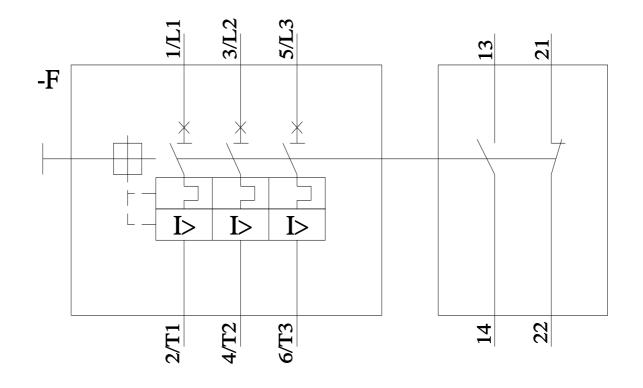

last modified:

11/21/2022 🖸

## **Mouser Electronics**

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Siemens: 3RV20110GA15