SIEMENS

Data sheet

3RV2021-1AA25



Circuit breaker size S0 for motor protection, CLASS 10 A-release 1.1...1.6 A N-release 21 A Spring-type terminal Standard switching capacity with transverse auxiliary switches 1 NO+1 NC $\,$

| product brand name | SIRIUS |
|---|----------------------|
| product designation | Circuit breaker |
| design of the product | For motor protection |
| product type designation | 3RV2 |
| General technical data | |
| size of the circuit-breaker | S0 |
| size of contactor can be combined company-specific | S00, S0 |
| product extension auxiliary switch | Yes |
| power loss [W] for rated value of the current | |
| at AC in hot operating state | 7.25 W |
| at AC in hot operating state per pole | 2.4 W |
| insulation voltage with degree of pollution 3 at AC rated value | 690 V |
| surge voltage resistance rated value | 6 kV |
| shock resistance according to IEC 60068-2-27 | 25g / 11 ms |
| mechanical service life (operating cycles) | |
| of the main contacts typical | 100 000 |
| of auxiliary contacts typical | 100 000 |
| electrical endurance (operating cycles) typical | 100 000 |
| type of protection according to ATEX directive 2014/34/EU | Ex II (2) GD |
| certificate of suitability according to ATEX directive 2014/34/EU | DMT 02 ATEX F 001 |
| reference code according to IEC 81346-2 | Q |
| Substance Prohibitance (Date) | 10/01/2009 |
| Ambient conditions | |
| installation altitude at height above sea level maximum | 2 000 m |
| ambient temperature | |
| during operation | -20 +60 °C |
| during storage | -50 +80 °C |
| during transport | -50 +80 °C |
| relative humidity during operation | 10 95 % |
| Main circuit | |
| number of poles for main current circuit | 3 |
| adjustable current response value current of the current- dependent overload release | 1.1 1.6 A |
| operating voltage | |
| rated value | 20 690 V |
| at AC-3 rated value maximum | 690 V |
| • at AC-3e rated value maximum | 690 V |
| operating frequency rated value | 50 60 Hz |
| operational current rated value | 1.6 A |
| operational current | |

| • at AC-3 at 400 V rated value | 1.6 A |
|--|-----------------------|
| • at AC-3e at 400 V rated value | 1.6 A |
| operating power | |
| • at AC-3 | |
| — at 230 V rated value | 0.3 kW |
| — at 400 V rated value | 0.6 kW |
| — at 500 V rated value | 0.8 kW |
| — at 690 V rated value | 1.1 kW |
| • at AC-3e | |
| — at 230 V rated value | 0.3 kW |
| — at 400 V rated value | 0.6 kW |
| — at 500 V rated value | 0.8 kW |
| — at 690 V rated value | 1.1 kW |
| operating frequency | |
| • at AC-3 maximum | 15 1/h |
| • at AC-3e maximum | 15 1/h |
| Auxiliary circuit | |
| design of the auxiliary switch | transverse |
| number of NC contacts for auxiliary contacts | 1 |
| number of NO contacts for auxiliary contacts | 1 |
| number of CO contacts for auxiliary contacts | 0 |
| | 0 |
| operational current of auxiliary contacts at AC-15 | |
| • at 24 V | 2 A |
| • at 120 V | 0.5 A |
| • at 125 V | 0.5 A |
| • at 230 V | 0.5 A |
| operational current of auxiliary contacts at DC-13 | |
| • at 24 V | 1 A |
| • at 60 V | 0.15 A |
| Protective and monitoring functions | |
| product function | |
| ground fault detection | No |
| phase failure detection | Yes |
| trip class | CLASS 10 |
| design of the overload release | thermal |
| maximum short-circuit current breaking capacity (Icu) | |
| at AC at 240 V rated value | 100 kA |
| at AC at 400 V rated value | 100 kA |
| at AC at 500 V rated value | 100 kA |
| at AC at 690 V rated value | 100 kA |
| operating short-circuit current breaking capacity (Ics) at AC | |
| at 240 V rated value | 100 kA |
| • at 400 V rated value | 100 kA |
| • at 500 V rated value | 100 kA |
| • at 690 V rated value | 100 kA |
| response value current of instantaneous short-circuit trip unit | 21 A |
| UL/CSA ratings | |
| full-load current (FLA) for 3-phase AC motor | |
| at 480 V rated value | 1.6 A |
| at 600 V rated value | 1.6 A |
| yielded mechanical performance [hp] | |
| for single-phase AC motor | |
| at 230 V rated value | 0.1 hp |
| | 0.1 hp |
| for 3-phase AC motor at 460(480.) (stand uplus | 4 hr |
| — at 460/480 V rated value | |
| | 1 hp |
| — at 575/600 V rated value | 0.8 hp |
| contact rating of auxiliary contacts according to UL | |
| contact rating of auxiliary contacts according to UL Short-circuit protection | 0.8 hp C300 / R300 |
| contact rating of auxiliary contacts according to UL | 0.8 hp |
| contact rating of auxiliary contacts according to UL Short-circuit protection | 0.8 hp C300 / R300 |


design of the fuse link


• for short-circuit protection of the auxiliary switch required


Fuse gL/gG: 10 A, miniature circuit breaker C 6 A (short-circuit current lk < 400 A)


| nstallation/ mounting/ dimensions | |
|--|--|
| mounting position | any |
| fastening method | screw and snap-on mounting onto 35 mm DIN rail according to DIN EN 60715 |
| height | 119 mm |
| width | 45 mm |
| depth | 97 mm |
| required spacing | |
| with side-by-side mounting at the side | 0 mm |
| for grounded parts at 400 V | |
| — downwards | 30 mm |
| — upwards | 30 mm |
| — at the side | 9 mm |
| • for live parts at 400 V | |
| — downwards | 30 mm |
| — upwards | 30 mm |
| — at the side | 9 mm |
| • for grounded parts at 500 V | 5 mm |
| | 20 mm |
| — downwards | 30 mm 30 mm |
| — upwards | |
| — at the side | 9 mm |
| • for live parts at 500 V | 20 mm |
| — downwards | 30 mm |
| — upwards | 30 mm |
| — at the side | 9 mm |
| for grounded parts at 690 V | |
| — downwards | 50 mm |
| — upwards | 50 mm |
| — backwards | 0 mm |
| — at the side | 30 mm |
| — forwards | 0 mm |
| for live parts at 690 V | |
| — downwards | 50 mm |
| — upwards | 50 mm |
| — backwards | 0 mm |
| — at the side | 30 mm |
| — forwards | 0 mm |
| connections/ Terminals | |
| type of electrical connection | |
| for main current circuit | spring-loaded terminals |
| for auxiliary and control circuit | spring-loaded terminals |
| arrangement of electrical connectors for main current | Top and bottom |
| circuit | |
| type of connectable conductor cross-sections | |
| for main contacts | |
| — solid or stranded | 2x (1 10 mm²) |
| - finely stranded with core end processing | 2x (1 6 mm²) |
| - finely stranded without core end processing | 2x (1 6 mm²) |
| for AWG cables for main contacts | 2x (18 8) |
| type of connectable conductor cross-sections | |
| for auxiliary contacts | |
| — solid or stranded | 2x (0.5 2.5 mm²) |
| finely stranded with core end processing | 2x (0.5 1.5 mm ²) |
| — finely stranded without core end processing | 2x (0.5 1.5 mm ²) |
| for AWG cables for auxiliary contacts | 2x (20 14) |
| design of screwdriver shaft | Diameter 3 mm |
| size of the screwdriver tip | 3,0 x 0,5 mm |
| Safety related data | |
| B10 value | |
| | |

| • with high demand proportion of dangerou | rate according to SN 319 | 920 5.0 | 00 | | |
|--|---|--|---|---|-------------------------------------|
| proportion of dangerou | | | | | |
| | us failures | | | | |
| with low demand r | rate according to SN 3192 | 20 50 | % | | |
| with high demand | rate according to SN 319 | 920 50 | % | | |
| failure rate [FIT] | | | | | |
| with low demand r | rate according to SN 3192 | 20 50 | FIT | | |
| • | iterval or service life acco | rding to IEC 10 a | а | | |
| 61508 | | | | | |
| protection class IP on | the front according to IE | | | | |
| touch protection on the | e front according to IEC | 60529 fing | er-safe, for vertical contact | from the front | |
| display version for switch | hing status | Har | ndle | | |
| ertificates/ approvals | | | | | |
| General Product Appro | oval | | | | For use in hazard- ous locations |
| | <u>Confirmation</u> | U | KC | EHC | K ATEX |
| For use in hazard- ous locations | Declaration of Conform | mity | Test Certificates | | Marine / Shipping |
| IECEx | UK CA | CE EG-Konf. | Special Test Certific- ate | Type Test Certific- ates/Test Report | ABS |
| Marine / Shipping | | | | | other |
| | | Hoyds Kegister us | PRS | RINA | <u>Confirmation</u> |
| TENTIAS | | | | | |
| other | Railway | | | | |
| other VDE | Railway Confirmation | Vibration and Shock | | | |
| UTTHE INFORMATION | Confirmation | tet (see here). | | | |
| urther information Siemens has decided th https://press.siemens.co Siemens is working on Please contact your loca EAC relevant market (oth Information on the pac https://support.industry.s | Confirmation to exit the Russian mark m/global/en/pressrelease the renewal of the curra al Siemens office on the si her than the sanctioned E kaging siemens.com/cs/ww/en/vie | tet (see here). Set (s | AC certification if you intend | I to import or offer to sup | ply these products to an |
| urther information Siemens has decided th https://press.siemens.co Siemens is working on Please contact your loca EAC relevant market (oth Information on the pac https://support.industry.ss Information- and Down https://www.siemens.cor Industry Mall (Online o | Confirmation to exit the Russian mark m/global/en/pressrelease the renewal of the curra al Siemens office on the si ther than the sanctioned E skaging siemens.com/cs/ww/en/vie hloadcenter (Catalogs, E m/ic10 ordering system) | et (see here). /siemens-wind-down-ru ent EAC certificates. tatus of validity of the E EAEU member states Ru ew/109813875 Brochures,) | AC certification if you intend ussia or Belarus). | I to import or offer to sup | ply these products to an |
| urther information Siemens has decided th https://press.siemens.co Siemens is working on Please contact your loca EAC relevant market (oth Information on the pac https://support.industry.si Information- and Down https://www.siemens.cor Industry Mall (Online o https://mall.industry.siem | Confirmation to exit the Russian mark of confirmation to exit the Russian mark of the renewal of the curr al Siemens office on the si her than the sanctioned E kaging siemens.com/cs/ww/en/vie bloadcenter (Catalogs, B m/ic10 | et (see here). /siemens-wind-down-ru ent EAC certificates. tatus of validity of the E EAEU member states Ru ew/109813875 Brochures,) | AC certification if you intend ussia or Belarus). | I to import or offer to sup | ply these products to an |
| urther information Siemens has decided th https://press.siemens.co Siemens is working on Please contact your loca EAC relevant market (oth Information on the pac https://support.industry.si Information- and Down https://www.siemens.cor Industry Mall (Online o https://mall.industry.siem Cax online generator http://support.automatior | Confirmation Confirmation to exit the Russian mark m/global/en/pressrelease the renewal of the curra al Siemens office on the si ther than the sanctioned E skaging siemens.com/cs/ww/en/vie hoadcenter (Catalogs, B m/ic10 ordering system) nens.com/mall/en/en/Cata n.siemens.com/WW/CAXe | tet (see here). /siemens-wind-down-ru ent EAC certificates. tatus of validity of the E EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RV/2 order/default.aspx?lang | AC certification if you intend ussia or Belarus). | | ply these products to an |
| urther information Siemens has decided the https://press.siemens.co Siemens is working on Please contact your loca EAC relevant market (other Information on the pac https://support.industry.siem Information- and Down https://www.siemens.cor Industry Mall (Online o https://mall.industry.siem Cax online generator http://support.automatior Service&Support (Man https://support.industry.se | Confirmation to exit the Russian mark om/global/en/pressrelease the renewal of the curra al Siemens office on the si ther than the sanctioned E staging siemens.com/cs/ww/en/vice hoadcenter (Catalogs, B m/ic10 ordering system) hens.com/mall/en/en/Cata n.siemens.com/WW/CAXC uals, Certificates, Chara siemens.com/cs/ww/en/ps | tet (see here). /siemens-wind-down-ru ent EAC certificates. tatus of validity of the E EAEU member states Ru ew/109813875 Brochures,) alog/product?mlfb=3RV/ order/default.aspx?lang acteristics, FAQs,) s/3RV2021-1AA25 | AC certification if you intend ussia or Belarus). 2021-1AA25 =en&mlfb=3RV2021-1AA25 | i i | ply these products to an |
| urther information Siemens has decided t https://press.siemens.co Siemens is working on Please contact your loca EAC relevant market (oth Information on the pac https://support.industry.siem Industry Mall (Online o https://www.siemens.cor Industry Mall (Online o https://support.automation Service&Support (Man https://support.industry.si Image database (produ http://www.automation.si | Confirmation Confi | et (see here). //siemens-wind-down-ru ent EAC certificates. tatus of validity of the E :AEU member states Ri ew/109813875 Brochures,) alog/product?mlfb=3RV/2 order/default.aspx?lang acteristics, FAQs,) //3RV2021-1AA25 on drawings, 3D mode le.aspx?mlfb=3RV2021 | AC certification if you intend ussia or Belarus). 2021-1AA25 =en&mlfb=3RV2021-1AA25 Is, device circuit diagrams | i i | ply these products to an |
| urther information Siemens has decided th https://press.siemens.co Siemens is working on Please contact your loca EAC relevant market (oti Information on the pac https://support.industry.siem Cax online generator https://support.automatior Service&Support (Man https://support.industry.siem Cax online generator http://support.automation Service&Support (Man https://support.industry.si Image database (produ http://www.automation.si Characteristic: Tripping | Confirmation Confi | tet (see here). //siemens-wind-down-ru- ent EAC certificates. tatus of validity of the E AEU member states Ri ew/109813875 Brochures,) alog/product?mlfb=3RV/ order/default.aspx?lang acteristics, FAQs,) /3RV2021-1AA25 on drawings, 3D mode le.aspx?mlfb=3RV2021 t-through current | AC certification if you intend ussia or Belarus). 2021-1AA25 =en&mlfb=3RV2021-1AA25 Is, device circuit diagrams -1AA25⟨=en | i i | ply these products to an |

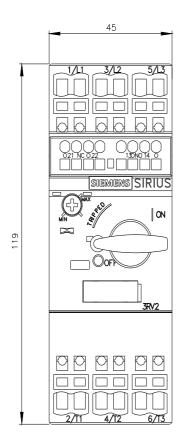

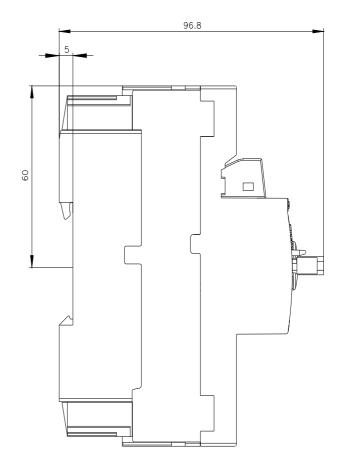

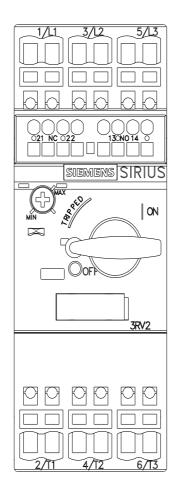

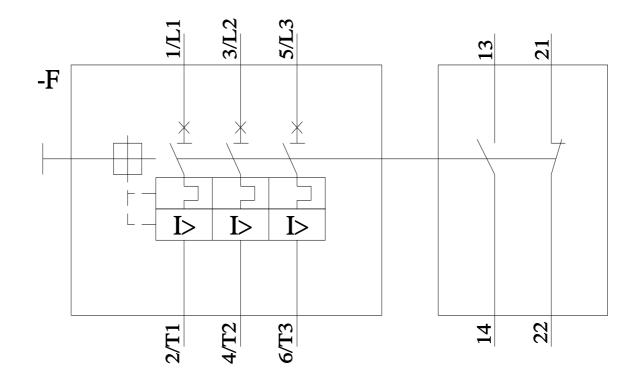

last modified:

11/21/2022 🖸

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Siemens: 3RV20211AA25