SIEMENS

Data sheet

3UG4582-1AW30



Insulation monitoring relay for ungrounded (IT) supply systems up to 250 V AC, 15-400 Hz and up to 300 V DC Measuring range 1-100 kohm Supply voltage 24-240 V AC/DC 22.5 mm, 1 change-over contact screw terminal

| product brand name | SIRIUS |
|--|--|
| product designation | Insulation monitoring relay with analog setting |
| product type designation | 3UG4 |
| General technical data | |
| product function | Insulation monitor |
| • | |
| type of voltage | |
| • for monitoring | AC/DC |
| of the operating voltage for actuation | AC/DC |
| of the control supply voltage | AC/DC |
| surge voltage resistance rated value | 6 000 V |
| protection class IP | IP20 |
| thermal current of the switching element with contacts maximum | 4 A |
| reference code according to IEC 81346-2 | К |
| Substance Prohibitance (Date) | 05/01/2012 |
| SVHC substance name | Blei - 7439-92-1 Bleimonoxid (Bleioxid) - 1317-36-8 |
| Product Function | |
| product function | |
| error memory | Yes |
| Control circuit/ Control | |
| control supply voltage at AC | |
| • at 50 Hz rated value | 24 240 V |
| • at 60 Hz rated value | 24 240 V |
| control supply voltage at DC rated value | 24 240 V |
| operating range factor control supply voltage rated value at DC | |
| • initial value | 0.85 |
| • full-scale value | 1.1 |
| operating range factor control supply voltage rated value at AC at 50 Hz | |
| ● initial value | 0.85 |
| • full-scale value | 1.1 |
| operating range factor control supply voltage rated value at AC at 60 Hz | |
| • initial value | 0.85 |
| • full-scale value | 1.1 |
| Measuring circuit | |
| measurable line frequency | 50 60 Hz |
| measurable voltage at AC | 0 250 V |
| Auxiliary circuit | |
| | |

| number of NC contacts for auxiliary contacts | 0 |
|--|--|
| number of NC contacts delayed switching | 0 |
| number of NO contacts for auxiliary contacts | 0 |
| number of NO contacts delayed switching | 0 |
| number of CO contacts | |
| delayed switching | 1 |
| Main circuit | |
| operating frequency rated value | 15 400 Hz |
| Connections/ Terminals | |
| product component removable terminal for auxiliary and | No |
| control circuit | |
| type of electrical connection | screw-type terminals |
| type of connectable conductor cross-sections | |
| • solid | 2x (0.75 2.5 mm²) |
| finely stranded with core end processing | 2x (0.75 2.5 mm²) |
| connectable conductor cross-section | |
| • solid | 0.75 2.5 mm ² |
| finely stranded with core end processing | 0.75 2.5 mm ² |
| AWG number as coded connectable conductor cross section | |
| • solid | 20 12 |
| stranded | 18 14 |
| tightening torque with screw-type terminals | 0.6 0.8 N·m |
| | 0.0 0.8 N'III |
| Installation/ mounting/ dimensions | |
| mounting position | any |
| fastening method | snap-on fastening on 35 mm DIN rail |
| height | 78 mm |
| width | 22.5 mm |
| depth | 100 mm |
| required spacing | |
| with side-by-side mounting | |
| — forwards | 0 mm |
| — backwards | 0 mm |
| — upwards | 0 mm |
| — downwards | 0 mm |
| | |
| — at the side | 0 mm |
| | 0 mm |
| • for grounded parts | |
| for grounded parts forwards | 0 mm |
| for grounded parts forwards backwards | 0 mm 0 mm |
| for grounded parts forwards backwards upwards | 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side | 0 mm 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards | 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts | 0 mm 0 mm 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards | 0 mm 0 mm 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards | 0 mm 0 mm 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards | 0 mm 0 mm 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards | 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards upwards upwards | 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards backwards upwards downwards | 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards backwards upwards downwards at the side | 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm |
| for grounded parts for wards backwards upwards at the side downwards for live parts for wards backwards backwards upwards downwards at the side Ambient conditions | 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards forwards backwards backwards upwards at the side at the side Move the side Advectory of the side | 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts for wards backwards backwards backwards upwards downwards at the side Move the side Ambient conditions ambient temperature during operation Certificates/ approvals | 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts forwards backwards backwards backwards backwards at the side downwards at the side Monitorial conditions ambient temperature during operation Certificates/ approvals | 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts for wards backwards backwards backwards upwards downwards at the side Move the side Ambient conditions ambient temperature during operation Certificates/ approvals | 0 mm 0 mm |
| for grounded parts forwards backwards upwards at the side downwards for live parts for wards backwards backwards backwards upwards downwards at the side Move the side Ambient conditions ambient temperature during operation Certificates/ approvals | 0 mm 0 mm |
| for grounded parts for wards backwards upwards at the side downwards for live parts for live parts forwards backwards backwards upwards downwards at the side Ambient conditions ambient temperature during operation Certificates/ approvals General Product Approval | 0 mm 0 mm |
| for grounded parts for wards backwards upwards at the side downwards for live parts for live parts forwards backwards backwards upwards downwards at the side Ambient conditions ambient temperature during operation Certificates/ approvals General Product Approval | 0 mm 0 mm |
| for grounded parts for wards backwards upwards at the side downwards for live parts for wards backwards backwards upwards downwards at the side Mbient conditions ambient temperature during operation Certificates/ approvals General Product Approval Confirmation | $\begin{array}{c} 0 \ mm \\ \end{array}$ |
| for grounded parts for wards backwards upwards at the side downwards for live parts for wards backwards backwards backwards upwards at the side Ambient conditions ambient temperature during operation Certificates/ approvals General Product Approval | 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm 0 mm |

Subject to change without notice © Copyright Siemens



Special Test Certificate







Confirmation

Railway

Vibration and Shock

Further information

Siemens has decided to exit the Russian market (see here).

https://press.siemens.com/global/en/pressrelease/siemens-wind-down-russian-business

Siemens is working on the renewal of the current EAC certificates.

Please contact your local Siemens office on the status of validity of the EAC certification if you intend to import or offer to supply these products to an EAC relevant market (other than the sanctioned EAEU member states Russia or Belarus).

Information on the packaging

https://support.industry.siemens.com/cs/ww/en/view/109813875

Information- and Downloadcenter (Catalogs, Brochures,...)

https://www.siemens.com/ic10

Industry Mall (Online ordering system)

https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3UG4582-1AW30

Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3UG4582-1AW30

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)


https://support.industry.siemens.com/cs/ww/en/ps/3UG4582-1AW30


Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...)


http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3UG4582-1AW30&lang=en

Characteristic: Derating

https://support.industry.siemens.com/cs/ww/en/ps/3UG4582-1AW30/manual

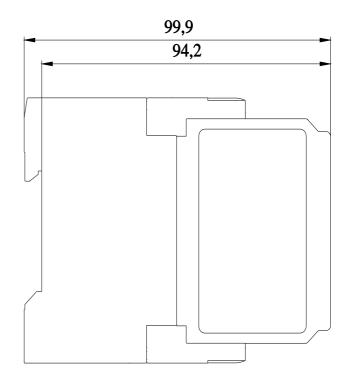

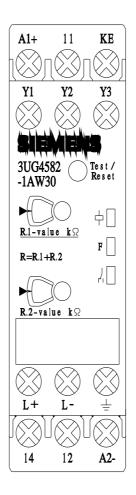

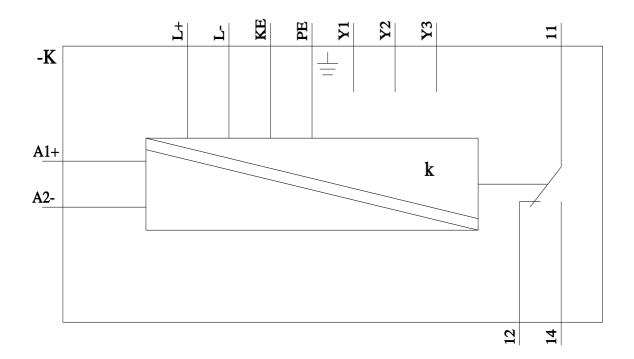

last modified:

8/7/2023 🖸

8/15/2023

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Siemens: 3UG45821AW30