




Gateway for integration of Panasonic air conditioners into KNX TP-1 (EIB) control systems

Compatible with Etherea line air conditioners commercialized by Panasonic

Application's Program Version: 1.5

USER MANUAL

Issue date: 01/2025 r5.3 ENGLISH

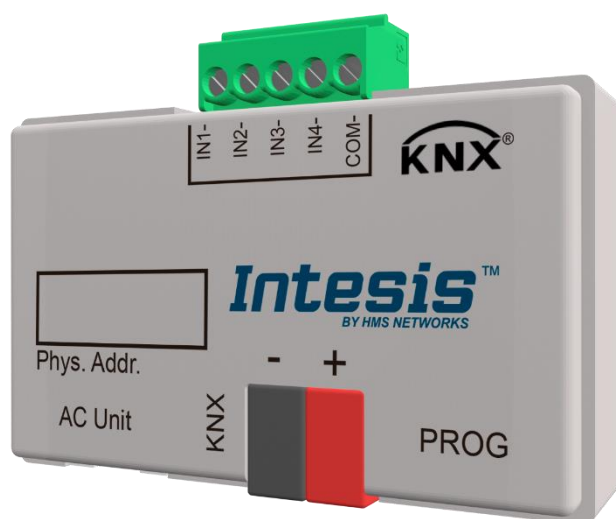



Important User Information

Disclaimer

The information in this document is for informational purposes only. Please inform HMS Industrial Networks of any inaccuracies or omissions found in this document. HMS Industrial Networks disclaims any responsibility or liability for any errors that may appear in this document.

HMS Industrial Networks reserves the right to modify its products in line with its policy of continuous product development. The information in this document shall therefore not be construed as a commitment on the part of HMS Industrial Networks and is subject to change without notice. HMS Industrial Networks makes no commitment to update or keep current the information in this document.

The data, examples and illustrations found in this document are included for illustrative purposes and are only intended to help improve understanding of the functionality and handling of the product. In view of the wide range of possible applications of the product, and because of the many variables and requirements associated with any particular implementation, HMS Industrial Networks cannot assume responsibility or liability for actual use based on the data, examples or illustrations included in this document nor for any damages incurred during installation of the product. Those responsible for the use of the product must acquire sufficient knowledge in order to ensure that the product is used correctly in their specific application and that the application meets all performance and safety requirements including any applicable laws, regulations, codes and standards. Further, HMS Industrial Networks will under no circumstances assume liability or responsibility for any problems that may arise as a result from the use of undocumented features or functional side effects found outside the documented scope of the product. The effects caused by any direct or indirect use of such aspects of the product are undefined and may include e.g. compatibility issues and stability issues.

Gateway for integration of Panasonic air conditioners into KNX TP-1 (EIB) control systems. Compatible with Etherea line air conditioners commercialized by Panasonic.

Application's Program Version: 1.5


| ORDER CODE | LEGACY ORDER CODE |
|-----------------|-------------------|
| INKNXPAN001I000 | PA-AC-KNX-1i |

INDEX

| | | |
|-------|---|----|
| 1. | Presentation | 6 |
| 2. | Connection | 7 |
| 3. | Configuration and setup | 8 |
| 4. | ETS Parameters | 9 |
| 4.1 | General dialog | 9 |
| 4.1.1 | Etherea AC model | 10 |
| 4.1.2 | Send READs for Control_ objects on bus recovery | 10 |
| 4.1.3 | Scene to load on bus recovery / startup | 11 |
| 4.1.4 | Disallow control from remote controller | 11 |
| 4.1.5 | Enable func "Control_ Lock Control Obj" | 11 |
| 4.1.6 | Enable func "Operating Hours Counter" | 12 |
| 4.1.7 | Enable object "Error Code [2byte]" | 12 |
| 4.1.8 | Enable object "Error Text Code [14byte]" | 13 |
| 4.2 | Mode Configuration dialog | 13 |
| 4.2.1 | Indoor unit has HEAT mode | 13 |
| 4.2.2 | Indoor unit has FAN mode | 14 |
| 4.2.3 | When mode is AUTO Status_ objs report actual operating status | 14 |
| 4.2.4 | Enable "Mode Cool/Heat objects | 14 |
| 4.2.5 | Enable PID-Compat. Scaling Mode Objects | 14 |
| 4.2.6 | Enable use of + / - object for Mode | 15 |
| 4.2.7 | Enable use of bit-type Mode objects (for control) | 16 |
| 4.2.8 | Enable use of bit-type Mode objects (for status) | 16 |
| 4.2.9 | Enable use of Text object for Mode | 16 |
| 4.3 | Special Modes Configuration dialog | 17 |
| 4.3.1 | Enable use of "POWERFUL" mode (AC feature) | 18 |
| 4.3.2 | Enable use of "QUIET" mode (AC feature) | 18 |
| 4.3.3 | Enable use of POWER mode | 18 |
| 4.3.4 | Enable use of ECONOMY mode | 19 |
| 4.3.5 | Enable use of ADDITIONAL HEATING mode | 20 |
| 4.3.6 | Enable use of ADDITIONAL COOLING mode | 21 |
| 4.4 | Fan Speed Configuration dialog | 21 |
| 4.4.1 | DPT object type for Fan Speed | 22 |
| 4.4.2 | Enable use of +/- object for Fan Speed | 23 |
| 4.4.3 | Enable "Fan Speed Manual/Auto" objects for Control and Status | 23 |
| 4.4.4 | Enable use of bit-type Fan Speed objects (for Control) | 24 |
| 4.4.5 | Enable use of bit-type Fan Speed objects (for Status) | 24 |
| 4.4.6 | Enable use of Text object for Fan Speed | 25 |
| 4.5 | Vane U-D Configuration dialog | 25 |
| 4.5.1 | Indoor unit has U-D Vanes | 26 |
| 4.5.2 | DPT object type for Vane U-D | 26 |
| 4.5.3 | Enable use of +/- obj for Vane U-D | 27 |
| 4.5.4 | Enable "Vanes U-D Manual/Auto" objects for Control and Status | 28 |
| 4.5.5 | Enable use of bit-type Vane U-D objects (for Control) | 29 |
| 4.5.6 | Enable use of bit-type Vane U-D objects (for Status) | 29 |
| 4.5.7 | Enable use of Text object for Vane U-D | 29 |
| 4.6 | Vane L-R Configuration dialog | 30 |
| 4.6.1 | Indoor unit has L-R Vanes | 30 |
| 4.6.2 | DPT object type for Vane L-R | 30 |
| 4.6.3 | Enable use of +/- obj for Vane L-R | 32 |
| 4.6.4 | Enable "Vanes L-R Manual/Auto" objects for Control and Status | 32 |
| 4.6.5 | Enable use of bit-type Vane L-R objects (for Control) | 33 |
| 4.6.6 | Enable use of bit-type Vane L-R objects (for Status) | 33 |
| 4.6.7 | Enable use of Text object for Vane L-R | 34 |
| 4.7 | Temperature Configuration dialog | 34 |
| 4.7.1 | Periodic sending of "Status_ AC Setp" | 34 |
| 4.7.2 | Enable use of +/- object for Setpoint Temperature | 35 |

| | | |
|---|---|----|
| 4.7.3 | Enable limits on Control_ Setpoint obj | 35 |
| 4.7.4 | Ambient temp. ref. is provided from KNX | 36 |
| 4.8 | Scene Configuration dialog | 37 |
| 4.8.1 | Enable use of scenes | 37 |
| 4.8.2 | Scenes can be stored from KNX bus | 37 |
| 4.8.3 | Enable use of bit objects for scene execution | 38 |
| 4.8.4 | Scene "x" preset | 39 |
| 4.9 | Switch-Off Timeouts Configuration dialog | 40 |
| 4.9.1 | Enable use of Open Window / Switch off timeout function | 40 |
| 4.9.2 | Enable use of Occupancy function | 42 |
| 4.9.3 | Enable use of SLEEP timeout | 44 |
| 4.10 | Binary Input "x" Configuration dialog | 44 |
| 4.10.1 | Enable use of Input "x" | 45 |
| 4.10.2 | Contact type..... | 45 |
| 4.10.3 | Debounce time | 45 |
| 4.10.4 | Disabling function..... | 46 |
| 4.10.5 | Function..... | 46 |
| 4.11 | Power Consumption configuration..... | 53 |
| 4.11.1 | Enable use of Power Consumption | 53 |
| 5. | Specifications..... | 55 |
| 6. | AC Unit Types compatibility. | 56 |
| 7. | Error Codes | 57 |
| Appendix A – Communication Objects Table..... | | 59 |

1. Presentation



INKNXPAN001I000 allows a complete and natural integration of PANASONIC air conditioners with KNX control systems.

Compatible with all Etherea models commercialized by PANASONIC.

Main features:

- Reduced dimensions, quick installation.
- Multiple objects for control and status (bit, byte, characters...) with KNX standard datapoint types.
- Status objects for every control available.
- Timeout for Open Window and Occupancy. Sleep function also available.
- Control of the AC unit based in the ambient temperature read by the own AC unit, or in the ambient temperature read by any KNX thermostat.
- AC unit can be controlled simultaneously by the IR remote control of the AC unit and by KNX.
- Total Control and Monitoring of the AC unit from KNX, including monitoring of AC unit's state of internal variables, running hours counter (for filter maintenance control), and error indication and error code.
- Up to 5 scenes can be saved and executed from KNX, fixing the desired combination of Operation Mode, Set Temperature, Fan Speed, Vane Position and Remote Controller Lock in any moment by using a simple switching.
- Four potential-free binary inputs provide the possibility to integrate many types of external devices. Also configurable from ETS, they can be used for switching, dimming, shutter/blind control, and more

2. Connection

The interface comes with a cable for direct connection to the internal control board of the AC indoor unit.

- Connection of the interface to the AC indoor unit:

Disconnect mains power from the AC unit. Open the front cover of the indoor unit in order to have access to the internal control board. In the control board locate the socket connector marked as:

CN-CNT in Etherea line units.

Using the cable that comes with the interface, insert one of its connectors, the one installed in the shortest uncovered part, into the socket of the INKNXPAN001I000 marked as **AC Unit**, and the other connector, the one in the largest uncovered part, into the socket **CN-CNT** of the AC unit's control board. Fix the INKNXPAN001I000 inside or outside the AC indoor unit depending on your needs, remember that INKNXPAN001I000 must be also connected to the KNX bus. Close the AC indoor unit's front cover again.

- ⚠ **Important:** The cable supplied with the interface is 1.5 m (4.9 ft) long. Do not modify its length since it may affect the correct interface's operation. Keep the cable away from power and ground wires, and never bundle them together.

- Connection of the interface to the KNX bus:

Disconnect power of the KNX bus. Connect the interface to the KNX TP-1 (EIB) bus using the KNX standard connector (red/grey) of the interface, respect polarity. Reconnect power of the KNX bus.

- Connections diagram:

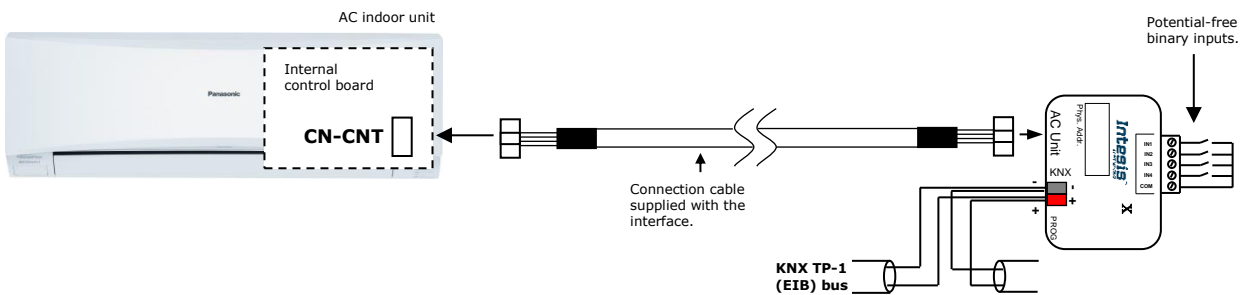


Figure 2.2 Connection diagram

3. Configuration and setup

This is a fully compatible KNX device which must be configured and setup using standard KNX tool ETS.

ETS database for this device can be downloaded from:

<https://intesis.com/products/ac-interfaces/panasonic-gateways/panasonic-knx-inputs-ac-pa-ac-knx-1i>

Please consult the README.txt file, located inside the downloaded zip file, to find instructions on how to install the database.

⚠ Important: Do not forget to select the correct settings of AC indoor unit being connected to the INKNXPAN001I000 (Fan speed and Vanes), this is in "Parameters" of the device in ETS.

4. ETS Parameters

When imported to the ETS software for the first time, the gateway shows the following default parameter configuration:

Device: 1.1.1 PA AC interface, 4 binary inputs

| | | |
|-----------------------------------|---|---|
| General | Download latest database entry for this product and its User Manual from: | <input type="text" value="http://www.intesis.com"/> |
| Mode Configuration | Etherea AC model | <input type="text" value="CS-xyyMKE or CS-xyyNKE"/> |
| Special Modes Configuration | Send READs for Control_ objects on bus recovery (T & U flags must be active) | <input type="text" value="No"/> |
| Fan Speed Configuration | Scene to load on bus recovery / startup (needs to define vals for that scene) | <input type="text" value="(none)"/> |
| Vanes Up-Down Configuration | Disallow control from remote controller | <input type="text" value="No"/> |
| Vanes Left-Right Configuration | > Enable comm obj "Ctrl_Remote Lock" | <input type="text" value="No"/> |
| Temperature Configuration | Enable func "Control_Lock Control Obj" | <input type="text" value="No"/> |
| Scene Configuration | Enable func "Operating Hours Counter" | <input type="text" value="No"/> |
| Switch-Off Timeouts Configuration | Enable object "Error Code [2byte]" | <input type="text" value="No"/> |
| Binary Input 1 Configuration | Enable object "Error Text Code [14byte]" (3 ASCII-char Error Code) | <input type="text" value="Yes"/> |
| Binary Input 2 Configuration | | |
| Binary Input 3 Configuration | | |
| Binary Input 4 Configuration | | |
| Power Consumption Configuration | | |

Figure 4.1 Default parameter configuration

With this configuration it's possible to send On/Off (*Control_ On/Off*), change the AC Mode (*Control_ Mode*), the Fan Speed (*Control_ Fan Speed*) and also the Setpoint Temperature (*Control_ Setpoint Temperature*). The Status_ objects, for the mentioned Control_ objects, are also available to use if needed. Also objects *Status_ AC Setpoint Temp* and *Status_ Error/Alarm* are shown.

| 1.1.1 PA AC interface, 4 binary inputs | |
|--|--|
| 0: | Control_ On/Off [DPT_1.001 - 1bit] - 0-Off;1-On |
| 3: | Control_ Mode [DPT_20.105 - 1byte] - 0-Aut;1-Hea;3-Coo;9-Fan;14-Dry |
| 13: | Control_ Fan Speed / 5 Speeds [DPT_5.001 - 1byte] - Thresholds:30%,50%,70% and 90% |
| 21: | Control_ Vanes U-D / 5 Pos [DPT_5.001 - 1byte] - Thresholds:30%,50%,70% and 90% |
| 29: | Control_ Vanes L-R / 5 Pos [DPT_5.001 - 1byte] - Thresholds:30%,50%,70% and 90% |
| 37: | Control_ Setpoint Temp [DPT_9.001 - 2byte] - °C |
| 66: | Status_ On/Off [DPT_1.001 - 1bit] - 0-Off;1-On |
| 69: | Status_ Mode [DPT_20.105 - 1byte] - 0-Aut;1-Hea;3-Coo;9-Fan;14-Dry |
| 77: | Status_ Fan Speed / 5 Speeds [DPT_5.001 - 1byte] - 20%, 40%, 60%, 80% and 100% |
| 85: | Status_ Vanes U-D / 5 Pos [DPT_5.001 - 1byte] - 20%, 40%, 60%, 80% and 100% |
| 93: | Status_ Vanes L-R / 5 Pos [DPT_5.001 - 1byte] - 20%, 40%, 60%, 80% and 100% |
| 101: | Status_ AC Setpoint Temp [DPT_9.001 - 2byte] - °C |
| 104: | Status_ Error/Alarm [DPT_1.005 - 1bit] - 0-No alarm;1-Alarm |
| 106: | Status_ Error Text Code [DPT_16.001 - 14byte] - 3 char PA Error;Empty-None |

Figure 4.2 Default communication objects

4.1 General dialog

Inside this parameter's dialog it is possible to activate or change the parameters shown in the **Figure 4.1**.

The first field shows the URL where to download the database and the user manual for the product.

4.1.1 Etherea AC model

Select the indoor unit model you have in order to show/hide communication object according to your AC available features.

- If **"CS-xyyMKE or CS-xyyNKE"** is selected, communication objects related to functionalities for the CSxyyPKE indoor units or newer will be hidden.
- If **"CS-xyyPKE or newer"** is selected, communication objects related to functionalities for the CSxyyPKE indoor units or newer will be shown.

Etherea AC model

CS-xyyPKE or newer

- 40: Control_ Today [DPT_11.001 - 3byte] - Today's date
- 41: Control_ Reset Energy Counter [DPT_1.015 - 1bit] - 1-Reset counter
- 102: Status_ AC Return Path Temp [DPT_9.001 - 2byte] - °C
- 103: Status_ Outdoor Temp [DPT_9.001 - 2byte] - °C
- 107: Status_ Power Consumption [DPT_14.056 - 4byte] - W
- 108: Status_ Today Energy [DPT_13.010 - 4byte] - Wh
- 109: Status_ Yesterday Energy [DPT_13.010 - 4byte] - Wh
- 110: Status_ Total Energy [DPT_13.010 - 4byte] - Wh
- 111: Status_ Today [DPT_11.001 - 3byte] - Today's date

Figure 4.4 Parameter and communication object detail

4.1.2 Send READs for Control_ objects on bus recovery

When this parameter is enabled, INKNXPAN001I000 will send READ telegrams for the group addresses associated on its *Control_* objects on bus recovery or application reset/start-up.

- If set to **"no"** the gateway will not perform any action.
- If set to **"yes"** all *Control_* objects with both Transmit (**T**) and Update (**U**) flags enabled will send READs and their values will be updated with the response when received.

Send READs for Control_ objects on bus recovery (T and U flags must be active)

yes

> Delay before sending READs (sec)

30

Figure 4.4 Parameter detail

- Delay before sending READs (sec):

With this parameter, a delay can be configured between 0 and 30 seconds for the READs sent by the *Control_* objects. This is to give time enough to other KNX devices on the bus to start-up before sending the READs.

4.1.3 Scene to load on bus recovery / startup

This parameter executes a selected scene on bus recovery or startup, only if the selected scene has an enabled preset or values previously saved from KNX bus (see Scene Configuration dialog).

If the gateway is disconnected from the indoor unit the scene will not be applied, even when connecting to the indoor unit again.




Figure 4.5 Parameter detail

4.1.4 Disallow control from remote controller

This parameter allows:

- 1- Having the remote controller always locked, or
 - 2- Decide through a new communication object if the RC is locked or not.
- If set to **"yes"** all the actions performed through the remote controller will be disabled.
 - If set to **"no"** the remote controller will work as usually. It also appears a new parameter and the communication object *Control_ Lock Remote Control*.

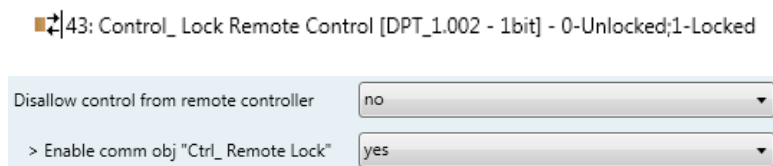


Figure 4.6 Communication object and parameter detail

➤ Enable comm obj "Ctrl_ Remote Lock":

If set to **"no"** the object will not be shown.

If set to **"yes"** the *Control_ Lock Remote Control* object will appear.

- When a **"1"** value is sent to this communication object, the remote controller is locked. To be unlocked a **"0"** value must be sent. The gateway remembers the last value received even if a KNX bus reset/failure happens.

⚠ Important: If an initial scene is enabled and it has as Value for Remote Lock (unchanged) or unlocked, this would unlock the remote controller because the initial scene has priority over the *Control_ Lock Remote Control* communication object.

4.1.5 Enable func "Control_ Lock Control Obj"

This parameter shows/hide the *Control_ Lock Control Obj* communication object which, depending on the sent value, locks or unlocks ALL the *Control_* communication objects except itself.

■ ↗ 44: Control_ Lock Control Objects [DPT_1.002 - 1bit] - 0-Unlocked;1-Locked

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Lock Control Objects* object will appear.
 - When a **"1"** value is sent to this communication object, all the *Control_* objects will be locked. To unlock a **"0"** value must be sent, as the gateway remembers the last value received even if a KNX bus reset/failure happens.

4.1.6 Enable func "Operating Hours Counter"

This parameter shows/hides the *Status_ Operation Hour Counter* communication object which counts the number of operating hours for the INKNXPAN001I000.

■ ↗ 107: Status_ Operation Hour Counter [DPT_7.001 - 2byte] - Number of operating hours

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Operation Hour Counter* object will appear.
 - This object can be read and sends its status every time an hour is counted. The gateway keeps that count in memory and the status is sent also after a KNX bus reset/failure. Although this object is marked as a *Status_* object it also can be written to update the counter when needed. To reset the counter should be written a **"0"** value.
 - ⚠ **Important:** This object comes by default without the write (**W**) flag activated. If is necessary to write on it, this flag must be activated.
 - ⚠ **Important:** This object will also return its status, every time a value is written, only if it's different from the existing one.
 - ⚠ **Important:** If the stored value is 0 hours, the gateway will not send the status to KNX.

4.1.7 Enable object "Error Code [2byte]"

This parameter shows/hides the *Status_ Error Code* communication object which shows the indoor unit errors, if occurred, in numeric format.

■ ↗ 101: Status_ Error Code [2byte] - 0-No error /Any other see man.

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Error Code [2byte]* object will appear.
 - This object can be read and also sends the indoor unit error, if occurred, in numeric format. If a **"0"** value is shown that means no error.

4.1.8 Enable object "Error Text Code [14byte]"

This parameter shows/hides the *Status_ Error Text Code* communication object which shows the indoor unit errors, if occurred, in text format.

■ ↗ 102: Status_ Error Text Code [DPT_16.001 - 14byte] - 3 char PA Error;Empty-None

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Error Text Code* object will appear.
 - This object can be read and also sends the indoor unit error, if occurred, in text format. The errors shown have the same format as at the remote controller and at the error list from the indoor unit manufacturer. If the object's value is empty that means no error.

4.2 Mode Configuration dialog

Figure 4.7 Default Mode Configuration dialog

All the parameters in this section are related with the different mode properties and communication objects.

■ ↗ 3: Control_ Mode [DPT_20.105 - 1byte] - 0-Aut;1-Hea;3-Coo;9-Fan;14-Dry

The byte-type communication object for Mode works with the DTP_20.105. Auto mode will be enabled with a **"0"** value, Heat mode with a **"1"** value, Cool mode with a **"3"** value, Fan mode with a **"9"** value and Dry mode with a **"14"** value.

4.2.1 Indoor unit has HEAT mode

This parameter has to be used to indicate if the indoor unit has the *heating mode operation* available.

- If set to **"no"**, the indoor unit doesn't have the *heating mode operation* available.
- If set to **"yes"**, the indoor unit has the *heating mode operation* available.

⚠ **Important:** Read the documentation of your indoor unit to check if it has HEAT mode available.

4.2.2 Indoor unit has FAN mode

This parameter has to be used to indicate if the indoor unit has the *fan mode* available.

- If set to **"no"**, the indoor unit doesn't have the *fan mode* available.
- If set to **"yes"**, the indoor unit has the *fan mode* available.

⚠ **Important:** Read the documentation of your indoor unit to check if it has FAN mode available.

4.2.3 When mode is AUTO Status_ objs report actual operating status

This parameter shows the real status of the indoor unit when Auto mode is enabled.

- If set to **"no"**, when the indoor unit is set to Auto mode, all the *Status_* objects concerning mode will only show Auto enabled.
- If set to **"yes"**, when the indoor unit is set to Auto mode, all the *Status_* objects concerning mode will show the real mode which the machine is working (Cool, Heat, Dry, Fan). In case of the bitfield objects, also the *Status_ Mode Auto* will be shown enabled with a **"1"** value.

4.2.4 Enable "Mode Cool/Heat objects

This parameter shows/hides the *Control_* and *Status_ Mode Cool/Heat* communication objects.

➡ 4: Control_ Mode Cool/Heat [DPT_1.100 - 1bit] - 0-Cool;1-Heat
➡ 70: Status_ Mode Cool/Heat [DPT_1.100 - 1bit] - 0-Cool;1-Heat

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_* and *Status_ Mode Cool/Heat* objects will appear.
 - When a **"1"** value is sent to the *Control_* communication object, **Heat mode** will be enabled in the indoor unit, and the *Status_* object will return this value.
 - When a **"0"** value is sent to the *Control_* communication object, **Cool mode** will be enabled in the indoor unit, and the *Status_* object will return this value.

4.2.5 Enable PID-Compat. Scaling Mode Objects

This parameter shows/hides the *Control_ Mode Cool & On* and *Control_ Mode Heat & On* communication objects.

- 5: Control_ Mode Cool & On [DPT_5.001 - 1byte] - 0%-Off;0.1%-100%-On+Cool
- 6: Control_ Mode Heat & On [DPT_5.001 - 1byte] - 0%-Off;0.1%-100%-On+Heat

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Mode Cool & On* and *Control_ Mode Heat & On* objects will appear.
 - These objects provide compatibility with those KNX thermostats that control the demand of heating or cooling by using scaling (percentage) objects. In these thermostats, the percentage demand is meant to be applied on a fluid valve of the heating / cooling system.
 - INKNXPAN001I000 device does not provide individual control on the internal parts of the indoor unit (as can be its compressor, refrigerant valves, etc). Rather, it provides the same level of control as a (user) remote controller.
 - Objects "Control_ Mode Cool & On" and "Control_ Mode Heat & On" intend to bring compatibility between thermostats oriented to the control of custom heating / cooling systems and ready-made AC indoor units, by applying the following logic:
 - Whenever a non-zero value (>0%) is received at "Control_ Mode Cool & On", indoor unit will switch On in COOL mode.
 - Whenever a non-zero value (>0%) is received at "Control_ Mode Heat & On", indoor unit will switch On in HEAT mode.
 - Lastest updated object will define the operating mode
 - Indoor unit will switch off only when both objects become zero (0%) – or when an OFF is requested at object "0. On/Off [DPT_1.001 - 1bit]"

⚠ Important: *These objects function is only to send On/Off and Cool/Heat to the indoor unit. The PID (Inverter system) is calculated by the indoor unit itself. Please consider introducing an appropriate PID configuration to the external KNX thermostat to not interfere the indoor unit PID.*

4.2.6 Enable use of + / - object for Mode

This parameter shows/hides the *Control_ Mode +/-* communication object which lets change the indoor unit mode by using two different datapoint types.

- 12: Control_ Mode +/- [DPT_1.007 - 1bit] - 0-Decrease;1-Increase

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Mode +/-* object and a new parameter will appear.

| | |
|-----------------------------------|--|
| Enable use of +/- object for Mode | <input type="text" value="yes"/> |
| > DPT type for +/- Mode Object | <input type="text" value="0-Up / 1-Down [DPT_1.008]"/> |

Figure 4.8 Parameter detail

➤ DPT type for +/- Mode Object

This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_Mode* +/- object.

The sequence followed when using this object is shown below:



- Up / Increase
- Down / Decrease

4.2.7 Enable use of bit-type Mode objects (for control)

This parameter shows/hides the bit-type *Control_Mode* objects.

- 7: Control_Mode Auto [DPT_1.002 - 1bit] - 1-Set AUTO mode
- 8: Control_Mode Heat [DPT_1.002 - 1bit] - 1-Set HEAT mode
- 9: Control_Mode Cool [DPT_1.002 - 1bit] - 1-Set COOL mode
- 10: Control_Mode Fan [DPT_1.002 - 1bit] - 1-Set FAN mode
- 11: Control_Mode Dry [DPT_1.002 - 1bit] - 1-Set DRY mode

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_Mode* objects for Auto, Heat, Cool, Fan and Dry will appear. To activate a mode by using these objects a **"1"** value has to be sent.

4.2.8 Enable use of bit-type Mode objects (for status)

This parameter shows/hides the bit-type *Status_Mode* objects.

- 71: Status_Mode Auto [DPT_1.002 - 1bit] - 1-AUTO mode is active
- 72: Status_Mode Heat [DPT_1.002 - 1bit] - 1-HEAT mode is active
- 73: Status_Mode Cool [DPT_1.002 - 1bit] - 1-COOL mode is active
- 74: Status_Mode Fan [DPT_1.002 - 1bit] - 1-FAN mode is active
- 75: Status_Mode Dry [DPT_1.002 - 1bit] - 1-DRY mode is active

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Status_Mode* objects for Auto, Heat, Cool, Fan and Dry will appear. When enabled, a mode will return a **"1"** through its bit-type object.

4.2.9 Enable use of Text object for Mode

This parameter shows/hides the *Status_Mode Text* communication object.

76: Status_ Mode Text [DPT_16.001 - 14byte] - ASCII String

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Mode Text* object will appear. Also, in the parameters, will be shown five text fields, one for each mode, that will let modify the text string displayed by the *Status_ Mode Text* when changing mode.

| | |
|----------------------------|------|
| > String when mode is AUTO | AUTO |
| > String when mode is HEAT | HEAT |
| > String when mode is COOL | COOL |
| > String when mode is FAN | FAN |
| > String when mode is DRY | DRY |

Figure 4.9 Parameter detail

4.3 Special Modes Configuration dialog

Device: 1.1.1 PA AC Interface

| | | |
|-----------------------------------|--|-----|
| General | Enable use of "POWERFUL" mode (AC feature) | Yes |
| Mode Configuration | Enable use of "QUIET" mode (AC feature) | Yes |
| Special Modes Configuration | Enable use of POWER mode | No |
| Fan Speed Configuration | Enable use of ECONOMY mode | No |
| Vanes Up-Down Configuration | Enable use of ADDITIONAL HEATING mode | No |
| Vanes Left-Right Configuration | Enable use of ADDITIONAL COOLING mode | No |
| Temperature Configuration | | |
| Scene Configuration | | |
| Switch-Off Timeouts Configuration | | |
| Binary Input 1 Configuration | | |
| Binary Input 2 Configuration | | |
| Binary Input 3 Configuration | | |
| Binary Input 4 Configuration | | |

Figure 4.10 Default Special Modes Configuration dialog

The Special Modes can be parameterized through the ETS parameters dialog, and they can be used to give extra functionality.

- ⚠ **Important:** When executing any of the Special Modes (excluding POWERFUL and QUIET modes), the real state of the indoor unit will NOT be shown in KNX.
- ⚠ **Important:** When the predefined time for the Special Mode is finished or a "0" value is sent to stop it, the previous state will be recovered (excluding in POWERFUL and QUIET modes).
- ⚠ **Important:** If a value concerning On/Off, Mode, Fan Speed or Setpoint Temperature is received from KNX while any Special Mode (excluding POWERFUL and QUIET modes) is running ("1"), the Special Mode will stop and the previous state will be recovered. The value received will be also applied then.
- ⚠ **Important:** If a value concerning On/Off, Mode, Fan Speed or Setpoint Temperature is modified through the remote controller, the Special Mode (excluding POWERFUL and QUIET modes) will stop WITHOUT recovering the previous state. Then the real indoor unit state will be shown in KNX including the new value received through the remote controller.

4.3.1 Enable use of "POWERFUL" mode (AC feature)

This parameter shows/hides the *Control_ Powerful* and *Status_ Powerful* communication objects.

- 1: Control_ Powerful [DPT_1.002 - 1bit] - 1-Set POWERFUL
- 67: Status_ Powerful [DPT_1.002 - 1bit] - 1-POWERFUL is active

⚠ Important: *The Powerful Mode is an internal AC feature. Please check the indoor unit user's manual to have more information about it.*

- If set to "no" the object will not be shown.
- If set to "yes" the *Control_ Powerful* and *Status_ Powerful* objects will appear.
 - When a "1" value is sent to the *Control_* communication object, Powerful Mode will be enabled, and the *Status_* object will return this value.
 - When a "0" value is sent to the *Control_* communication object, Powerful Mode will be disabled, and the *Status_* object will return this value.

4.3.2 Enable use of "QUIET" mode (AC feature)

This parameter shows/hides the *Control_ Quiet* and *Status_ Quiet* communication objects.

- 2: Control_ Quiet [DPT_1.002 - 1bit] - 1-Set QUIET
- 68: Status_ Quiet [DPT_1.002 - 1bit] - 1-QUIET is active

⚠ Important: *The Quiet Mode is an internal AC feature. Please check the indoor unit user's manual to have more information about it.*

- If set to "no" the object will not be shown.
- If set to "yes" the *Control_ Quiet* and *Status_ Quiet* objects will appear.
 - When a "1" value is sent to the *Control_* communication object, Quiet Mode will be enabled, and the *Status_* object will return this value.
 - When a "0" value is sent to the *Control_* communication object, Quiet Mode will be disabled, and the *Status_* object will return this value.

4.3.3 Enable use of POWER mode

This parameter shows/hides the *Control_ Power Mode* and *Status_ Power Mode* communication objects. The Power Mode lets change the Setpoint Temperature and the Fan Speed within a given period of time.

- 47: Control_ Power Mode [DPT_1.010 - 1bit] - 0-Stop;1-Start
- 114: Status_ Power Mode [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to "no" the objects will not be shown.

- If set to **"yes"** the *Control_ Power Mode* and *Status_ Power Mode* objects and new parameters will appear.

| | |
|--|---------------------|
| Enable use of POWER mode | yes |
| > Action time for this mode (minutes) (0 = permanent / unlimited) | 2 |
| > Setpoint delta increase (HEAT) or decrease (COOL) - in Celsius | 2.0°C |
| > Fanspeed for this mode | SPEED 3 (if avail.) |

Figure 4.11 Parameter detail

- When a **"1"** value is sent to the *Control_* communication object Power Mode will be enabled, and the *Status_* object will return this value.
- When a **"0"** value is sent to the *Control_* communication object, Power Mode will be disabled, and the *Status_* object will return this value.

⚠ Important: This mode will ONLY work if the indoor unit is both turned on and in a Heat, Cool, Auto-Heat or Auto-Cool Mode.

➤ Action time for this mode (minutes):

Duration of Power Mode, in minutes, once started.

➤ Setpoint delta increase (HEAT) or decrease (COOL) – in Celsius:



Number of degrees Celsius that will increase in Heat Mode, or decrease in Cool Mode, while in Power Mode.

➤ Fan Speed for this mode:

Fan Speed that will be set in the unit while in Power Mode.

4.3.4 Enable use of ECONOMY mode

This parameter shows/hides the *Control_ Econo Mode* and *Status_ Econo Mode* communication objects. The Econo Mode lets change the Setpoint Temperature and the Fan Speed within a given period of time.

 48: Control_ Econo Mode [DPT_1.010 - 1bit] - 0-Stop;1-Start
 115: Status_ Econo Mode [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Econo Mode* and *Status_ Econo Mode* objects and new parameters will appear.
 - When a **"1"** value is sent to the *Control_* communication object, EconoMode will be enabled, and the *Status_* object will return this value.

- When a "0" value is sent to the *Control_* communication object, EconoMode will be disabled, and the *Status_* object will return this value.

⚠ Important: *This mode will ONLY work if the indoor unit is both turned on and in a Heat, Cool, Auto-Heat or Auto-Cool Mode.*

➤ Action time for this mode (minutes):

Duration of EconoMode, in minutes, once started.

➤ Setpoint delta increase (HEAT) or decrease (COOL) – in Celsius:

Number of degrees Celsius that will increase in Heat Mode, or decrease in Cool Mode, while in EconoMode.

➤ Fan Speed for this mode:

Fan Speed that will be set in the unit while in EconoMode.

4.3.5 Enable use of ADDITIONAL HEATING mode

This parameter shows/hides the *Control_ Start Additional Heat Mode* and *Status_ Additional Heat Mode* communication objects. The Additional Heating Mode lets change the Setpoint Temperature and the Fan Speed within a given period of time.

■ ↕ 49: *Control_ Additional Heat* [DPT_1.010 - 1bit] - 0-Stop;1-Start
 ■ ↕ 116: *Status_ Additional Heat* [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to "no" the objects will not be shown.
- If set to "yes" the *Control_ Start Additional Heat Mode* and *Status_ Additional Heat Mode* objects and new parameters will appear.
 - When a "1" value is sent to the *Control_* communication object, Additional Heating Mode will be enabled, and the *Status_* object will return this value.
 - When a "0" value is sent to the *Control_* communication object, Additional Heating Mode will be disabled, and the *Status_* object will return this value.

⚠ Important: *This mode will ALWAYS turn on the indoor unit in Heat mode.*

➤ Action time for this mode (minutes):

Duration of Additional Heating Mode, in minutes, once started.

➤ Setpoint temp for this mode (°C):

Setpoint temperature that will be applied while in Additional Heating Mode.

➤ Fan Speed for this mode:

Fan Speed that will be set in the unit while in Additional Heating Mode.

4.3.6 Enable use of ADDITIONAL COOLING mode

This parameter shows/hides the *Control_ Start Additional Cool Mode* and *Status_ Additional Cool Mode* communication objects. The Additional Heating Mode lets change the Setpoint Temperature and the Fan Speed within a given period of time.

■ 50: Control_ Additional Cool [DPT_1.010 - 1bit] - 0-Stop;1-Start
 ■ 117: Status_ Additional Cool [DPT_1.001 - 1bit] - 0-Off;1-On

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the Control_ Start Additional Cool Mode and Status_ Additional Cool Mode objects and new parameters will appear.
 - When a **"1"** value is sent to the *Control_* communication object, Additional Cooling Mode will be enabled, and the *Status_* object will return this value.
 - When a **"0"** value is sent to the *Control_* communication object, Additional Cooling Mode will be disabled, and the *Status_* object will return this value.

⚠ Important: This mode will ALWAYS turn on the indoor unit in Cool mode.

➤ Action time for this mode (minutes):

Duration of Additional Cooling Mode, in minutes, once started.

➤ Setpoint temp for this mode (°C):

Setpoint temperature that will be applied while in Additional Cooling Mode.

➤ Fan Speed for this mode:

Fan Speed that will be set in the unit while in Additional Cooling Mode.

4.4 Fan Speed Configuration dialog

Device: 1.1.1 PA AC interface, 4 binary inputs

| | | |
|-----------------------------------|--|---------------------|
| General | DPT object type for fanspeed | Scaling [DPT_5.001] |
| Mode Configuration | Enable use of +/- object for Fan Speed | No |
| Special Modes Configuration | Enable "Fan Speed Man/Auto" objects for Control and Status | No |
| Fan Speed Configuration | Enable use of bit-type Fan Speed objects (for Control) | No |
| Vanes Up-Down Configuration | Enable use of bit-type Fan Speed objects (for Status) | No |
| Vanes Left-Right Configuration | Enable use of Text object for Fan Speed | No |
| Temperature Configuration | | |
| Scene Configuration | | |
| Switch-Off Timeouts Configuration | | |
| Binary Input 1 Configuration | | |
| Binary Input 2 Configuration | | |
| Binary Input 3 Configuration | | |
| Binary Input 4 Configuration | | |
| Power Consumption Configuration | | |

Figure 4.12 Default Fan Speed Configuration dialog

All the parameters in this section are related with the Fan Speed properties and communication objects.

4.4.1 DPT object type for Fan Speed

With this parameter is possible to change the DPT for the *Control_Fan Speed* and *Status_Fan Speed* byte-type communication objects. Datapoints Scaling (DPT_5.001) and Enumerated (DPT_5.010) can be selected.

- When **"Enumerated [DPT 5.010]"** is selected, *Control_Fan Speed* and *Status_Fan Speed* communication objects for this DPT will appear.

➡ 13: Control_Fan Speed / 5 Speeds [DPT_5.010 - 1byte] - Speed values: 1,2,3,4,5
 ➡ 77: Status_Fan Speed / 5 Speeds [DPT_5.010 - 1byte] - Speed Values: 1,2,3,4,5

The first fan speed will be selected if a **"1"** is sent to the *Control_* object. The second one will be selected sending a **"2"**; the third one will be selected sending a **"3"**; the fourth one will be selected sending a **"4"**; and the last one will be selected sending a **"5"**.

The *Status_* object will always return the value for the fan speed selected.

⚠ Important: If a **"0"** value is sent to the *Control_* object, the minimum fan speed will be selected. If a value bigger than **"5"** is sent to the *Control_* object, then the maximum fan speed will be selected.

- When **"Scaling [DPT 5.001]"** is selected, *Control_Fan Speed* and *Status_Fan Speed* communication objects for this DPT will appear.

➡ 13: Control_Fan Speed / 5 Speeds [DPT_5.001 - 1byte] - Thresholds: 30%, 50%, 70% and 90%
 ➡ 77: Status_Fan Speed / 5 Speeds [DPT_5.001 - 1byte] - 20%, 40%, 60%, 80% and 100%

When a value between **0%** and **29%** is sent to the *Control_* object the first fan speed will be selected.


When a value between **30%** and **49%** is sent to the *Control_* object, the second speed will be selected.

When a value between **50%** and **69%** is sent to the *Control_* object, the third speed will be selected.

When a value between **70%** and **89%** is sent to the *Control_* object, the fourth speed will be selected.

When a value between **90%** and **100%** is sent to the *Control_* object, the fifth speed will be selected.

The *Status_* object will return a **20%** when the first speed is selected, a **40%** for the second one, a **60%** for the third one, a **80%** for the fourth one, and a **100%** for the last one.

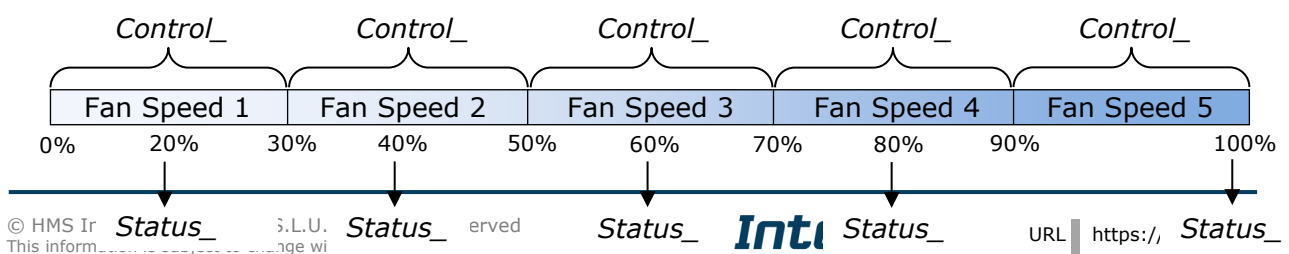

4.4.2 Enable use of +/- object for Fan Speed

This parameter shows/hides the *Control_ Fan Speed +/-* communication object which lets increase/decrease the indoor unit fan speed by using two different datapoint types.

■ 20: Control_ Fan Speed +/- [DPT_1.007 - 1bit] - 0-Decrease;1-Increase

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Fan Speed +/-* object and a new parameter will appear.

| | |
|--|-------------------------------------|
| Enable use of +/- object for Fan Speed | Yes |
| > DPT type for +/- Fan Speed object | 0-Decrease / 1-Increase [DPT_1.007] |
| > Does +/- sequence include fan speed AUTO? | No |
| > Roll over Speed at upper/lower limit (when controlling with +/- obj) | Yes |

Figure 4.13 Parameter detail

➤ DPT type for +/- Fan Speed Object


This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_ Fan Speed +/-* object.

➤ Does +/- sequence include fan speed AUTO?

This parameter lets choose if AUTO function is included (**"yes"**) or not (**"no"**) in the sequence when using *Control_ Fan Speed +/-* object as shown in the discontinuous segment at the picture below.

➤ Roll-over Speed at upper/lower limit

This parameter lets choose if roll-over will be enabled (**"yes"**) or disabled (**"no"**) for the *Control_ Fan Speed +/-* object.

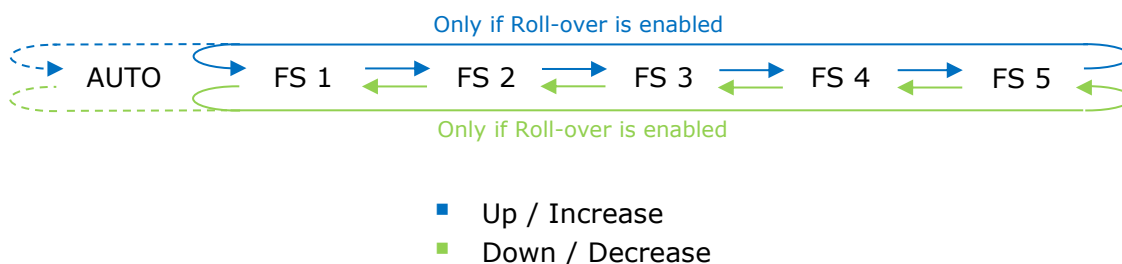

4.4.3 Enable "Fan Speed Manual/Auto" objects for Control and Status

This parameter shows/hides the *Control_ Fan Speed Manual/Auto* and *Status_ Fan Speed Manual/Auto* communication objects.

- ↕ 14: Control_ Fan Speed Manual/Auto [DPT_1.002 - 1bit] - 0-Manual;1-Auto
- ↕ 76: Status_ Fan Speed Manual/Auto [DPT_1.002 - 1bit] - 0-Manual;1-Auto

- If set to **"no"** the objects will not be shown.
 - If set to **"yes"** the *Control_ Fan Speed Manual/Auto* and *Status_ Fan Speed Manual/Auto* objects will appear.
 - When a **"1"** value is sent to the *Control_* communication object, Fan Speed will be in Auto mode, and the *Status_* object will return this value.
 - When a **"0"** value is sent to the *Control_* communication object, Fan Speed will be in Manual mode and the first fan speed will be enabled. The *Status_* object will return this value.
- ⚠ **Important:** When in Auto Mode the indoor unit will choose the most appropriate fan speed, but this will be shown neither in KNX nor in the remote controller.

4.4.4 Enable use of bit-type Fan Speed objects (for Control)

This parameter shows/hides the bit-type *Control_ Fan Speed* objects.

- ↕ 15: Control_ Fan Speed 1 [DPT_1.002 - 1bit] - 1-Set Fan Speed 1
- ↕ 16: Control_ Fan Speed 2 [DPT_1.002 - 1bit] - 1-Set Fan Speed 2
- ↕ 17: Control_ Fan Speed 3 [DPT_1.002 - 1bit] - 1-Set Fan Speed 3
- ↕ 18: Control_ Fan Speed 4 [DPT_1.002 - 1bit] - 1-Set Fan Speed 4
- ↕ 19: Control_ Fan Speed 5 [DPT_1.002 - 1bit] - 1-Set Fan Speed 5

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Fan Speed* objects for Speed 1, Speed 2, Speed 3, Speed 4 and Speed 5 will appear. To activate a Fan Speed by using these objects a **"1"** value has to be sent.

4.4.5 Enable use of bit-type Fan Speed objects (for Status)

This parameter shows/hides the bit-type *Status_ Fan Speed* objects.

- 77: Status_ Fan Speed 1 [DPT_1.002 - 1bit] - 1-Fan in speed 1
- 78: Status_ Fan Speed 2 [DPT_1.002 - 1bit] - 1-Fan in speed 2
- 79: Status_ Fan Speed 3 [DPT_1.002 - 1bit] - 1-Fan in speed 3
- 80: Status_ Fan Speed 4 [DPT_1.002 - 1bit] - 1-Fan in speed 4
- 81: Status_ Fan Speed 5 [DPT_1.002 - 1bit] - 1-Fan in speed 5

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Status_ Fan Speed* objects for Speed 1, Speed 2, Speed 3, Speed 4 and Speed 5 will appear. When a Fan Speed is enabled, a **"1"** value is returned through its bit-type object.

4.4.6 Enable use of Text object for Fan Speed

This parameter shows/hides the *Status_ Fan Speed Text* communication object.

- 82: Status_ Fan Speed Text [DPT_16.001 - 14byte] - ASCII String

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Fan Speed Text* object will appear. Also, in the parameters, will be shown five text fields, one for each Fan Speed, that will let modify the text string displayed by the *Status_ Fan Speed Text* when changing a fan speed.

| | |
|---------------------------------|---------|
| > String when fan speed is AUTO | AUTO |
| > String when fan speed is 1 | SPEED 1 |
| > String when fan speed is 2 | SPEED 2 |
| > String when fan speed is 3 | SPEED 3 |
| > String when fan speed is 4 | SPEED 4 |
| > String when fan speed is 5 | SPEED 5 |

Figure 4.14 Parameter detail

4.5 Vane U-D Configuration dialog

Device: 1.1.1 PA AC interface, 4 binary inputs

| | | |
|-----------------------------------|--|---------------------|
| General | Indoor unit has Up-Down Vanes (see docum. for your indoor unit) | Yes |
| Mode Configuration | DPT object type for Vanes Up-Down | Scaling [DPT_5.001] |
| Special Modes Configuration | Enable use of +/- object for Vanes U-D | No |
| Fan Speed Configuration | Enable "Vanes U-D Man/Auto" objects (for Control and Status) | No |
| Vanes Up-Down Configuration | Enable use of bit-type Vanes U-D objects (for Control) | No |
| Vanes Left-Right Configuration | Enable use of bit-type Vanes U-D objects (for Status) | No |
| Temperature Configuration | Enable use of Text object for Vanes U-D | No |
| Scene Configuration | | |
| Switch-Off Timeouts Configuration | | |
| Binary Input 1 Configuration | | |
| Binary Input 2 Configuration | | |
| Binary Input 3 Configuration | | |
| Binary Input 4 Configuration | | |
| Power Consumption Configuration | | |

Figure 4.15 Vane U-D Configuration dialog

All the parameters in this section are related with the Vane U-D properties and communication objects.

4.5.1 Indoor unit has U-D Vanes

This parameter lets choose if the unit has U-D Vanes available or not.

Indoor unit has Up-Down Vanes
(see docum. for your indoor unit)

yes

Figure 4.17 Parameter detail

- If set to **"no"** all the parameters and communication objects for the U-D Vanes will not be shown.
- If set to **"yes"** all the parameters and communication objects (if enabled in the parameters dialog) for the U-D Vanes will be shown.

⚠ Important: Read the documentation of your indoor unit to check if U-D Vanes are available.

4.5.2 DPT object type for Vane U-D

With this parameter is possible to change de DPT for the *Control_ Vane U-D* and *Status_ Vane U-D* byte-type communication objects. Datapoints Scaling (DPT_5.001) and Enumerated (DPT_5.010) can be selected.

- When **"Enumerated [DPT 5.010]"** is selected, *Control_ Vane U-D* and *Status_ Vane U-D* communication objects for this DPT will appear.

- 21: Control_ Vanes Up-Down / 5 pos [DPT_5.010 - 1byte] - Position values: 1,2,3,4,5
- 85: Status_ Vanes U-D / 5 Pos [DPT_5.010 - 1byte] - Position values 1,2,3,4,5

To choose a vane position, values from **"1"** to **"5"** can be sent to the *Control_* object. Each value will correspond to the position (i.e. Value **"3"** = Position 3).

The *Status_* object will always return the value for the vane position selected.

⚠ **Important:** If a "0" value is sent to the *Control_* object, the Position 1 will be selected. If a value bigger than "5" is sent to the *Control_* object, then the Position 5 will be selected.

- When "**Scaling [DPT 5.001]**" is selected, *Control_ Vane U-D* and *Status_ Vane U-D* communication objects for this DPT will appear.

➡ 21: *Control_ Vanes Up-Down* / 5 pos [DPT_5.001 - 1byte] - Thresholds:30%,50%,70% and 90%

➡ 85: *Status_ Vanes U-D* / 5 Pos [DPT_5.001 - 1byte] - 20%, 40%, 60%, 80% and 100%

When a value between **0%** and **29%** is sent to the *Control_* object the first vane position will be selected.


When a value between **30%** and **49%** is sent to the *Control_* object, the second vane position will be selected.

When a value between **50%** and **69%** is sent to the *Control_* object, the third vane position will be selected.

When a value between **70%** and **89%** is sent to the *Control_* object, the fourth vane position will be selected.

When a value between **90%** and **100%** is sent to the *Control_* object, the fifth vane position will be selected.

The *Status_* object will return a **20%** for the first vane position, a **40%** for the second one, a **60%** for the third one, an **80%** for the fourth one and a **100%** for the fifth and last one.

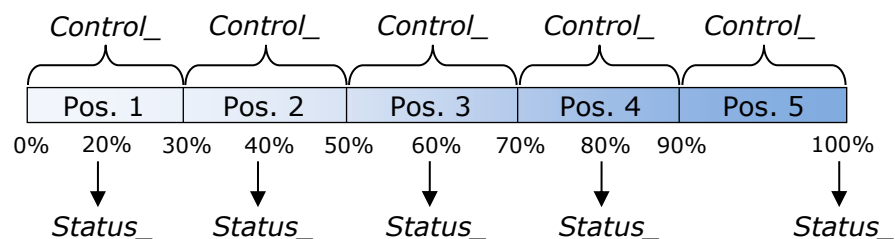

4.5.3 Enable use of +/- obj for Vane U-D

This parameter shows/hides the *Control_ Vane U-D +/-* communication object which lets change the indoor unit vane position by using two different datapoint types.

➡ 28: *Control_ Vanes Up-Down +/-* [DPT_1.007 - 1bit] - 0-Decrease;1-Increase

- If set to "**no**" the object will not be shown.
- If set to "**yes**" the *Control_ Vane U-D +/-* object and a new parameter will appear.

| | |
|--|-------------------------------------|
| Enable use of +/- object for Vanes Up-Down | Yes |
| > DPT type for +/- Vanes Up-Down obj | 0-Decrease / 1-Increase [DPT_1.007] |
| > Does +/- sequence include vanes Up-Down AUTO? | No |
| > Roll over Vanes at upper/lower limit (when controlling with +/- obj) | Yes |

Figure 4.16 Parameter detail

➤ DPT type for +/- Vane U-D obj


This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_ Vane U-D +/-* object.

➤ Does +/- sequence include vanes U-D AUTO?

This parameter lets choose if AUTO function is included ("yes") or not ("no") in the sequence when using *Control_ Vane U-D +/-* object as shown in the discontinuous segment at the picture below.

➤ Roll over Vanes at upper/lower limit

This parameter lets choose if roll-over will be enabled ("yes") or disabled ("no") for the *Vane U-D +/-* object.

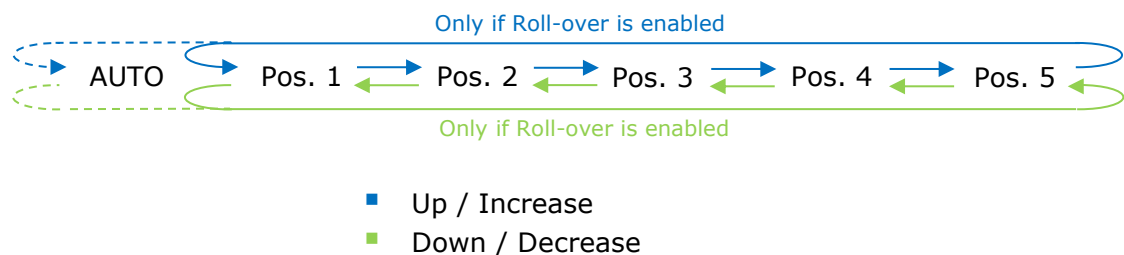

4.5.4 Enable "Vanes U-D Manual/Auto" objects for Control and Status

This parameter shows/hides the *Control_ Vanes U-D Man/Auto* and *Status_ Vanes U-D Man/Auto* communication objects.

■ 22: Control_ Vanes Up-Down Man/Auto [DPT_1.002 - 1bit] - 0-Manual/1-Auto
 ■ 86: Status_ Vanes U-D Man/Auto [DPT_1.002 - 1bit] - 0-Manual/1-Auto

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Vanes U-D Man/Auto* and *Status_ Vanes U-D Man/Auto* objects will appear.
 - When a **"1"** value is sent to the *Control_* communication object, Vanes U-D will be in Auto mode, and the *Status_* object will return this value.
 - When a **"0"** value is sent to the *Control_* communication object, Vanes U-D will be in Manual mode and the first position will be enabled. The *Status_* object will return this value.

⚠ Important: When in Auto Mode the indoor unit will choose the most appropriate vane U-D position, but this will be shown neither in KNX nor in the remote controller.

4.5.5 Enable use of bit-type Vane U-D objects (for Control)

This parameter shows/hides the bit-type *Control_ Vane U-D* objects.

- ↕ 23: Control_ Vanes Up-Down Pos 1 [DPT_1.002 - 1bit] - 1-Set Position 1
- ↕ 24: Control_ Vanes Up-Down Pos 2 [DPT_1.002 - 1bit] - 1-Set Position 2
- ↕ 25: Control_ Vanes Up-Down Pos 3 [DPT_1.002 - 1bit] - 1-Set Position 3
- ↕ 26: Control_ Vanes Up-Down Pos 4 [DPT_1.002 - 1bit] - 1-Set Position 4
- ↕ 27: Control_ Vanes Up-Down Pos 5 [DPT_1.002 - 1bit] - 1-Set Position 5

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Vane U-D* objects for each Position (1 to 5) will appear. To activate a Vane Position by using these objects, a **"1"** value has to be sent.

4.5.6 Enable use of bit-type Vane U-D objects (for Status)

This parameter shows/hides the bit-type *Status_ Vane U-D* objects.

- ↕ 87: Status_ Vanes U-D Pos 1 [DPT_1.002 - 1bit] - 1-Vanes in Position 1
- ↕ 88: Status_ Vanes U-D Pos 2 [DPT_1.002 - 1bit] - 1-Vanes in Position 2
- ↕ 89: Status_ Vanes U-D Pos 3 [DPT_1.002 - 1bit] - 1-Vanes in Position 3
- ↕ 90: Status_ Vanes U-D Pos 4 [DPT_1.002 - 1bit] - 1-Vanes in Position 4
- ↕ 91: Status_ Vanes U-D Pos 5 [DPT_1.002 - 1bit] - 1-Vanes in Position 5

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Status_ Vane U-D* objects for each Position (1 to 5) will appear. When a Vane Position is enabled, a **"1"** value is returned through its bit-type object.

4.5.7 Enable use of Text object for Vane U-D

This parameter shows/hides the *Status_ Vane U-D Text* communication object.

- ↕ 92: Status_ Vanes U-D Text [DPT_16.001 - 14byte] - ASCII String

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Vane U-D Text* object will appear. Also, in the parameters will be shown six text fields, five for the Vane Position and one for the Auto function, that will let modify the text string displayed by the *Status_ Vane U-D Text* when changing a vane position.

| | |
|-------------------------------------|-----------|
| > String when vanes U-D is in AUTO | U-D AUTO |
| > String when vanes U-D is in POS 1 | U-D POS 1 |
| > String when vanes U-D is in POS 2 | U-D POS 2 |
| > String when vanes U-D is in POS 3 | U-D POS 3 |
| > String when vanes U-D is in POS 4 | U-D POS 4 |
| > String when vanes U-D is in POS 5 | U-D POS 5 |

Figure 4.17 Parameter detail

4.6 Vane L-R Configuration dialog

Device: 1.1.1 PA AC interface, 4 binary inputs

| | | |
|-----------------------------------|---|---------------------|
| General | Indoor unit has Left-Right Vanes (see docum. for your indoor unit) | Yes |
| Mode Configuration | DPT object type for Vanes Left-Right | Scaling [DPT_5.001] |
| Special Modes Configuration | Enable use of +/- object for Vanes L-R | No |
| Fan Speed Configuration | Enable "Vanes L-R Man/Auto" objects (for Control and Status) | No |
| Vanes Up-Down Configuration | Enable use of bit-type Vanes L-R objects (for Control) | No |
| Vanes Left-Right Configuration | Enable use of bit-type Vanes L-R objects (for Status) | No |
| Temperature Configuration | Enable use of Text object for Vanes L-R | No |
| Scene Configuration | | |
| Switch-Off Timeouts Configuration | | |
| Binary Input 1 Configuration | | |
| Binary Input 2 Configuration | | |
| Binary Input 3 Configuration | | |
| Binary Input 4 Configuration | | |
| Power Consumption Configuration | | |

Figure 4.18 Vane L-R Configuration dialog

All the parameters in this section are related with the Vane L-R properties and communication objects.

4.6.1 Indoor unit has L-R Vanes

This parameter lets choose if the unit has L-R Vanes available or not.

| | |
|--|-----|
| Indoor unit has Up-Down Vanes (see docum. for your indoor unit) | yes |
|--|-----|

Figure 4.19 Parameter detail

- If set to **"no"** all the parameters and communication objects for the L-R Vanes will not be shown.
- If set to **"yes"** all the parameters and communication objects (if enabled in the parameters dialog) for the L-R Vanes will be shown.

⚠ Important: Read the documentation of your indoor unit to check if L-R Vanes are available.

4.6.2 DPT object type for Vane L-R

With this parameter is possible to change de DPT for the *Control_ Vane L-R* and *Status_ Vane L-R* byte-type communication objects. Datapoints Scaling (DPT_5.001) and Enumerated (DPT_5.010) can be selected.

- When **"Enumerated [DPT 5.010]"** is selected, *Control_ Vane L-R* and *Status_ Vane L-R* communication objects for this DPT will appear.

■ 29: Control_ Vanes L-R / 5 pos [DPT_5.010 - 1by - Position values 1,2,3,4,5]

■ 93: Status_ Vanes L-R / 5 Pos [DPT_5.010 - 1byte] - Position values 1,2,3,4,5

To choose a vane position, values from **"1"** to **"5"** can be sent to the *Control_* object. Each value will correspond to the position (i.e. Value **"3"** = Position 3).

The *Status_* object will always return the value for the vane position selected.

⚠ **Important:** If a **"0"** value is sent to the *Control_* object, the Position 1 will be selected. If a value bigger than **"5"** is sent to the *Control_* object, then the Position 5 will be selected.

- When **"Scaling [DPT 5.001]"** is selected, *Control_ Vane L-R* and *Status_ Vane L-R* communication objects for this DPT will appear.

■ 29: Control_ Vanes Left-Right / 5 pos [DPT_5.001 - 1by - Thresholds:30%,50%,70% and 90%]

■ 93: Status_ Vanes L-R / 5 Pos [DPT_5.001 - 1byte] - 20%, 40%, 60%, 80% and 100%

When a value between **0%** and **29%** is sent to the *Control_* object the first vane position will be selected.


When a value between **30%** and **49%** is sent to the *Control_* object, the second vane position will be selected.

When a value between **50%** and **69%** is sent to the *Control_* object, the third vane position will be selected.

When a value between **70%** and **89%** is sent to the *Control_* object, the fourth vane position will be selected.

When a value between **90%** and **100%** is sent to the *Control_* object, the fifth vane position will be selected.

The *Status_* object will return a **20%** for the first vane position, a **40%** for the second one, a **60%** for the third one, an **80%** for the fourth one and a **100%** for the fifth and last one.

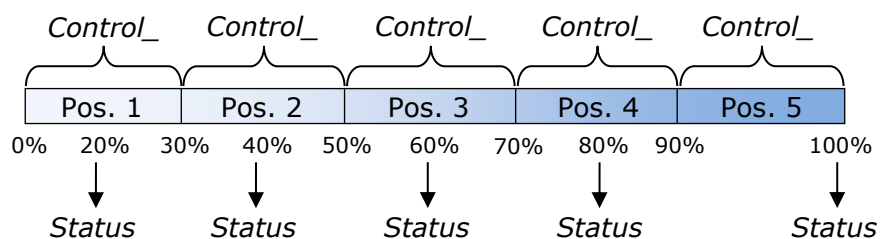

4.6.3 Enable use of +/- obj for Vane L-R

This parameter shows/hides the *Control_ Vane L-R +/-* communication object which lets change the indoor unit vane position by using two different datapoint types.

➡ 36: Control_ Vanes Left-Right +/- [DPT_1.007 - 1bit] - 0-Decrease;1-Increase

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Vane L-R +/-* object and a new parameter will appear.

| | |
|--|-------------------------------------|
| Enable use of +/- object for Vanes Left-Right | Yes |
| > DPT type for +/- Vanes Left-Right object | 0-Decrease / 1-Increase [DPT_1.007] |
| > Does +/- sequence include vanes Left-Right AUTO? | Yes |
| > Roll over Vanes at upper/lower limit (when controlling with +/- obj) | Yes |

Figure 4.20 Parameter detail

➤ DPT type for +/- Vane L-R obj


This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_ Vane L-R +/-* object.

➤ Does +/- sequence include vanes L-R AUTO?

This parameter lets choose if AUTO function is included (**"yes"**) or not (**"no"**) in the sequence when using *Control_ Vane L-R +/-* object as shown in the discontinuous segment at the picture below.

➤ Roll over Vanes at upper/lower limit

This parameter lets choose if roll-over will be enabled (**"yes"**) or disabled (**"no"**) for the *Vane L-R +/-* object.

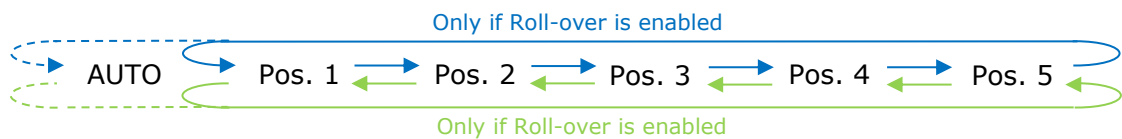

- Up / Increase
- Down / Decrease

4.6.4 Enable "Vanes L-R Manual/Auto" objects for Control and Status

This parameter shows/hides the *Control_ Vanes L-R Man/Auto* and *Status_ Vanes L-R Man/Auto* communication objects.

➡ 30: Control_ Vanes L-R Man/Auto [DPT_1.002 - 1bit] - 0-Manual/1-Auto

■ 94: Status_ Vanes L-R Man/Auto [DPT_1.002 - 1bit] - 0-Manual;1-Auto

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Vanes L-R Man/Auto* and *Status_ Vanes L-R Man/Auto* objects will appear.
 - When a **"1"** value is sent to the *Control_* communication object, Vanes L-R will be in Auto mode, and the *Status_* object will return this value.
 - When a **"0"** value is sent to the *Control_* communication object, Vanes L-R will be in Manual mode and the first position will be enabled. The *Status_* object will return this value.

Note: When feature 'remote lock' is enabled, parameter 'vane left-right manual/auto' of the AC indoor unit controlled by INKNXPAN001I000 does not perform control.

⚠ Important: When in Auto Mode the indoor unit will choose the most appropriate vane L-R position, but this will be shown neither in KNX nor in the remote controller.

4.6.5 Enable use of bit-type Vane L-R objects (for Control)

This parameter shows/hides the bit-type *Control_ Vane L-R* objects.

■ 31: Control_ Vanes Left-Right Pos 1 [DPT_1.002 - 1bit] - 1-Set Position 1
 ■ 32: Control_ Vanes Left-Right Pos 2 [DPT_1.002 - 1bit] - 1-Set Position 2
 ■ 33: Control_ Vanes Left-Right Pos 3 [DPT_1.002 - 1bit] - 1-Set Position 3
 ■ 34: Control_ Vanes Left-Right Pos 4 [DPT_1.002 - 1bit] - 1-Set Position 4
 ■ 35: Control_ Vanes Left-Right Pos 5 [DPT_1.002 - 1bit] - 1-Set Position 5

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Control_ Vane L-R* objects for each Position (1 to 5) will appear. To activate a Vane Position by using these objects, a **"1"** value has to be sent.

4.6.6 Enable use of bit-type Vane L-R objects (for Status)

This parameter shows/hides the bit-type *Status_ Vane L-R* objects.

■ 95: Status_ Vanes L-R Pos 1 [DPT_1.002 - 1bit] - 1-Vanes in Position 1
 ■ 96: Status_ Vanes L-R Pos 2 [DPT_1.002 - 1bit] - 1-Vanes in Position 2
 ■ 97: Status_ Vanes L-R Pos 3 [DPT_1.002 - 1bit] - 1-Vanes in Position 3
 ■ 98: Status_ Vanes L-R Pos 4 [DPT_1.002 - 1bit] - 1-Vanes in Position 4
 ■ 99: Status_ Vanes L-R Pos 5 [DPT_1.002 - 1bit] - 1-Vanes in Position 5

- If set to **"no"** the objects will not be shown.

- If set to **"yes"** the *Status_ Vane L-R* objects for each Position (1 to 5) will appear. When a Vane Position is enabled, a **"1"** value is returned through its bit-type object.

4.6.7 Enable use of Text object for Vane L-R

This parameter shows/hides the *Status_ Vane L-R Text* communication object.

100: Status_ Vanes L-R Text [DPT_16.001 - 14byte] - ASCII String

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Status_ Vane L-R Text* object will appear. Also, in the parameters will be shown six text fields, five for the Vane Position and one for the Auto function, that will let modify the text string displayed by the *Status_ Vane L-R Text* when changing a vane position.

| | |
|-------------------------------------|-----------|
| > String when vanes L-R is in AUTO | L-R AUTO |
| > String when vanes L-R is in POS 1 | L-R POS 1 |
| > String when vanes L-R is in POS 2 | L-R POS 2 |
| > String when vanes L-R is in POS 3 | L-R POS 3 |
| > String when vanes L-R is in POS 4 | L-R POS 4 |
| > String when vanes L-R is in POS 5 | L-R POS 5 |

Figure 4.21 Parameter detail

4.7 Temperature Configuration dialog

Device: 1.1.1 PA AC interface, 4 binary inputs

| | | |
|-----------------------------------|---|----|
| General | Periodic sending of "Status_ AC Setp" (in seconds; 0=No periodic sending) | 0 |
| Mode Configuration | Enable use of +/- obj for Setpoint Temp | No |
| Special Modes Configuration | Enable limits on Control_ Setpoint obj | No |
| Fan Speed Configuration | Ambient temp. ref. is provided from KNX (carefully read User Guide if enabled) | No |
| Vanes Up-Down Configuration | | |
| Vanes Left-Right Configuration | | |
| Temperature Configuration | | |
| Scene Configuration | | |
| Switch-Off Timeouts Configuration | | |
| Binary Input 1 Configuration | | |
| Binary Input 2 Configuration | | |
| Binary Input 3 Configuration | | |
| Binary Input 4 Configuration | | |
| Power Consumption Configuration | | |

Figure 4.22 Default Temperature Configuration dialog

All the parameters in this section are related with the Temperature properties and communication objects.

4.7.1 Periodic sending of "Status_ AC Setp"

This parameter lets change the interval of time (in seconds, from 0 to 255) at the end of which the AC setpoint temperature is sent to the KNX bus. For a "0" value, the AC setpoint temperature will ONLY be sent on change. The AC setpoint temperature is sent through the communication object *Status_ AC Setpoint Temp*.

102: Status_ AC Return Path Temp [DPT_9.001 - 2byte] - °C



| | | |
|--|-----|--|
| Periodic sending of "Status_ AC Setp" (in seconds; 0 = No periodic sending) | 255 |   |
|--|-----|--|

Figure 4.23 Parameter detail

△ Important: In case the ambient temperature is provided from KNX, the setpoint temperature returned from this object, will be the one resulting from the formula shown in the section "2.7.4 Ambient temp. ref. is provided from KNX".

4.7.2 Enable use of +/- object for Setpoint Temperature

This parameter shows/hides the *Control_ Setpoint Temp +/-* communication object which lets change the indoor unit setpoint temperature by using two different datapoint types.

38: Control_ Setpoint Temp +/- [DPT_1.007 - 1bit] - 0-Decrease;1-Increase

- If set to "no" the object will not be shown.
- If set to "yes" the *Control_ Setpoint Temp +/-* object and a new parameter will appear.



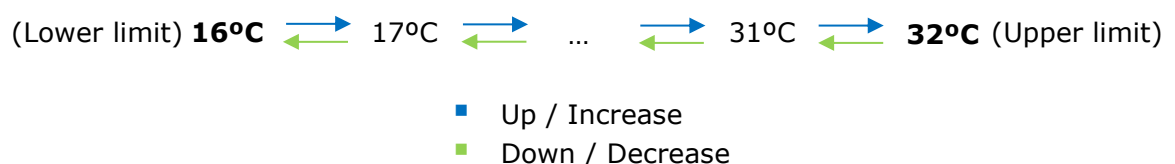
| | | |
|-------------------------------------|---------------------------|---|
| Enable use of +/- obj for Setp Temp | yes |  |
| > DPT type for +/- Setp Temp object | 0-Up / 1-Down [DPT_1.008] |  |

Figure 4.24 Parameter detail

➤ DPT type for +/- Setp Temp object

This parameter lets choose between the datapoints **0-Up / 1-Down [DPT_1.008]** and **0-Decrease / 1-Increase [DPT_1.007]** for the *Control_ Setpoint Temp +/-* object.



4.7.3 Enable limits on Control_ Setpoint obj

This parameter enables to define temperature limits for the *Control_ Setpoint Temperature* object.

| | |
|---------------------------------------|--------|
| Enable limits on Control_Setpoint obj | yes |
| > Control_Set Temp Lower limit (°C) | 18.0°C |
| > Control_Set Temp Upper limit (°C) | 30.0°C |

Figure 4.25 Parameter detail

- If set to **"no"** the setpoint temperature limits for the *Control_Setpoint Temperature* object will be the default: 16°C for the lower limit and 32°C for the upper limit.
- If set to **"yes"** it is possible to define temperature limits for the *Control_Setpoint Temperature* object.

➤ Control_Set Temp Lower limit (°C)

This parameter lets to define the lower limit for the setpoint temperature.

➤ Control_Set Temp Upper limit (°C)

This parameter lets to define the upper limit for the setpoint temperature.

⚠ **Important:** If a setpoint temperature above the upper defined limit (or below the lower defined limit) is sent through the *Control_Setpoint Temperature* object, it will be ALWAYS applied the limit defined.

⚠ **Important:** When limits are enabled, any setpoint temperature sent to the AC (even through scenes, special modes, etc.) will be limited.

4.7.4 Ambient temp. ref. is provided from KNX

This parameter shows/hides the *Control_Ambient Temperature* communication object which lets use an ambient temperature reference provided by a KNX device.

🔗 39: Control_Ambient Temperature [DPT_9.001 - 2byte] - (°C)

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_Ambient Temperature* object will appear. Meant to be enabled when you want the temperature provided by a KNX sensor to be the reference ambient temperature for the air conditioner. Then, the following formula applies for calculation of real *Control_Setpoint Temperature* sent to the AC unit:

$$\text{"AC Setp. Temp."} = \text{"KNX Setp. Temp."} - (\text{"KNX Amb. Temp."} - \text{"KNX Setp. Temp."})/2$$

- AC Setp. Temp.: AC indoor unit setpoint temperature
- KNX Amb. Temp.: Ambient temperature provided from KNX
- KNX Setp. Temp.: Setpoint temperature provided from KNX

As an example, consider the following situation:

User wants: **19°C** ("KNX Setp. Temp.")

User sensor (a KNX sensor) reads: **21°C** ("KNX Amb Temp.")

In this example, the final setpoint temperature that INKNXPAN001I000 will send out to the indoor unit (shown in "AC Setp. Temp.") will become $19^{\circ}\text{C} - (21^{\circ}\text{C} - 19^{\circ}\text{C})/2 = \mathbf{18^{\circ}\text{C}}$. This is the setpoint that will actually be requested to Panasonic unit.

This formula will be applied as soon as the *Control_ Setpoint Temperature* and *Control_ Ambient Temperature* objects are written at least once from the KNX installation. After that, they are kept always consistent.

Note that this formula will always drive the AC indoor unit demand in the *right* direction, regardless of the operation mode (Heat, Cool or Auto).

4.8 Scene Configuration dialog

| Device: 1.1.1 PA AC Interface | |
|-----------------------------------|---|
| General | Enable use of scenes: Yes |
| Mode Configuration | Scenes can be stored from KNX bus: No |
| Special Modes Configuration | Enable use of bit objects for scene execution: No |
| Fan Speed Configuration | Scene 1 preset: No |
| Vanes Up-Down Configuration | Scene 2 preset: No |
| Vanes Left-Right Configuration | Scene 3 preset: No |
| Temperature Configuration | Scene 4 preset: No |
| Scene Configuration | Scene 5 preset: No |
| Switch-Off Timeouts Configuration | |
| Binary Input 1 Configuration | |
| Binary Input 2 Configuration | |
| Binary Input 3 Configuration | |
| Binary Input 4 Configuration | |

Figure 4.26 Parameter detail

All the parameters in this section are related with the Scene properties and communication objects. A scene contains values of: On/Off, Mode, Fan speed, Vane position, Setpoint Temperature and Remote Controller Disablement.

4.8.1 Enable use of scenes

This parameter shows/hides the scene configuration parameters and communication objects.

51: Control_ Execute Scene [DPT_17.001 - 1byte] - 0..4-Exec1-5

Enable use of scenes: yes

Figure 4.27 Parameter detail

- If set to **"no"** the scene parameters and communication objects will not be shown.
- If set to **"yes"** the scene parameters and communication objects will be shown. To execute a scene through the byte-type object, a value from **"0"** to **"4"** has to be sent, corresponding each one to a different scene (i.e. "0" = Scene 1;... "4" = Scene 5).

4.8.2 Scenes can be stored from KNX bus

This parameter shows/hides the *Control_ Save/Exec Scene* and all the *Control_ Store Scene* (if enabled) communication objects.

- 51: Control_ Save/Exec Scene [DPT_18.001 - 1byte] - 0.4-Exec1-5;128..132-Save1-5
- 52: Control_ Store Scene 1 [DPT_1.002 - 1bit] - 1-Store Scene 1
- 53: Control_ Store Scene 2 [DPT_1.002 - 1bit] - 1-Store Scene 2
- 54: Control_ Store Scene 3 [DPT_1.002 - 1bit] - 1-Store Scene 3
- 55: Control_ Store Scene 4 [DPT_1.002 - 1bit] - 1-Store Scene 4
- 56: Control_ Store Scene 5 [DPT_1.002 - 1bit] - 1-Store Scene 5

- If set to **"no"** the communication objects will not be shown.
- If set to **"yes"** the communication objects and a new parameter will appear. To store a scene through the byte-type object, a value from **"128"** to **"132"** has to be sent to the object, corresponding each one to a different scene (i.e. "128" = Scene 1;... "132" = Scene 5).

Scenes can be stored from KNX bus

> Enable use of bit objects for storing scenes (from bus)

Figure 4.28 Parameter detail

➤ Enable use of bit objects for storing scenes (from bus)

If set to **"no"** the objects will not be shown.

If set to **"yes"** the *Control_ Store Scene* objects for storing scenes will appear. To store a scene by using these objects, a **"1"** value has to be sent to the scene's object we want to store (i.e. to store scene 4, a "1" has to be sent to the *Control_ Store Scene 4* object).

4.8.3 Enable use of bit objects for scene execution

This parameter shows/hides the *Control_ Execute Scene* bit-type communication objects.

- 57: Control_ Execute Scene 1 [DPT_1.002 - 1bit] - 1-Execute Scene 1
- 58: Control_ Execute Scene 2 [DPT_1.002 - 1bit] - 1-Execute Scene 2
- 59: Control_ Execute Scene 3 [DPT_1.002 - 1bit] - 1-Execute Scene 3
- 60: Control_ Execute Scene 4 [DPT_1.002 - 1bit] - 1-Execute Scene 4
- 61: Control_ Execute Scene 5 [DPT_1.002 - 1bit] - 1-Execute Scene 5

Enable use of bit objects for scene execution

Figure 4.29 Parameter detail

- If set to **"no"** the communication objects will not be shown.
- If set to **"yes"** the communication objects will appear. To execute a scene by using these objects, a **"1"** value has to be sent to the scene's object we want to execute (i.e. to execute scene 4, a "1" has to be sent to the *Control_ Execute Scene 4* object).

4.8.4 Scene "x" preset

This parameter lets define a preset for a scene (the following description is valid for all the scenes).




Figure 4.30 Parameter detail

- If set to **"no"** the preset for the scene "x" will be disabled.
- If set to **"yes"** the preset will be enabled. When a scene is executed the values configured in the preset will be applied.

⚠ Important: If a scene's preset is enabled, will not be possible to modify (store) the scene from the KNX bus.

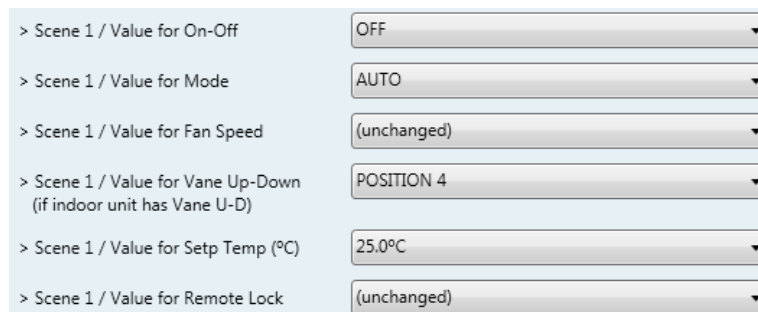


Figure 4.31 Parameter detail

➤ Scene "x" / Value for On-Off

This parameter lets choose the power of the indoor unit when the scene is executed. The following options are available: **"ON"**, **"OFF"** or **"(unchanged)"**.

➤ Scene "x" / Value for Mode

This parameter lets choose the mode of the indoor unit when the scene is executed. The following options are available: **"AUTO"**, **"HEAT (if available)"**, **"COOL"**, **"FAN (if available)"**, **"DRY"**, or **"(unchanged)"**.

➤ Scene "x" / Value for Fan Speed

This parameter lets choose the fan speed of the indoor unit when the scene is executed. The following options are available: **"SPEED 1"**, **"SPEED 2"**, **"SPEED 3"**, **"SPEED 4"**, **"SPEED 5"**, or **"(unchanged)"**.

➤ Scene "x" / Value for Vane U-D (if available)

This parameter lets choose the vane position of the indoor unit when the scene is executed. The following options are available: **"POSITION 1"**, **"POSITION 2"**, **"POSITION 3"**, **"POSITION 4"**, **"POSITION 5"**, **"AUTO"** or **"(unchanged)"**.

➤ Scene "x" / Value for Vane L-R (if available)

This parameter lets choose the vane position of the indoor unit when the scene is executed. The following options are available: **"POSITION 1"**, **"POSITION 2"**, **"POSITION 3"**, **"POSITION 4"**, **"POSITION 5"**, **"AUTO"** or **"(unchanged)"**.

➤ Scene "x" / Value for Setp Temp (°C)

This parameter lets choose the setpoint temperature of the indoor unit when the scene is executed. The following options are available: from **"16°C"** to **"32°C"** (both included), or **"(unchanged)"**.

➤ Scene "x" / Value for Remote Lock

This parameter lets choose the remote controller status of the indoor unit when the scene is executed. The following options are available: **"locked"**, **"unlocked"**, or **"(unchanged)"**.

⚠ **Important:** If any preset value is configured as **"(unchanged)"**, the execution of this scene will not change current status of this feature in the AC unit.

⚠ **Important:** When a scene is executed, Status_ Current Scene object shows the number of this scene. Any change in previous items does Status_ Current Scene show **"No Scene"**. Only changes on items marked as **"(unchanged)"** will not disable current scene.

4.9 Switch-Off Timeouts Configuration dialog

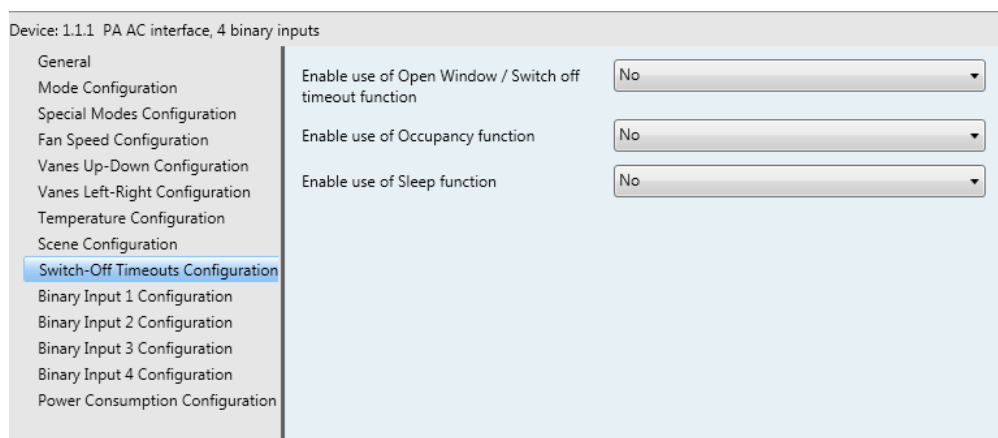


Figure 4.32 Default Switch-Off Timeouts Configuration dialog

All the parameters in this section are related with the timeout properties and communication objects.

4.9.1 Enable use of Open Window / Switch off timeout function

This parameter shows/hides the *Control_ Switch Off Timeout* communication object which lets Start/Stop a timeout to switch off the indoor unit.

➡ 42: Control_ Window Contact Status [DPT_1.009 - 1bit] - 0-Open;1-Closed

42: Control_ Switch Off Timeout [DPT_1.010 - 1bit] - 0-Stop;1-Start

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Switch Off Timeout* object and new parameters will appear. If a **"1"** value is sent to this object, and the indoor unit is already turned on, the switch-off timeout will begin. If a **"0"** value is sent to this object, the switch-off timeout will stop.

| | |
|---|--------------------------------------|
| Enable use of Open Window / Switch off timeout function | yes |
| > AC switch-off timeout (min) | 2 |
| > DPT for Window / Switch-off timeout | 0-Open / 1-Closed Window [DPT_1.009] |
| > Reload last On/Off val once window is closed | no |
| > Disallow On/Off operation while window is Open | yes |

Figure 4.33 Parameter detail

➤ AC switch-off timeout (min)

This parameter lets select how much time (in minutes) to wait before switching off the indoor unit.

➤ DPT for Window / Switch-off timeout

This parameter lets choose between the datapoints **0-Open / 1-Closed Window [DPT_1.009]** and **0-Stop / 1-Start Timeout [DPT_1.010]** for the *Control_ Switch Off Timeout*.

➤ Disallow On/Off operation while window is Open

If set to **"no"**, On/Off commands while the window is open will be accepted.

- If a **"1"** value is sent to the *Control_ Switch Off Timeout* object the switch-off timeout period will begin again.
- If a **"0"** value is sent to the *Control_ Switch Off Timeout* object, no action will be performed.

If set to **"yes"**, On/Off commands, while the window is open, will be saved (but not applied). These commands will be used in the next parameter if set to **"yes"**.

➤ Reload last On/Off val once window is closed?

If set to **"no"**, once the switch-off timeout is stopped, any value will be reloaded.

If set to **"yes"**, once the switch-off timeout is stopped, the last On/Off value sent will be reloaded.

- If a **"1"** value is sent to the *Control_ Switch Off Timeout* object after the timeout period, the indoor unit will **turn on**.

- If a "0" value is sent to the *Control_ Switch Off Timeout* after the timeout period, no action will be performed.

4.9.2 Enable use of Occupancy function

This parameter shows/hides the *Control_ Occupancy* communication object which lets apply different parameters to the indoor unit depending on the presence/no presence in the room.

■ 43: Control_ Occupancy [DPT_1.018 - 1bit] - 0-Not Occupied;1-Occupied

- If set to "no" the object will not be shown.
- If set to "yes" the *Control_ Occupancy* object and new parameters will appear. If a "1" value is sent to this object (no room occupancy), the timeout will begin. If a "0" value is sent to this object, the timeout will stop.

Figure 4.34 Parameter detail

➤ Timeout to apply action (minutes)

This parameter lets choose how much time to wait (in minutes) before executing the action specified in the next parameter ("Action after timeout elapsed").

➤ Action after timeout elapsed

When **Switch-Off** is selected, once the timeout has elapsed, the indoor unit will be turned off.

When **Apply Preset Delta** is selected, once the timeout has elapsed, a delta temperature will be applied in order to save energy (decreasing the setpoint when in Heat mode, or increasing the setpoint when in Cool mode). Also new parameters will appear.

Figure 4.35 Parameter detail

➤ Temp delta decrease (HEAT) or increase (COOL) (°C)

This parameter lets configure the delta temperature (increase or decrease) that will be applied when the timeout has elapsed.

- ⚠ **Important:** When there is occupancy again after the application of a delta, the same delta will be applied inversely. (i.e. In a room with AC in cool mode and 25°C setpoint temperature, a +2°C delta is applied after the occupancy timeout, setting the setpoint at 27°C because there is no occupancy in the

room. If the setpoint is raised to 29°C during that period, when the room is occupied again, a **-2°C** delta will be applied and the final setpoint temperature will then be 27°C).

➤ Enable secondary timeout

If set to **"no"** nothing will be applied.

If set to **"yes"**, a new timeout will be enabled and two new parameters will appear.

| | |
|--|--------------------|
| > Timeout to apply action (min) | 2 |
| > Action after timeout elapsed | Apply Preset Delta |
| > Temp delta dec (HEAT) / or inc (COOL) (°C) | 2.0°C |

Figure 4.36 Parameter detail

➤ Timeout to apply action (minutes)

This parameter lets choose how much time to wait (in minutes) before executing the action specified in the next parameter ("Action after timeout elapsed").

➤ Action after timeout elapsed

When **Switch-Off** is selected, once the timeout has elapsed, the indoor unit will turn off.

When **Apply Preset Delta** is selected, once the timeout configured is extinguished, a delta temperature will be applied (decreasing the setpoint when in Heat mode, or increasing the setpoint when in Cool mode). Also new parameters will appear.

➤ Temp delta decrease (HEAT) or increase (COOL) (°C)

This parameter lets configure the delta temperature that will be applied when the timeout is extinguished.

⚠ Important: When there is occupancy again after the application of a delta, the same delta will be applied inversely as explained above.

➤ Disallow On/Off operation while not Occupied

If set to **"no"**, On/Off commands while the window is open will be accepted.

- If a **"1"** value is sent to the *Control_ Occupancy* object the switch-off timeout period will begin again.
- If a **"0"** value is sent to the *Control_ Occupancy* object, no action will be performed.

If set to **"yes"**, On/Off commands while not occupied will be saved (but not applied). These commands will be used in the next parameter if set to **"yes"**.

Figure 4.37 Parameter detail

➤ Reload last On/Off value when Occupied

If set to **"no"**, once the switch-off timeout has elapsed, any value will be reloaded.

If set to **"yes"**, once the switch-off timeout has elapsed, the last On/Off value will be reloaded.

- If a **"1"** value is sent to the *Control_ Occupancy* object after the timeout period, the indoor unit will **turn on**.
- If a **"0"** value is sent to the *Control_ Occupancy* after the timeout period no action will be performed.

4.9.3 Enable use of SLEEP timeout

This parameter shows/hides the *Control_ Start Sleep Timeout* communication object which lets start a timeout to automatically turn off the indoor unit.

■ 44: Control_ Sleep Timeout [DPT_1.010 - 1bit] - 0-Stop;1-Start

- If set to **"no"** the object will not be shown.
- If set to **"yes"** the *Control_ Start Sleep Timeout* object and a new parameter will appear. If a **"1"** value is sent to this object the switch-off timeout will begin. If a **"0"** value is sent to this object, the switch-off timeout will stop.

Figure 4.38 Parameter detail

➤ Timeout to apply action (minutes)

This parameter lets select how much time (in minutes) to wait before switching off the AC unit.

4.10 Binary Input "x" Configuration dialog

Device: 1.1.1 PA AC interface, 4 binary inputs

| | | |
|-----------------------------------|---|-------------------|
| General | Enable use of Input 1 | Yes |
| Mode Configuration | > Contact type | NO: Normally Open |
| Special Modes Configuration | > Debounce time | 50 ms |
| Fan Speed Configuration | > Disabling function | No |
| Vanes Up-Down Configuration | > Function | Switching |
| Vanes Left-Right Configuration | > Send telegram after bus recovery | No action |
| Temperature Configuration | > Value on raising edge (contact activated) | No action |
| Scene Configuration | > Value on falling edge (contact deactivated) | No action |
| Switch-Off Timeouts Configuration | > Cyclical sending | Never |
| Binary Input 1 Configuration | | |
| Binary Input 2 Configuration | | |
| Binary Input 3 Configuration | | |
| Binary Input 4 Configuration | | |
| Power Consumption Configuration | | |

Figure 4.39 Binary Input Configuration dialog

All the parameters in this section are related with the binary inputs properties and communication objects.

4.10.1 Enable use of Input "x"

This parameter enables the use of the Input "x" and shows/hides the *Status_Inx* communication object(s) which will act as configured in the "Function" parameter.

```

■|120: Status_In1 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On
■|122: Status_In2 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On
■|124: Status_In3 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On
■|126: Status_In4 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On

```

- If set to **"no"** the objects will not be shown.
- If set to **"yes"** the *Status_Inx* object(s) and new parameters will appear.

4.10.2 Contact type

This parameter lets choose the behavior that will have the binary input depending on if the contact is normally open or normally closed.

- There are two possible options to configure the contact type: **"NO: Normally Open"** and **"NC: Normally Closed"**.

4.10.3 Debounce time

This parameter lets choose a debounce time (in milliseconds) that will be applied to the contact.

4.10.4 Disabling function

This parameter shows/hides the *Control_Disable Input x* communication object which will let disable/enable the input x.

■ ↗ 65: Control_Disable Input 4 [DPT_1.002 - 1bit] - 0-False;1-True
 ■ ↗ 65: Control_Disable Input 4 [DPT_1.003 - 1bit] - 0-Disable;1-Enable

- If set to **"no"** any object will be shown.
- When **"DPT 1.003: 0-Disable; 1-Enable"** is selected, the input can be disabled using the value **"0"** and enabled using the value **"1"**.
- When **"DPT 1.002: 0-Enable; 1-Disable"** is selected, the input can be disabled using the value **"1"** and enabled using the value **"0"**.

4.10.5 Function

This parameter lets choose the function that will have the binary input. There are 7 different functions available: Switching, Dimming, Shutter/Blind, Value, Execute Scene (internal), Occupancy (internal) and Window Contact (internal).

- When **"Switching"** is selected the communication object and new parameters for the Input "x" will appear as shown below.

■ ↗ 120: Status_In1 - Switching [DPT_1.001 - 1bit] - 0-Off;1-On

| | |
|---|-----------------|
| > Function | Switching |
| > Send telegram after bus recovery | No action |
| > Value on raising edge (contact activated) | Toggle (On/Off) |
| > Value on falling edge (contact deactivated) | No action |
| > Cyclical sending | Never |

Figure 4.40 Parameter detail

➤ Send telegram after bus recovery

This parameter lets select if the Binary Input "x" will send a telegram, or not, after a bus recovery, and the type of telegram sent (if enabled).

- When **"No action"** is selected, no telegram will be sent after a bus recovery.
- When **"Current status"** is selected, the binary input will send a telegram with its current status after a bus recovery. Also a new parameter will appear (see below).

- When **"On"** is selected, the binary input will send a telegram with a **"1"** value after a bus recovery. Also a new parameter will appear (see below).
- When **"Off"** is selected, the binary input will send a telegram with a **"0"** value after a bus recovery. Also a new parameter will appear (see below).




Figure 4.41 Parameter detail

➤ Sending delay after a bus recovery (seconds)

This parameter lets configure a delay (in seconds) that will be applied after a bus recovery and, after which, a telegram will be sent.

➤ Value on rising edge

This parameter lets select the value that the Binary Input "x" will send on a rising edge (contact activated).

- When **"On"** is selected, the binary input will always send telegrams with a **"1"** value.
- When **"Off"** is selected, the binary input will always send telegrams with a **"0"** value.
- When **"Toggle (On/Off)"** is selected, the binary input will send a **"1"** value after a **"0"** value and viceversa.
- When **"No action"** is selected, the binary input will not perform any action.

➤ Value on falling edge

This parameter lets select the value that the Binary Input "x" will send on a falling edge (contact deactivated).

- When **"On"** is selected, the binary input will always send telegrams with a **"1"** value.
- When **"Off"** is selected, the binary input will always send telegrams with a **"0"** value.
- When **"Toggle (On/Off)"** is selected, the binary input will send a **"1"** value after a **"0"** value and viceversa.
- When **"No action"** is selected, the binary input will not perform any action.

➤ Cyclical sending

This parameter lets enable/disable cyclical sending when a determined condition is met.

- When **"When output value is On"** is selected, everytime a **"1"** value is sent, it will be sent cyclically. Also a new parameter will appear (see below).

- When **"When output value is Off"** is selected, everytime a **"0"** value is sent, it will be sent cyclically. Also a new parameter will appear (see below).
- When **"Always"** is selected, the binary input will send any value cyclically. Also a new parameter will appear (see below).
- When **"Never"** is selected, cyclical sending will be disabled.

➤ Period for cyclical sending (seconds)

This parameter lets configure a time (in seconds) for the cyclical sending.

> Period for cyclical sending (seconds) 2

Figure 4.42 Parameter detail

- When **"Dimming"** is selected the communication objects and new parameters for the Input "x" will appear as shown below.

120: Status_In1 - Dimming - On/Off [DPT_1.001 - 1bit] - 0-Off;1-On
 121: Status_In1 - Dimming - Step(%) [DPT_3.007 - 4bit] - Dimming step

> Function Dimming

> Send telegram after bus recovery No action

> Mode for short (long) operation Toggle: On/Off (increase/decrease)

> Increasing step + 100 %

> Decreasing step - 100 %

> Short/long operation limit (x100ms) 10

> Cyclical sending period (x100ms) (0-No cyclical sending) 0

Figure 4.43 Parameter detail

➤ Send telegram after bus recovery

This parameter lets select if the Binary Input "x" will send a telegram, or not, after a bus recovery, and the type of telegram sent (if enabled).

- When **"No action"** is selected, no telegram will be sent after a bus recovery.
- When **"On"** is selected, the binary input will send a telegram with a **"1"** value after a bus recovery. Also a new parameter will appear (see below).
- When **"Off"** is selected, the binary input will send a telegram with a **"0"** value after a bus recovery. Also a new parameter will appear (see below).

> Sending delay after bus recovery (seconds) 10

Figure 4.44 Parameter detail

➤ Sending delay after a bus recovery (seconds)

This parameter lets configure a delay (in seconds) that will be applied after a bus recovery and, after which, a telegram will be sent.

➤ Mode for short (long) operation

This parameter lets select the value that the Binary Input "x" will send on a rising edge (contact activated), for a short and a long operation.

- When **"On (increase)"** is selected, the binary input will always send telegrams with a **"1"** value for a short operation, and an **"increase step"** for a long operation.
- When **"Off (decrease)"** is selected, the binary input will always send telegrams with a **"0"** value for a short operation, and an **"decrease step"** for a long operation.
- When **"Toggle: On/Off (increase/decrease)"** is selected:
 - For the short operation the binary input will send a **"1"** value after a **"0"** value and viceversa.
 - For the long operation the binary input will send an **"increase step"** after a **"decrease step"** and viceversa.

⚠ **Important:** Note that the first long operation in toggle depends on the last short operation, meaning that after a **"1"** value will be sent a **"decrease step"** and after a **"0"** value will be sent an **"increase step"**.

⚠ **Important:** The time period between a short and a long operation is defined in the parameter "Short/long operation limit (x100ms)".

➤ Increasing step

This parameter lets select the increasing step value (in %) that will be sent for a long operation.

➤ Decreasing step

This parameter lets select the decreasing step value (in %) that will be sent for a long operation.

➤ Short/long operation limit (x100ms)

This parameter lets introduce the time period difference for the short and the long operation.

➤ Cycl. send. period in long oper. (x100ms)

This parameter lets configure a time (in seconds) for the cyclical sending of a long operation.

- When **"Shutter/Blind"** is selected the communication objects and new parameters for the Input "x" will appear as shown below.

■ 120: Status_In1 - Shut/Blind - Step [DPT_1.007 - 1bit] - 0-Step Up;1-Step Down
 ■ 121: Status_In1 - Shut/Blind - Move [DPT_1.008 - 1bit] - 0-Move Up;1-Move Down

The screenshot shows a configuration window with the following settings:

- > Function: Shutter/Blind
- > Send telegram after bus recovery: No action
- > Operation: Toggle (Up/Down)
- > Method: Step-Move-Step
- > Short/long operation limit (x100ms): 10
- > Vanes adjustment time (x100ms): 10

Figure 4.45 Parameter detail

➤ Send telegram after bus recovery

This parameter lets select if the Binary Input "x" will send a telegram, or not, after a bus recovery and the type of telegram sent (if enabled).

- When **"No action"** is selected, no telegram will be sent after a bus recovery.
- When **"Move Up"** is selected, the binary input will send a telegram with a **"0"** value after a bus recovery. Also a new parameter will appear (see below).
- When **"Move Down"** is selected, the binary input will send a telegram with a **"1"** value after a bus recovery. Also a new parameter will appear (see below).

The screenshot shows a single parameter setting:

- > Sending delay after bus recovery (seconds): 10

Figure 4.46 Parameter detail

➤ Sending delay after a bus recovery (seconds)

This parameter lets configure a delay (in seconds) that will be applied after a bus recovery and, after which, a telegram will be sent.

➤ Operation

This parameter lets select the value that the Binary Input "x" will send on a rising edge (contact activated).

- When **"Up"** is selected, the binary input will always send telegrams with a **"0"**.
- When **"Down"** is selected, the binary input will always send telegrams with a **"1"** value.

- When **"Toggle (Up/Down)"** is selected the binary input will send a **"0"** value after a **"1"** value and viceversa.

➤ Method

This parameter lets select the working method for the shutter/blind.

- When **"Step-Move-Step"** is selected: On a rising edge (contact activated) a step/stop telegram will be sent and will begin a time called **T1**. If a falling edge occurs (contact deactivated) during the **T1**, no action will be performed.

If the rising edge is maintained longer than **T1**, a move telegram will be sent and will start a time called **T2**. If a falling edge occurs during the **T2**, a step/stop telegram will be sent. If a falling edge occurs after **T2** no action will be performed.

- When **"Move-Step"** is selected: On a rising edge a move telegram will be sent and will begin the **T2** time. If a falling edge occurs during the **T2**, a step/stop telegram will be sent. If a falling edge occurs after **T2** no action will be performed.

⚠ **Important:** The **T1** time have to be defined in the "Short/long operation limit (x100ms)" parameter. Also the **T2** time have to be defined in the "Vanes adjustment time (x100ms)" parameter.

➤ Short/long operation limit (x100ms)

This parameter lets introduce the time period difference for the short and the long operation (T1 time).

➤ Vanes adjustment time (x100ms)

This parameter lets introduce the time period for the vanes adjustment/blind movement (T2 time).

- When **"Value"** is selected the communication objects and new parameters for the Input "x" will appear as shown below.

121: Status_In1 - Value [DPT_5.010 - 1byte] - 1-byte unsigned value

| | |
|--|-------------------|
| > Function | Value |
| > Send telegram after bus recovery | Fixed value |
| > Sending delay after bus recovery (seconds) | 10 |
| > DPT to be sent | DPT 5.010 (1byte) |
| > Value on raising edge (when contact activated) | 234 |

Figure 4.47 Parameter detail

➤ Send telegram after bus recovery

This parameter lets select if the Binary Input "x" will send a telegram, or not, after a bus recovery and the type of telegram sent (if enabled).

- When **"No action"** is selected, no telegram will be sent after a bus recovery.
- When **"Fixed value"** is selected, the binary input will send a telegram with the same value configured in the "Value on rising edge" parameter. Also a new parameter will appear (see below).

Figure 4.49 Parameter detail

➤ Sending delay after a bus recovery (seconds)

This parameter lets configure a delay (in seconds) that will be applied after a bus recovery and, after which, a telegram will be sent.

➤ DPT to be sent

This parameter lets select the DPT type for the value that will be defined in the next parameter. This value will be sent on a rising edge (contact activated).

Figure 4.48 Parameter detail

➤ Value on rising edge (when contact activated)

This parameter lets define a value for the DTP type configured in the "DPT to be sent" parameter. This value will be sent on a rising edge (contact activated).

- When **"Execute Scene (internal)"** is selected, the binary input "x" will activate the scene defined in the next parameter, on a rising edge (contact activated).

Figure 4.49 Parameter detail

➤ Scene when contact is activated

This parameter lets choose the scene that will be activated on a rising edge. This scene MUST be defined in the "Scene Configuration" dialog as a preset.

- When **"Occupancy (internal)"** is selected, the binary input "x" will have the same behavior as configured in the parameter "Enable use of Occupancy function" inside the "Switch-Off Timeouts Configuration" dialog.

Figure 4.50 Parameter detail

- When **"Window Contact (internal)"** is selected, the binary input "x" will have the same behavior as configured in the parameter "Enable use of Open Window / Switch off timeout function" inside the "Switch-Off Timeouts Configuration" dialog.



Figure 4.51 Parameter detail

4.11 Power Consumption configuration

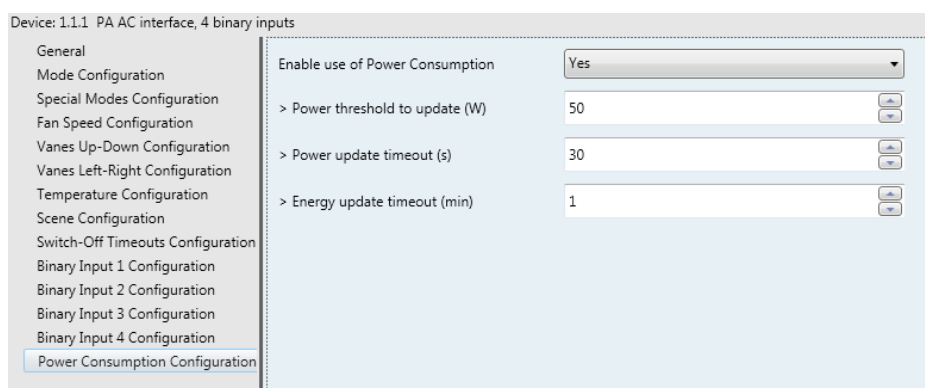


Figure 4.26 Parameter detail

All the parameters in this section are related with the Scene properties and communication objects. A scene contains values of: On/Off, Mode, Fan speed, Vane position, Setpoint Temperature and Remote Controller Disablement.

4.11.1 Enable use of Power Consumption

This parameter shows/hides the power consumption related parameters and communication objects.

- 40: Control_ Today [DPT_11.001 - 3byte] - Today's date
- 41: Control_ Reset Energy Counter [DPT_1.015 - 1bit] - 1-Reset counter
- 107: Status_ Power Consumption [DPT_14.056 - 4byte] - W
- 108: Status_ Today Energy [DPT_13.010 - 4byte] - Wh
- 109: Status_ Yesterday Energy [DPT_13.010 - 4byte] - Wh
- 110: Status_ Total Energy [DPT_13.010 - 4byte] - Wh
- 111: Status_ Today [DPT_11.001 - 3byte] - Today's date




Figure 4.27 Parameter detail

- If set to **"no"** the power consumption parameters and communication objects will not be shown.

- If set to “**yes**” the power consumption parameters and communication objects will be shown.
 - Control_ Today is used to set current local date.
 - Control_ Reset Energy Counter is used to reset all 3 energy counters:
 - Status_ Today Energy
 - Status_ Yesterday Energy
 - Status_ Total Energy

➤ Power Threshold to update (W)

This parameter is used to select the power threshold to be used before updating the information to the KNX bus.

Therefore, if the power value is not higher than the threshold selected, it won't be updated to the KNX bus.




Figure 4.27 Parameter detail

➤ Power update timeout (s)

This parameter is used to select the time threshold (in seconds) to be used before updating the power information to the KNX bus.

Therefore, the Power value will be updated to the KNX bus at least once each the value selected in the parameter.




Figure 4.27 Parameter detail

➤ Energy update timeout (min)


This parameter determines how often the energy information is read from the Panasonic System and sent to the KNX bus.



Figure 4.27 Parameter detail

5. Specifications

| | |
|------------------------------|--|
| Envelope | ABS (UL 94 HB). 2,5 mm thickness |
| Dimensions | 59 x 45 x 21 mm |
| Weight | 35g |
| Colour | Light Grey |
| Power supply | 29V DC, 7mA Supplied through KNX bus. |
| LED indicators | 1 x KNX programming. |
| Push buttons | 1 x KNX programming. |
| Binary inputs | 4 x Potential-free binary inputs. Signal cable length: 5m unshielded, may be extended up to 20m with twisted. Compliant with the following standards: IEC61000-4-2 : level 4 - 15kV (air discharge) - 8kV (contact discharge) MIL STD 883E-Method 3015-7 : class3B |
| Configuration | Configuration with ETS. |
| Operating Temperature | From -25°C to 60°C |
| Storage Temperature | From -40°C to 85°C |
| Isolation Voltage | 4000V |
| RoHS conformity | Compliant with RoHS directive (2002/95/CE). |
| Certifications | CE conformity to EMC directive (2004/108/EC) and Low-voltage directive (2006/95/EC) EN 61000-6-2; EN 61000-6-3; EN 60950-1; EN 50491-3; EN 50090-2-2; EN 50428; EN 60669-1; EN 60669-2-1 |

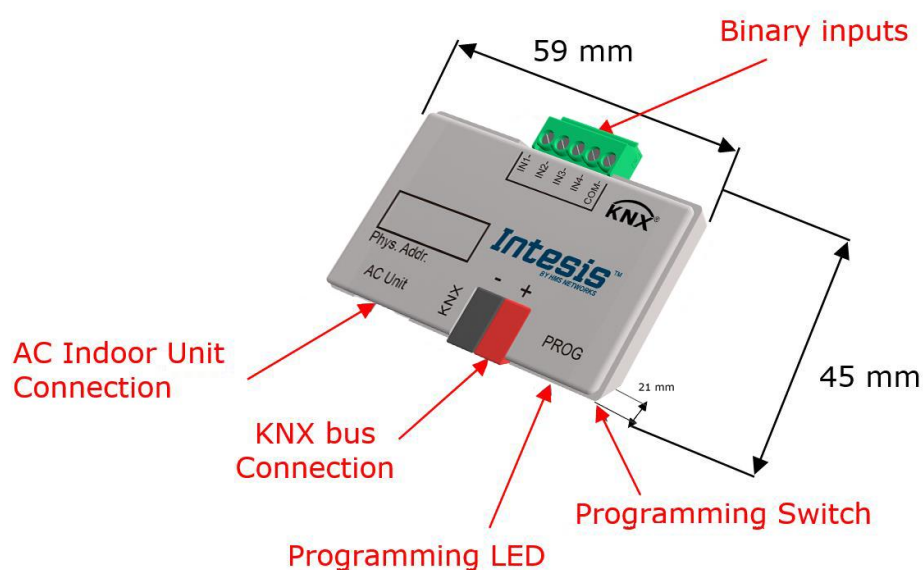

6. AC Unit Types compatibility

To check the compatibility of specific Panasonic indoor unit models with INKNXPAN001I000, use the Compatibility Tool:

<https://compatibility.intesis.com/>

7. Error Codes

| Error Code KNX Object | Error in RC | Abnormality / Protection control | Abnormality Judgment | Problem | Check Location |
|-----------------------------|----------------|---|--|---|--|
| 0 | H00 | — | — | No error | — |
| 65535 (-1 if signed) | — | — | — | Error in the communication of INKNXPAN0011000 device with the AC unit | <ul style="list-style-type: none"> Indoor/gateway connection wire |
| 8209 | H11 | Indoor/outdoor abnormal communication | After operation for 1 minute | Indoor/outdoor communication not establish | <ul style="list-style-type: none"> Indoor/outdoor wire terminal Indoor/outdoor PCB Indoor/outdoor connection wire |
| 8210 | H12 | Indoor unit capacity unmatched | 90s after power supply | Total indoor capability more than maximum limit or less than minimum limit, or number of indoor unit less than two. | <ul style="list-style-type: none"> Indoor/outdoor connection wire Indoor/outdoor PCB Specification and combination table in catalogue |
| 8212 | H14 | Indoor intake air temperature sensor abnormality | Continuous for 5s | Indoor intake air temperature sensor open or short circuit | <ul style="list-style-type: none"> Indoor intake air temperature sensor lead wire and connector |
| 8213 | H15 | Compressor temperature sensor abnormality | Continuous for 5s | Compressor temperature sensor open or short circuit | <ul style="list-style-type: none"> Compressor temperature sensor lead wire and connector |
| 8214 | H16 | Outdoor current transformer (CT) abnormality | — | Current transformer faulty or compressor faulty | <ul style="list-style-type: none"> Outdoor PCB faulty or compressor faulty |
| 8217 | H19 | Indoor fan motor mechanism lock | Continuous happen for 7 times | Indoor fan motor lock or feedback abnormal | <ul style="list-style-type: none"> Fan motor lead wire and connector Fan motor lock or block |
| 8227 | H23 | Indoor heat exchanger temperature sensor abnormality | Continuous for 5s | Indoor heat exchanger temperature sensor open or short circuit | <ul style="list-style-type: none"> Indoor heat exchanger temperature sensor lead wire and connector |
| 8229 | H25 | Indoor E-Ion abnormality | Port is ON for 10s during E-Ion off | — | <ul style="list-style-type: none"> E-Ion PCB |
| 8231 | H27 | Outdoor air temperature sensor abnormality | Continuous for 5s | Outdoor air temperature sensor open or short circuit | <ul style="list-style-type: none"> Outdoor air temperature sensor lead wire and connector |
| 8232 | H28 | Outdoor heat exchanger temperature sensor 1 abnormality | Continuous for 5s | Outdoor heat exchanger temperature sensor 1 open or short circuit | <ul style="list-style-type: none"> Outdoor heat exchanger temperature sensor 1 lead wire and connector |
| 8240 | H30 | Outdoor discharge pipe temperature sensor abnormality | Continuous for 5s | Outdoor discharge pipe temperature sensor open or short circuit | <ul style="list-style-type: none"> Outdoor discharge pipe temperature sensor lead wire and connector |
| 8242 | H32 | Outdoor heat exchanger temperature sensor 2 abnormality | Continuous for 5s | Outdoor heat exchanger temperature sensor 2 open or short circuit | <ul style="list-style-type: none"> Outdoor heat exchanger temperature sensor 2 lead wire and connector |
| 8243 | H33 | Indoor / outdoor misconnection abnormality | — | Indoor and outdoor rated voltage different | <ul style="list-style-type: none"> Indoor and outdoor units check |
| 8244 | H34 | Outdoor heat sink temperature sensor abnormality | Continuous for 2s | Outdoor heat sink temperature sensor open or short circuit | <ul style="list-style-type: none"> Outdoor heat sink sensor |
| 8246 | H36 | Outdoor gas pipe temperature sensor abnormality | Continuous for 5s | Outdoor gas pipe temperature sensor open or short circuit | <ul style="list-style-type: none"> Outdoor gas pipe temperature sensor lead wire and connector |
| 8247 | H37 | Outdoor liquid pipe temperature sensor abnormality | Continuous for 5s | Outdoor liquid pipe temperature sensor open or short circuit | <ul style="list-style-type: none"> Outdoor liquid pipe temperature sensor lead wire and connector |
| 8248 | H38 | Indoor/Outdoor mismatch (brand code) | — | Brand code not match | <ul style="list-style-type: none"> Check indoor unit and outdoor unit. |

| | | | | | |
|-------|-----|--|----------------------------------|--|---|
| 8249 | H39 | Abnormal indoor operating unit or standby units | 3 times happen within 40 minutes | Wrong wiring and connecting pipe, expansion valve abnormality, indoor heat exchanger sensor open circuit | <ul style="list-style-type: none"> • Check indoor/outdoor connection wire and connection pipe • Indoor heat exchanger sensor lead wire and connector • Expansion valve and lead wire and connector |
| 8257 | H41 | Abnormal wiring or piping connection | — | Wrong wiring and connecting pipe, expansion valve abnormality | <ul style="list-style-type: none"> • Check indoor/outdoor connection wire and connection pipe • Expansion valve and lead wire and connector. |
| 8280 | H58 | Indoor gas sensor abnormality | Continuous for 6 hours | Indoor gas sensor open or short circuit | <ul style="list-style-type: none"> • Indoor gas sensor • Indoor PCB |
| 8281 | H59 | ECO patrol sensor abnormality | Continuous for 70s | ECO patrol sensor open or short circuit | <ul style="list-style-type: none"> • ECO patrol sensor • ECO patrol and Indoor PCB |
| 8292 | H64 | Outdoor high pressure sensor abnormality | Continuous for 1 minutes | High pressure sensor open circuit during compressor stop | <ul style="list-style-type: none"> • High pressure sensor • Lead wire and connector |
| 8343 | H97 | Outdoor fan motor mechanism lock | 2 times happen within 30 minutes | Outdoor fan motor lock or feedback abnormal | <ul style="list-style-type: none"> • Outdoor fan motor lead wire and connector • Fan motor lock or block |
| 8344 | H98 | Indoor high pressure protection | — | Indoor high pressure protection (Heating) | <ul style="list-style-type: none"> • Check indoor heat exchanger • Air filter dirty • Air circulation short circuit |
| 8345 | H99 | Indoor operating unit freeze protection | — | Indoor freeze protection (Cooling) | <ul style="list-style-type: none"> • Check indoor heat exchanger • Air filter dirty • Air circulation short circuit |
| 12305 | F11 | 4-way valve switching abnormality | 4 times happen within 30 minutes | 4-way valve switching abnormal | <ul style="list-style-type: none"> • 4-way valve • Lead wire and connector. |
| 12311 | F17 | Indoor standby units freezing abnormality | 3 times happen within 40 minutes | Wrong wiring and connecting pipe, expansion valve leakage, indoor heat exchanger sensor open circuit | <ul style="list-style-type: none"> • Check indoor/outdoor connection wire and pipe • Indoor heat exchanger sensor lead wire and connector • Expansion valve lead wire and connector. |
| 12432 | F90 | Power factor correction (PFC) circuit protection | 4 times happen within 10 minutes | Power factor correction circuit abnormal | <ul style="list-style-type: none"> • Outdoor PCB faulty |
| 12433 | F91 | Refrigeration cycle abnormality | 2 times happen within 20 minutes | Refrigeration cycle abnormal | <ul style="list-style-type: none"> • Insufficient refrigerant or valve close |
| 12435 | F93 | Compressor abnormal revolution | 4 times happen within 20 minutes | Compressor abnormal revolution | <ul style="list-style-type: none"> • Power transistor module faulty or compressor lock |
| 12436 | F94 | Compressor discharge pressure overshoot protection | 4 times happen within 30 minutes | Compressor discharge pressure overshoot | <ul style="list-style-type: none"> • Check refrigeration system |
| 12437 | F95 | Outdoor cooling high pressure protection | 4 times happen within 20 minutes | Cooling high pressure protection | <ul style="list-style-type: none"> • Check refrigeration system • Outdoor air circuit |
| 12438 | F96 | Power transistor module overheating protection | 4 times happen within 30 minutes | Power transistor module overheat | <ul style="list-style-type: none"> • PCB faulty • Outdoor air circuit (fan motor) |
| 12439 | F97 | Compressor overheating protection | 3 times happen within 30 minutes | Compressor overheat | <ul style="list-style-type: none"> • Insufficient refrigerant |
| 12440 | F98 | Total running current protection | 3 times happen within 20 minutes | Total current protection | <ul style="list-style-type: none"> • Check refrigeration system • Power source or compressor lock |
| 12441 | F99 | Outdoor direct current (DC) peak detection | Continuous happen for 7 times | Power transistor module current protection | <ul style="list-style-type: none"> • Power transistor module faulty or compressor lock |

In case you detect an error code not listed, contact your nearest Panasonic technical support service for more information on the error meaning.

Appendix A – Communication Objects Table

| TOPIC | OBJECT NUMBER | NAME | LENGTH | DATAPOINT TYPE | | FLAGS | | | | FUNCTION |
|-------------------------------|---------------|-------------------------|-------------------------------|-------------------|-------------|-------|---|---|---|---|
| | | | | DPT_NAME | DPT_ID | R | W | T | U | |
| On/Off | 0 | Control_ On/Off | 1 bit | DPT_Switch | 1.001 | | W | T | | 0 - Off; 1-On |
| AC Features | 1 | Control_ Powerful | 1 bit | DPT_Bool | 1.002 | | W | T | | 1 – Set POWERFUL |
| | 2 | Control_ Quiet | 1 bit | DPT_Bool | 1.002 | | W | T | | 1 – Set QUIET |
| Mode | 3 | Control_ Mode | 1 byte | DPT_HVACContrMode | 20.105 | | W | T | | 0 - Auto; 1 - Heat; 3 - Cool; 9 - Fan; 14 - Dry |
| | 4 | Control_ Mode Cool/Heat | 1 bit | DPT_Heat/Cool | 1.100 | | W | T | | 0 - Cool; 1 - Heat; |
| | 5 | Control_ Mode Cool & On | 1 byte | DPT_Scaling | 5.001 | | W | T | | 0% - Off; 0.1%-100% - On + Cool |
| | 6 | Control_ Mode Heat & On | 1 byte | DPT_Scaling | 5.001 | | W | T | | 0% - Off; 0.1%-100% - On + Heat |
| | 7 | Control_ Mode Auto | 1 bit | DPT_Bool | 1.002 | | W | T | | 1 - Auto |
| | 8 | Control_ Mode Heat | 1 bit | DPT_Bool | 1.002 | | W | T | | 1 - Heat |
| | 9 | Control_ Mode Cool | 1 bit | DPT_Bool | 1.002 | | W | T | | 1 - Cool |
| | 10 | Control_ Mode Fan | 1 bit | DPT_Bool | 1.002 | | W | T | | 1 - Fan |
| | 11 | Control_ Mode Dry | 1 bit | DPT_Bool | 1.002 | | W | T | | 1 - Dry |
| | 12 | Control_ Mode -/+ | 1 bit | DPT_Step | 1.007 | | W | | | 0 - Decrease; 1 - Increase |
| | | Control_ Mode +/- | 1 bit | DPT_UpDown | 1.008 | | W | | | 0 - Up; 1 - Down |
| | Fan Speed | 13 | Control_ Fan Speed / 5 Speeds | 1 byte | DPT_Scaling | 5.001 | | W | T | |
| Control_ Fan Speed / 5 Speeds | | | 1 byte | DPT_Enumerated | 5.010 | | W | T | | 1 - Speed 1; 2 - Speed 2; 3 Speed 3; 4 - Speed 4; 5 Speed 5 |

| | | | | | | | | | |
|------------------|-----------|--------------------------------|--------|----------------|-------|--|---|---|--|
| | 14 | Control_ Fan Speed Manual/Auto | 1 bit | DPT_Bool | 1.002 | | W | T | 0 - Manual; 1 - Auto |
| | 15 | Control_ Fan Speed 1 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Fan Speed 1 |
| | 16 | Control_ Fan Speed 2 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Fan Speed 2 |
| | 17 | Control_ Fan Speed 3 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Fan Speed 3 |
| | 18 | Control_ Fan Speed 4 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Fan Speed 4 |
| | 19 | Control_ Fan Speed 5 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Fan Speed 5 |
| | 20 | Control_ Fan Speed -/+ | 1 bit | DPT_Step | 1.007 | | W | | 0 - Decrease; 1 - Increase |
| | | Control_ Fan Speed +/- | 1 bit | DPT_UpDown | 1.008 | | W | | 0 - Up; 1 - Down |
| Vanes U-D | 21 | Control_ Vane U-D / 5 pos | 1 byte | DPT_Scaling | 5.001 | | W | T | 0%-29% - Pos1; 30%-49% - Pos2; 50%-69% Pos3; 70%-89% - Pos4; 90%-100% - Pos5 |
| | | Control_ Vane U-D / 5 pos | 1 byte | DPT_Enumerated | 5.010 | | W | T | 1 - Pos1; 2 - Pos2; 3 - Pos3; 4 - Pos4; 5 - Pos5 |
| | 22 | Control_ Vane U-D Man/Auto | 1 bit | DPT_Bool | 1.002 | | W | T | 0 - Manual; 1 - Auto |
| | 23 | Control_ Vane U-D Pos1 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 1 |
| | 24 | Control_ Vane U-D Pos2 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 2 |
| | 25 | Control_ Vane U-D Pos3 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 3 |
| | 26 | Control_ Vane U-D Pos4 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 4 |
| | 27 | Control_ Vane U-D Pos5 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 5 |
| | 28 | Control_ Vane U-D -/+ | 1 bit | DPT_Step | 1.007 | | W | | 0 - Decrease; 1 - Increase |
| | | Control_ Vane U-D +/- | 1 bit | DPT_UpDown | 1.008 | | W | | 0 - Up; 1 - Down |
| Vanes L-R | 29 | Control_ Vane L-R / 5 pos | 1 byte | DPT_Scaling | 5.001 | | W | T | 0%-29% - Pos1; 30%-49% - Pos2; 50%-69% Pos3; 70%-89% - Pos4; 90%-100% - Pos5 |

| | | | | | | | | | |
|---------------------|-----------|-------------------------------|--------|----------------|--------|--|---|---|---|
| | | Control_ Vane L-R / 5 pos | 1 byte | DPT_Enumerated | 5.010 | | W | T | 1 - Pos1; 2 - Pos2; 3 - Pos3; 4 - Pos4; 5 - Pos5 |
| | 30 | Control_ Vane L-R Man/Auto | 1 bit | DPT_Bool | 1.002 | | W | T | 0 – Manual; 1 - Auto |
| | 31 | Control_ Vane L-R Pos1 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 1 |
| | 32 | Control_ Vane L-R Pos2 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 2 |
| | 33 | Control_ Vane L-R Pos3 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 3 |
| | 34 | Control_ Vane L-R Pos4 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 4 |
| | 35 | Control_ Vane L-R Pos5 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Position 5 |
| | 36 | Control_ Vane L-R -/+ | 1 bit | DPT_Step | 1.007 | | W | | 0 - Decrease; 1 - Increase |
| | | Control_ Vane L-R +/- | 1 bit | DPT_UpDown | 1.008 | | W | | 0 - Up; 1 - Down |
| Temperature | 37 | Control_ Setpoint Temp | 2 byte | DPT_Value_Temp | 9.001 | | W | T | 16°C to 32°C |
| | 38 | Control_ Setpoint Temp -/+ | 1 bit | DPT_Step | 1.007 | | W | | 0 - Decrease; 1 - Increase |
| | | Control_ Setpoint Temp +/- | 1 bit | DPT_UpDown | 1.008 | | W | | 0 - Up; 1 - Down |
| | 39 | Control_ Ambient Temperature | 2 byte | DPT_Value_Temp | 9.001 | | W | T | °C value in EIS5 format |
| Set date | 40 | Control_ Today | 3 byte | DPT_Date | 11.001 | | w | T | Today's date |
| Energy Reset | 41 | Control_ Reset Energy Counter | 1 bit | DPT_Reset | 1.015 | | W | T | 1- Reset Counter |
| Timeout | 42 | Control_ Switch Off Timeout | 1 bit | DPT_OpenClose | 1.009 | | W | T | 0 - Open; 1 - Closed |
| | | Control_ Switch Off Timeout | 1 bit | DPT_Start | 1.010 | | W | T | 0 - Stop; 1 - Start |
| | 43 | Control_ Occupancy | 1 bit | DPT_Occupancy | 1.018 | | W | T | 0 - Not Occupied; 1 - Occupied |
| | 44 | Control_ Sleep Timeout | 1 bit | DPT_Start | 1.010 | | W | T | 0 - Stop; 1 - Start |
| Locking | 45 | Control_ Lock Remote Control | 1 bit | DPT_Bool | 1.002 | | W | T | 0 - Unlock; 1 - Lock |
| | 46 | Control_ Lock Control Objects | 1 bit | DPT_Bool | 1.002 | | W | T | 0 - Unlock; 1 – Lock |

| | | | | | | | | | |
|---------------|----|--------------------------|--------|------------------|--------|--|---|---|--|
| Special Modes | 47 | Control_ Power Mode | 1 bit | DPT_Start | 1.010 | | W | T | 0 - Stop; 1 - Start |
| | 48 | Control_ Econo Mode | 1 bit | DPT_Start | 1.010 | | W | T | 0 - Stop; 1 - Start |
| | 49 | Control_ Additional Heat | 1 bit | DPT_Start | 1.010 | | W | T | 0 - Stop; 1 - Start |
| | 50 | Control_ Additional Cool | 1 bit | DPT_Start | 1.010 | | W | T | 0 - Stop; 1 - Start |
| Scenes | 51 | Control_ Save/Exec Scene | 1 byte | DPT_SceneControl | 18.001 | | W | T | 0 to 4 - Exec. Scene 1 to 5; 128 to 132 - Save Scene 1 to 5 |
| | 52 | Control_ Store Scene1 | 1 bit | DPT_Bool | 1.002 | | W | | 1 - Store Scene |
| | 53 | Control_ Store Scene2 | 1 bit | DPT_Bool | 1.002 | | W | | 1 - Store Scene |
| | 54 | Control_ Store Scene3 | 1 bit | DPT_Bool | 1.002 | | W | | 1 - Store Scene |
| | 55 | Control_ Store Scene4 | 1 bit | DPT_Bool | 1.002 | | W | | 1 - Store Scene |
| | 56 | Control_ Store Scene5 | 1 bit | DPT_Bool | 1.002 | | W | | 1 - Store Scene |
| | 57 | Control_ Execute Scene1 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Execute Scene |
| | 58 | Control_ Execute Scene2 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Execute Scene |
| | 59 | Control_ Execute Scene3 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Execute Scene |
| | 60 | Control_ Execute Scene4 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Execute Scene |
| | 61 | Control_ Execute Scene5 | 1 bit | DPT_Bool | 1.002 | | W | T | 1 - Execute Scene |
| Disabling | 62 | Control_ Disable Input 1 | 1 bit | DPT_Bool | 1.002 | | W | T | 0 - Enable; 1 - Disable |
| | | Control_ Disable Input 1 | 1 bit | DPT_Enable | 1.003 | | W | T | 0 - Disable; 1 - Enable |
| | 63 | Control_ Disable Input 2 | 1 bit | DPT_Bool | 1.002 | | W | T | 0 - Enable; 1 - Disable |
| | | Control_ Disable Input 2 | 1 bit | DPT_Enable | 1.003 | | W | T | 0 - Disable; 1 - Enable |
| | 64 | Control_ Disable Input 3 | 1 bit | DPT_Bool | 1.002 | | W | T | 0 - Enable; 1 - Disable |
| | | Control_ Disable Input 3 | 1 bit | DPT_Enable | 1.003 | | W | T | 0 - Disable; 1 - Enable |
| | 65 | Control_ Disable Input 4 | 1 bit | DPT_Bool | 1.002 | | W | T | 0 - Enable; 1 - Disable |

| | | | | | | | | | |
|--|--|--------------------------|-------|------------|-------|--|---|---|-------------------------|
| | | Control_ Disable Input 4 | 1 bit | DPT_Enable | 1.003 | | W | T | 0 - Disable; 1 - Enable |
|--|--|--------------------------|-------|------------|-------|--|---|---|-------------------------|

| | | | | | | | | | |
|--------------------|-----------|-------------------------------|---------|-------------------|--------|---|--|---|---|
| On/Off | 66 | Status_ On/Off | 1 bit | DPT_Switch | 1.001 | R | | T | 0 - Off; 1-On |
| AC Features | 67 | Status_ Powerful | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Powerful active |
| | 68 | Status_ Quiet | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Quiet active |
| Mode | 69 | Status_ Mode | 1 byte | DPT_HVACContrMode | 20.105 | R | | T | 0 - Auto; 1 - Heat; 3 - Cool; 9 - Fan; 14 - Dry |
| | 70 | Status_ Mode Cool/Heat | 1 bit | DPT_Heat/Cool | 1.100 | R | | T | 0 - Cool; 1 - Heat |
| | 71 | Status_ Mode Auto | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Auto |
| | 72 | Status_ Mode Heat | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Heat |
| | 73 | Status_ Mode Cool | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Cool |
| | 74 | Status_ Mode Fan | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Fan |
| | 75 | Status_ Mode Dry | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Dry |
| | 76 | Status_ Mode Text | 14 byte | DPT_String_8859_1 | 16.001 | R | | T | ASCII String |
| Fan Speed | 77 | Status_ Fan Speed / 5 Speeds | 1 byte | DPT_Scaling | 5.001 | R | | T | 20% - Speed 1; 40% - Speed 2; 60% - Speed 3; 80% - Speed 4; 100% - Speed 5 |
| | | Status_ Fan Speed / 5 Speeds | 1 byte | DPT_Enumerated | 5.010 | R | | T | 1 - Speed 1; 2 - Speed 2; 3 Speed 3; 4 - Speed 4; 5 Speed 5 |
| | 78 | Status_ Fan Speed Manual/Auto | 1 bit | DPT_Bool | 1.002 | R | | T | 0 - Manual; 1 - Auto |
| | 79 | Status_ Fan Speed 1 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Speed 1 |
| | 80 | Status_ Fan Speed 2 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Speed 2 |
| | 81 | Status_ Fan Speed 3 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Speed 3 |
| | 82 | Status_ Fan Speed 4 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Speed 4 |

| | | | | | | | | | |
|------------------|-----------|---------------------------|---------|-------------------|--------|---|--|---|---|
| | 83 | Status_ Fan Speed 5 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Speed 5 |
| | 84 | Status_ Fan Speed Text | 14 byte | DPT_String_8859_1 | 16.001 | R | | T | ASCII String |
| Vanes U-D | 85 | Status_ Vane U-D / 5 pos | 1 byte | DPT_Scaling | 5.001 | R | | T | 20% - Pos1; 40% - Pos2; 60% - Pos3; 80% - Pos4; 100% - Pos5 |
| | | Status_ Vane U-D / 5 pos | 1 byte | DPT_Enumerated | 5.010 | R | | T | 1 - Pos1; 2 - Pos2; 3 - Pos3; 4 - Pos4; 5 - Pos5 |
| | 86 | Status_ Vane U-D Man/Auto | 1 bit | DPT_Bool | 1.002 | R | | T | 0 - Manual; 1 - Auto |
| | 87 | Status_ Vane U-D Pos1 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 1 |
| | 88 | Status_ Vane U-D Pos2 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 2 |
| | 89 | Status_ Vane U-D Pos3 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 3 |
| | 90 | Status_ Vane U-D Pos4 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 4 |
| | 91 | Status_ Vane U-D Pos5 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 5 |
| | 92 | Status_ Vane U-D Text | 14 byte | DPT_String_8859_1 | 16.001 | R | | T | ASCII String |
| | 93 | Status_ Vane L-R / 5 pos | 1 byte | DPT_Scaling | 5.001 | R | | T | 20% - Pos1; 40% - Pos2; 60% - Pos3; 80% - Pos4; 100% - Pos5 |
| | | Status_ Vane L-R / 5 pos | 1 byte | DPT_Enumerated | 5.010 | R | | T | 1 - Pos1; 2 - Pos2; 3 - Pos3; 4 - Pos4; 5 - Pos5 |
| Vanes L-R | 94 | Status_ Vane L-R Man/Auto | 1 bit | DPT_Bool | 1.002 | R | | T | 0 - Manual; 1 - Auto |
| | 95 | Status_ Vane L-R Pos1 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 1 |
| | 96 | Status_ Vane L-R Pos2 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 2 |
| | 97 | Status_ Vane L-R Pos3 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 3 |
| | 98 | Status_ Vane L-R Pos4 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 4 |
| | 99 | Status_ Vane L-R Pos5 | 1 bit | DPT_Bool | 1.002 | R | | T | 1 - Position 5 |

| | | | | | | | | | |
|----------------------|------------|--------------------------------|---------|--------------------|--------|---|--|---|---|
| | 100 | Status_ Vane L-R Text | 14 byte | DPT_String_8859_1 | 16.001 | R | | T | ASCII String |
| Temperature | 101 | Status_ AC Setpoint Temp | 2 byte | DPT_Value_Temp | 9.001 | R | | T | 16°C to 32°C |
| | 102 | Status_ AC Return Path Temp | 2 byte | DPT_Value_Temp | 9.001 | R | | T | 0°C to 40°C |
| | 103 | Status_ Outdoor Temp | 2 byte | DPT_Value_Temp | 9.001 | R | | T | -10°C to 40°C |
| Error | 104 | Status_ Error/Alarm | 1 bit | DTP_Alarm | 1.005 | R | | T | 0 - No Alarm; 1 - Alarm |
| | 105 | Status_ Error Code | 2 byte | Enumerated | | R | | T | 0 - No Error; Any other see user's manual |
| | 106 | Status_ Error Text code | 14 byte | DPT_String_8859_1 | 16.001 | R | | T | 3 char Panasonic Error; Empty - none |
| Consumption | 107 | Status_ Power Consumption | 4 byte | DPT_Value_Power | 14.056 | R | | T | Current AC power consumption (W) |
| | 108 | Status_ Today Energy | 4 byte | DPT_ActiveEnergy | 13.010 | R | | T | Energy consumed today (Wh) |
| | 109 | Status_ Yesterday Energy | 4 byte | DPT_ActiveEnergy | 13.010 | R | | T | Energy consumed yesterday (Wh) |
| | 110 | Status_ Total Energy | 4 byte | DPT_ActiveEnergy | 13.010 | R | | T | Total energy consumed since last reset (Wh) |
| Date | 111 | Status_ Today | 3 byte | DPT_Date | 11.001 | R | | T | Today's date |
| Locking | 112 | Status_Lock Remote Control | 1 bit | DPT_Bool | 1.002 | R | | T | 0 - Unlocked; 1 - Locked |
| | 113 | Status_ Lock Control Objects | 1 bit | DPT_Bool | 1.002 | R | | T | 0 - Unlocked; 1 - Locked |
| Special Modes | 114 | Status_ Power Mode | 1 bit | DPT_Switch | 1.001 | R | | T | 0 - Off; 1-On |
| | 115 | Status_ Econo Mode | 1 bit | DPT_Switch | 1.001 | R | | T | 0 - Off; 1-On |
| | 116 | Status_ Additional Heat | 1 bit | DPT_Switch | 1.001 | R | | T | 0 - Off; 1-On |
| | 117 | Status_ Additional Cool | 1 bit | DPT_Switch | 1.001 | R | | T | 0 - Off; 1-On |
| Counter | 118 | Status_ Operation Hour Counter | 2 byte | DPT_Value_2_Ucount | 7.001 | R | | T | Number of operating hours |
| Scene | 119 | Status_ Current Scene | 1 byte | DPT_SceneNumber | 17.001 | R | | T | 0 to 4 - Scene 1 to 5; 63 - No Scene |
| Binary Inputs | 120 | Status_ Inx - Switching | 1 bit | DPT_Switch | 1.001 | R | | T | 0 - Off; 1-On |

| | | | | | | | | | |
|--|--------------------------|--------------------------------|--------|--------------------|--------|---|--|---|----------------------------|
| | 122 | Status_Inx – Dimming - On/Off | 1 bit | DPT_Switch | 1.001 | R | | T | 0 - Off; 1 - On |
| | 124 | Status_Inx – Shut/Blind - Step | 1 bit | DPT_Step | 1.007 | R | | T | 0 – Step Up; 1 – Step Down |
| | 126 | Status_Inx – Value | 1 byte | DPT_Value_1_Ucount | 5.010 | R | | T | 1 byte unsigned value |
| | | Status_Inx – Value | 2 byte | DPT_Value_2_Ucount | 7.001 | R | | T | 2 byte unsigned value |
| | | Status_Inx – Value | 2 byte | DPT_Value_2_Count | 8.001 | R | | T | 2 byte signed value |
| | | Status_Inx – Value | 2 byte | DPT_Value_Temp | 9.001 | R | | T | Temperature °C |
| | | Status_Inx – Value | 4 byte | DPT_Value_4_Ucount | 12.001 | R | | T | 4 byte unsigned value |
| | 121 | Status_Inx – Dimming – Step(%) | 1 bit | DPT_Control_Dimm. | 3.007 | R | | T | Dimming step |
| | 123 | Status_Inx - Shut/Blind -Move | 1 bit | DPT_UpDown | 1.008 | R | | T | 0 – Move Up; 1 – Move Down |
| | 125 127 | | | | | | | | |

Mouser Electronics

Authorized Distributor

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

[HMS Networks:](#)

[INKNXPAN001I000](#)