

## CMOS Programmable Ionization Smoke Detector ASIC with Interconnect, Timer Mode and Alarm Memory

### Features

- 6-12V Operation
- Low Quiescent Current Consumption
- Programmable Standby Sensitivity
- Programmable HUSH Sensitivity
- Programmable Hysteresis
- Programmable Chamber Voltage for Push-to-Test (PTT) and Chamber Test
- Programmable  $\pm 150$  mV Low-Battery Set Point
- Internal Ionization Chamber Test
- Programmable Low Battery Test Duration
- Internal Power-on Reset (POR) and Power-Up Low Battery Test
- Alarm Memory
- IO Filter and Charge Dump
- Interconnect Up to 40 Detectors
- $\pm 5\%$  All Internal Oscillator
- 9-Minute Timer for Sensitivity Control
- Temporal Horn Pattern
- Guard Outputs for Ion Detector Input
- $\pm 0.75$  pA Detect Input Current
- 10-year End of Life Indication
- Chamber Monitor Warning

### Description

The RE46C182 is a next generation low-power, CMOS ionization-type, smoke detector IC. With minimal external components, this circuit will provide all the required features for an ionization-type smoke detector.

An on-chip oscillator strobes power to the smoke detection circuitry for 5 ms every 10s to keep the standby current to a minimum.


A check for a low battery condition is performed every 80s and an ionization chamber test is performed once every 320s when in Standby mode. The temporal horn pattern complies with the National Fire Protection Association NFPA 72® National Fire Alarm and Signaling Code® for emergency evacuation signals.

An interconnect pin allows multiple detectors to be connected, such that when one unit alarms, all units will sound. A charge dump feature quickly discharges the interconnect line when exiting a Local Alarm condition. The interconnect input is also digitally filtered.


An internal 9-minute timer can be used for a Reduced Sensitivity mode.

An alarm memory feature allows the user to determine whether the unit has previously entered a Local Alarm condition.


### Package Type

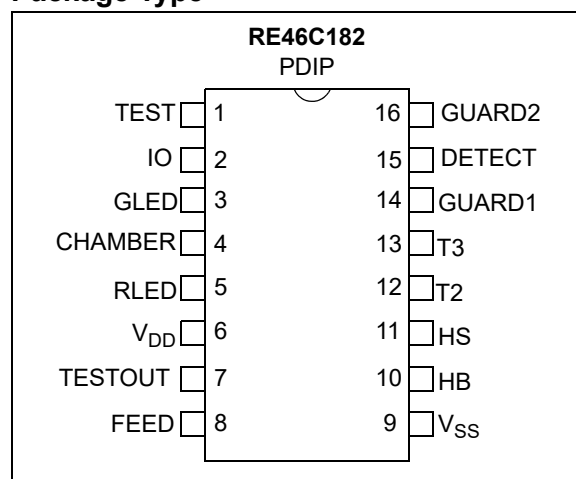

Functional Block Diagram

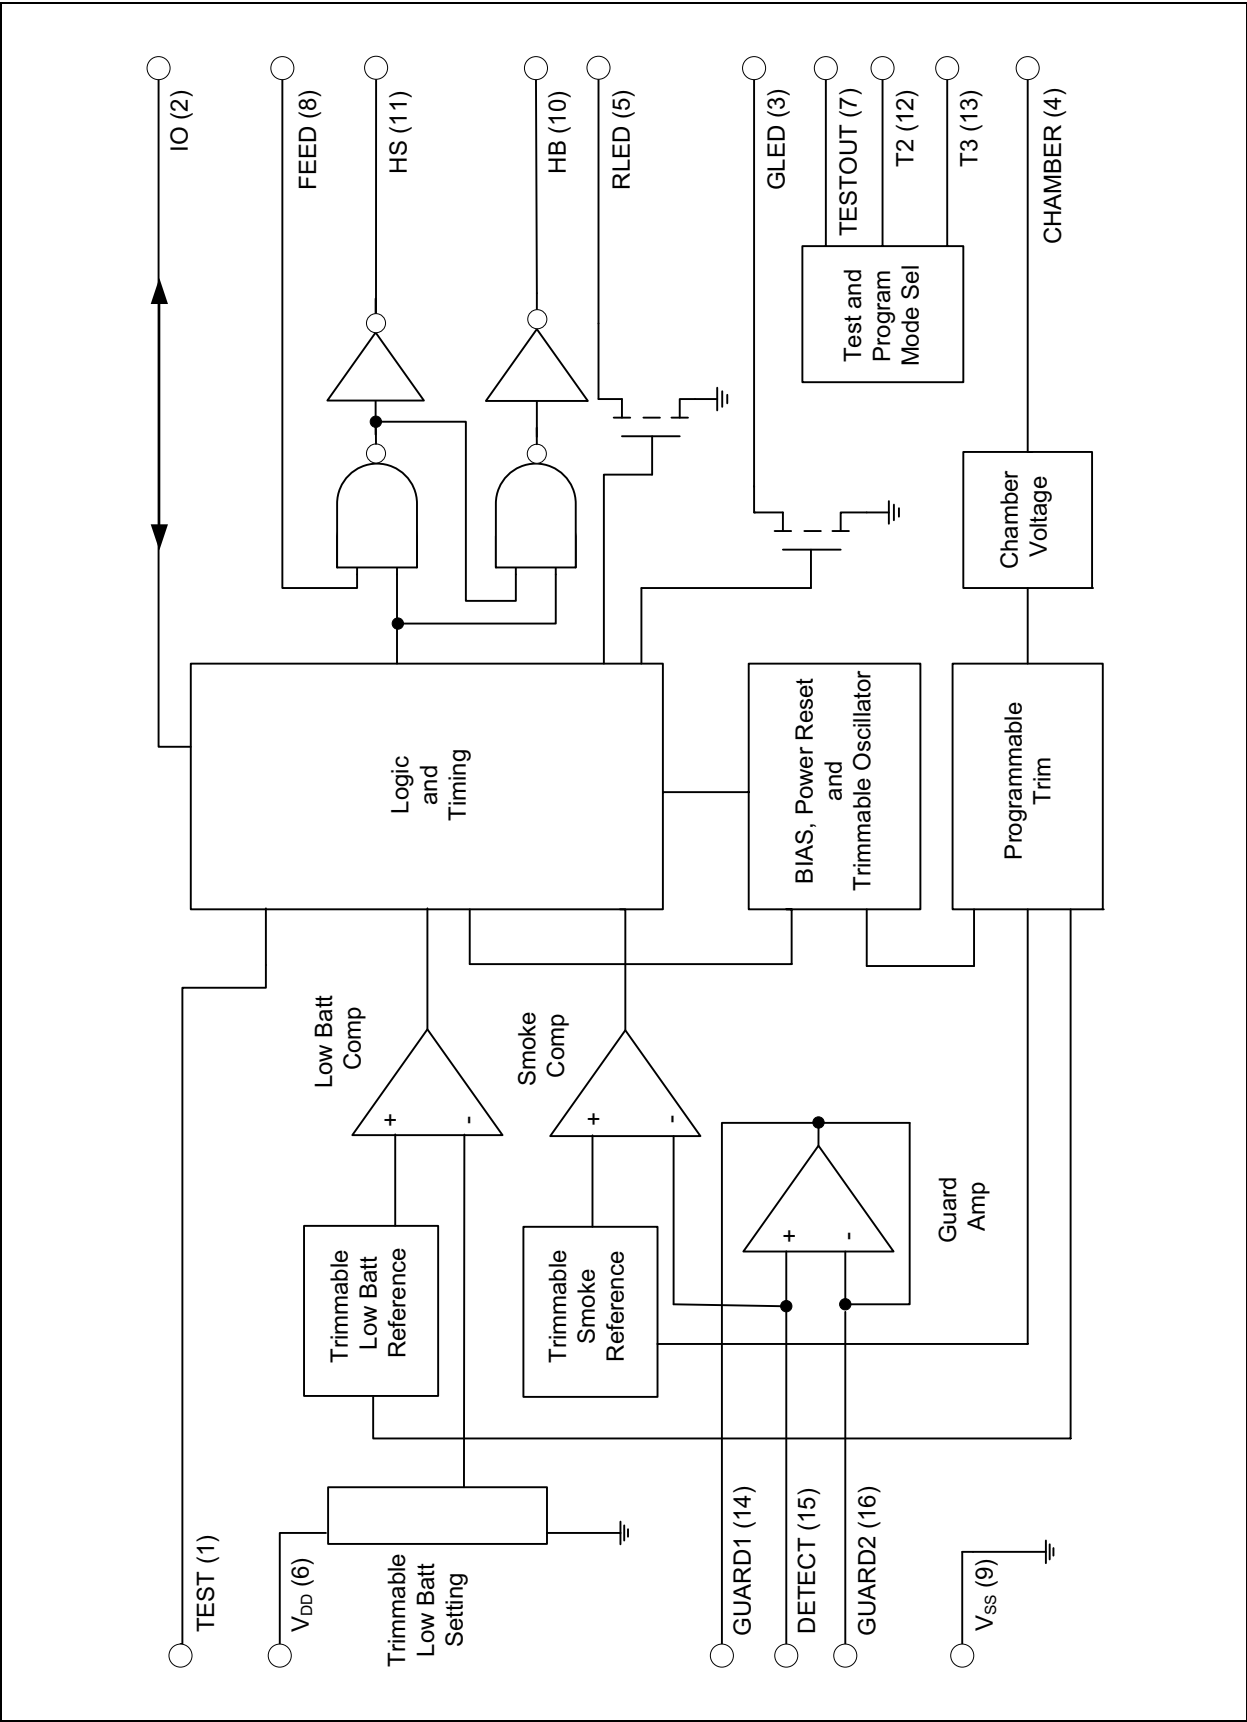

## Typical Application

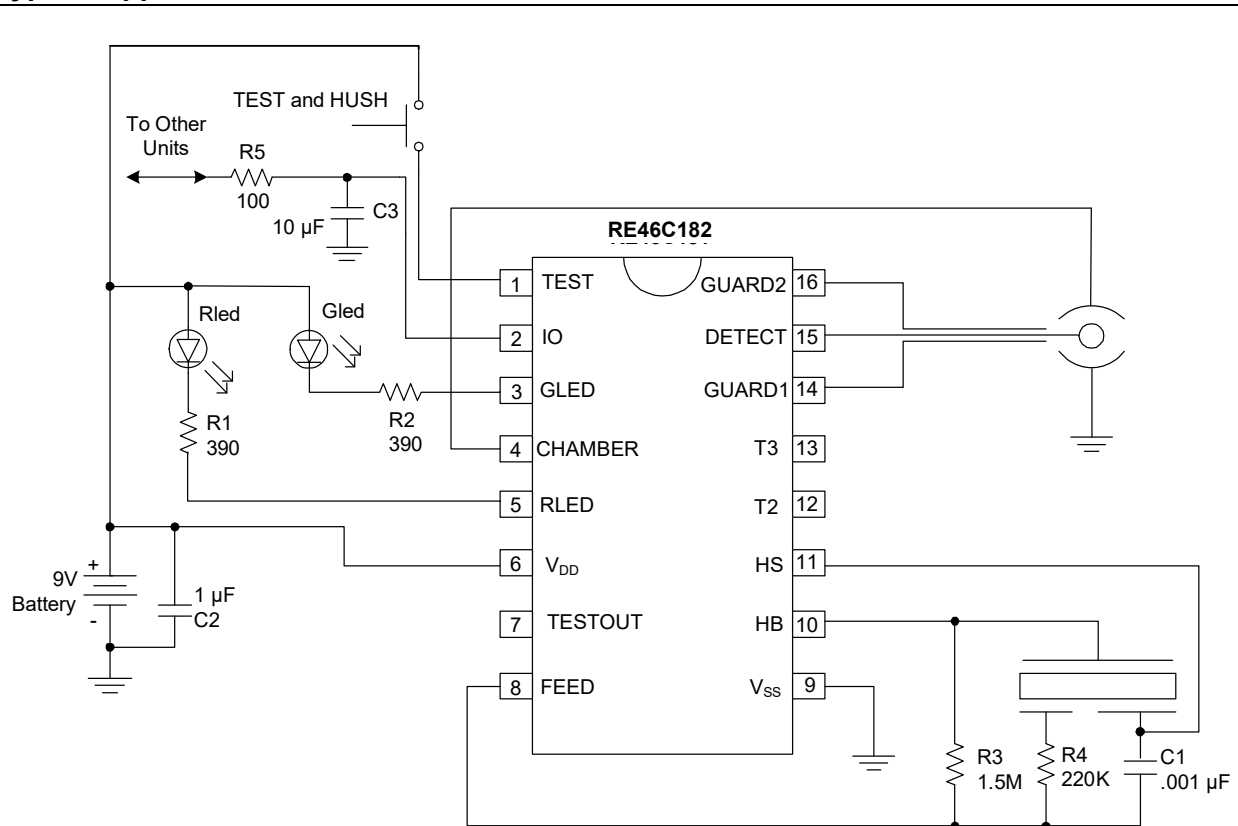

- Note 1:** R3, R4 and C1 are typical values and may be adjusted to maximize sound pressure.
- 2:** C2 should be located as close as possible to the device power pins.
- 3:** Route the pin 8 PC board trace away from pin 4 to avoid coupling.
- 4:** No internal reverse battery protection. External reverse battery protection circuitry required.

# RE46C182

---

NOTES:

## 1.0 ELECTRICAL CHARACTERISTICS

### 1.1 Absolute Maximum Ratings†

Supply Voltage .....	$V_{DD} = 12.5V$
Input Voltage Range Except FEED, IO .....	$V_{IN} = -0.3V$ to $V_{DD} + 0.3V$
FEED Input Voltage Range .....	$V_{INFD} = -10$ to $+22V$
IO Input Voltage Range .....	$V_{IO1} = -0.3$ to $15V$
Input Current Except FEED .....	$I_{IN} = 10$ mA
Storage Temperature .....	$T_{STG} = -55$ to $+125^{\circ}C$
Maximum Junction Temperature .....	$T_J = +150^{\circ}$

† **Notice:** Stresses above those listed under “Absolute Maximum Ratings” may cause permanent damage to the device. This is a stress rating only and functional operation of the device at these or any other conditions above those indicated in the operation listings of this specification is not implied. Exposure to maximum rating conditions for extended periods may affect device reliability.

## DC ELECTRICAL CHARACTERISTICS

**DC Electrical Characteristics:** Unless otherwise indicated, all parameters apply at  $T_A = -10^{\circ}C$  to  $+60^{\circ}C$ ,  $V_{DD} = 9V$ ,  $V_{SS} = 0V$  ([Note 1](#))

Parameters	Symbol	Test Pin	Min.	Typ.	Max.	Units	Conditions
Supply Voltage	$V_{DD}$	6	6	—	12	V	Operating
Supply Current	$I_{DD1}$	6	—	3.8	5.3	$\mu A$	Operating, RLED off, GLED off
	$I_{DD2}$	6	—	—	6	$\mu A$	Operating, $V_{DD} = 12V$ , RLED off, GLED off
	$I_{DD3}$	6	—	9.6	13.9	$\mu A$	Operating, RLED off, GLED off, smoke check
	$I_{DD4}$	6	—	21.4	30	$\mu A$	Operating, RLED off, GLED off, low battery check
Input Voltage High	$V_{IH1}$	8	6	—	—	V	
	$V_{IH2}$	2	3	—	—	V	No local alarm, IO as an input
	$V_{IH3}$	1	5.6	—	—	V	
	$V_{IH4}$	12	5.6	—	—	V	
Input Voltage Low	$V_{IL1}$	8	—	—	2.8	V	
	$V_{IL2}$	2	—	—	1	V	No local alarm, IO as an input
	$V_{IL3}$	1	—	—	3.4	V	
	$V_{IL4}$	12	—	—	3.4	V	
Input Leakage Low	$IL_{DET1}$	15	—	—	-0.75	pA	$V_{DD} = 9V$ , DETECT = $V_{SS}$ , 0-40% RH, $T_A = +25^{\circ}C$
	$IL_{DET2}$	15	—	—	-1.5	pA	$V_{DD} = 9V$ , DETECT = $V_{SS}$ , 85% RH, $T_A = +25^{\circ}C$ ( <a href="#">Note 2</a> )
	$IL_{FD1}$	8	—	—	-50	$\mu A$	FEED = -10V
	$IL_{FD2}$	8	—	—	-100	nA	FEED = $V_{SS}$

**Note 1:** Production tested at room temperature with temperature guard banded limits.

**2:** Sample test only.

**3:** Not 100% production tested.

**4:** Same limit range at each programmable step, see [Table 4-1](#).

## DC ELECTRICAL CHARACTERISTICS (CONTINUED)

DC Electrical Characteristics: Unless otherwise indicated, all parameters apply at $T_A = -10^{\circ}\text{C}$ to $+60^{\circ}\text{C}$ , $V_{DD} = 9\text{V}$ , $V_{SS} = 0\text{V}$ (Note 1)							
Parameters	Symbol	Test Pin	Min.	Typ.	Max.	Units	Conditions
Input Leakage High	$I_{H_{DET1}}$	15	—	—	0.75	pA	$V_{DD} = 9\text{V}$ , $\text{DETECT} = V_{DD}$ , 0-40% RH, $T_A = +25^{\circ}\text{C}$
	$I_{H_{DET2}}$	15	—	—	1.5	pA	$V_{DD} = 9\text{V}$ , $\text{DETECT} = V_{DD}$ , 85% RH, $T_A = +25^{\circ}\text{C}$ (Note 2)
	$I_{H_{FD1}}$	8	—	—	50	$\mu\text{A}$	FEED = 22V
	$I_{H_{FD2}}$	8	—	—	100	nA	FEED = $V_{DD}$
	$I_{IOL2}$	2	—	—	150	$\mu\text{A}$	No Alarm, $V_{IO} = 15\text{V}$
Output Off Leakage High	$I_{IOHZ}$	3, 5	—	—	1	$\mu\text{A}$	Outputs off, $V_{RLED} = 9\text{V}$ , $V_{GLED} = 9\text{V}$
Input Pull-Down Current	$I_{PD1}$	1	20	50	80	$\mu\text{A}$	TEST = 9V
	$I_{PD2}$	12	0.4	0.8	1.3	mA	T2 = 9V
Output High Voltage	$V_{OH1}$	10, 11	6.3	—	—	V	$I_{OH} = -16\text{ mA}$ , $V_{DD} = 7.2\text{V}$
Output Low Voltage	$V_{OL1}$	10, 11	—	—	0.9	V	$I_{OL} = 16\text{ mA}$ , $V_{DD} = 7.2\text{V}$
	$V_{OL3}$	3, 5	—	—	1	V	$I_{OL} = 10\text{ mA}$ , $V_{DD} = 7.2\text{V}$
Output Current	$I_{IOL1}$	2	25	—	60	$\mu\text{A}$	No alarm, $V_{IO} = V_{DD} - 2\text{V}$
	$I_{IOH1}$	2	-4	—	-16	mA	Alarm, $V_{IO} = 4\text{V}$ or $V_{IO} = 0\text{V}$
	$I_{IODMP}$	2	5	—	—	mA	At conclusion of local alarm or PTT, $V_{IO} = 1\text{V}$
Low-Battery Voltage	$V_{LB}$	6	6.75	6.9	7.05	V	LBTR[2:1] = 10
			7.05	7.2	7.35	V	LBTR[2:1] = 11
			7.35	7.5	7.65	V	LBTR[2:1] = 00
			7.65	7.8	7.95	V	LBTR[2:1] = 01
Offset Voltage	$V_{GOS1}$	14, 15	-50	—	50	mV	Guard amplifier
	$V_{GOS2}$	15, 16	-50	—	50	mV	Guard amplifier
	$V_{GOS3}$	15	-50	—	50	mV	Smoke comparator
Common-Mode Voltage	$V_{CM1}$	14, 15	2	—	$V_{DD} - 0.5$	V	Guard amplifier (Note 3)
	$V_{CM2}$	15	0.5	—	$V_{DD} - 2$	V	Smoke comparator (Note 3)
Output Impedance	$Z_{OUT}$	14, 16	—	10	—	$\text{k}\Omega$	Guard amplifier outputs (Note 3)
Chamber Voltage in PTT/Chamber Test	$V_{CHAMBER}$	4	4.49	4.5	4.51	V	User programmable (2.1V to 6.75V) (Note 4)
Hysteresis	$V_{HYS}$	13	140	150	160	mV	No alarm to alarm condition, user programmable (50 to 225 mV) (Note 4)

**Note 1:** Production tested at room temperature with temperature guard banded limits.

**2:** Sample test only.

**3:** Not 100% production tested.

**4:** Same limit range at each programmable step, see Table 4-1.

## AC ELECTRICAL CHARACTERISTICS

AC Electrical Characteristics: Unless otherwise indicated, all parameters apply at T <sub>A</sub> = -10°C to +60°C, V <sub>DD</sub> = 9V, V <sub>SS</sub> = 0V.							
Parameters	Symbol	Test Pin	Min.	Typ.	Max.	Units	Conditions
Time Base							
Internal Oscillator Period	T <sub>POSC</sub>	7	593	625	657	μs	Test mode (Note 1)
Internal Clock Period	T <sub>PCLK</sub>	—	9.5	10	10.5	ms	Operating
RLED Indicator							
On Time	T <sub>ON1</sub>	5	9.5	10	10.5	ms	Operating, LBSEL = 0
	T <sub>ON2</sub>	5	2.37	2.5	2.63	ms	Operating, LBSEL = 1 (Low battery test only)
Period	T <sub>PLED1</sub>	5	304	320	336	s	Standby
	T <sub>PLED2</sub>	5	0.95	1	1.05	s	Local alarm
	T <sub>PLED3</sub>	5	9.5	10	10.5	s	HUSH mode, no local alarm
GLED Indicator							
Period	T <sub>PLED4</sub>	3	38	40	42	s	Alarm memory indication GLED period, no alarm, No PTT
	T <sub>PLED5</sub>	3	475	500	525	ms	Alarm memory indication GLED period upon PTT, AMLEDEn = 1
Off Time	T <sub>OFLED1</sub>	3	712	750	788	ms	Alarm memory indication GLED off time between pulses
	T <sub>OFLED2</sub>	3	36	38	40	s	Alarm memory indication GLED off time between pulse trains (3x)
On Time	T <sub>ONLED1</sub>	3	237	250	263	ms	Alarm memory indication GLED on time
Alarm Memory Indication Time-out Period	T <sub>AMTO</sub>	3	22.8	24	25.2	h	AMTO[2:1] = 00
			45.6	48	50.4	h	AMTO[2:1] = 01
			0	0	0	h	AMTO[2:1] = 10, No alarm memory indication
			—	—	—	—	AMTO[2:1] = 11, Alarm memory indication never times out, as long as the alarm memory latch is set
Smoke Check							
Smoke Check Time	T <sub>SCT</sub>	—	4.7	5	5.3	ms	Operating

**Note 1:**  $T_{\text{POSC}}$  is 100% production tested. All other timing is verified by functional testing.

**2:** See the timing diagram for smoke alarm temporal pattern.

## AC ELECTRICAL CHARACTERISTICS (CONTINUED)

AC Electrical Characteristics: Unless otherwise indicated, all parameters apply at $T_A = -10^{\circ}\text{C}$ to $+60^{\circ}\text{C}$ , $V_{DD} = 9\text{V}$ , $V_{SS} = 0\text{V}$ .							
Parameters	Symbol	Test Pin	Min.	Typ.	Max.	Units	Conditions
Smoke Check Period	$T_{PER0}$	—	9.5	10	10.5	s	Standby, no alarm
	$T_{PER1}$	—	0.95	1	1.05	s	Standby, after one valid smoke sample and before entering local alarm, no PTT
	$T_{PER2}$	—	237	250	263	ms	Standby, upon start of PTT and before entering local alarm
	$T_{PER3}$	—	0.95	1	1.05	s	Local alarm (after three consecutive valid smoke samples) or remote alarm
Chamber Test Period	$T_{PCT1}$	—	304	320	336	s	Operating
<b>Low Battery</b>							
Low-Battery Check Period	$T_{PLB1}$	—	76	80	84	s	Standby, no alarm, no low battery
	$T_{PLB2}$	—	304	320	336	s	Standby, no alarm, low battery
<b>Horn Operation</b>							
Horn Delay	$T_{HDLY1}$	10, 11	475	500	525	ms	From local alarm to horn active, temporal horn pattern
Horn Period	$T_{HPER1}$	10, 11	38	40	42	s	Low battery, no alarm
	$T_{HPER2}$	10, 11	38	40	42	s	Chamber failure, no alarm
	$T_{HPER3}$	10, 11	237	250	263	ms	Alarm memory indication upon PTT, AMHCEn = 1
Horn On Time	$T_{HON1}$	10, 11	9.5	10	10.5	ms	1. Low battery 2. Chamber failure 3. Alarm memory indication upon PTT, AMHCEn = 1 4. EOL
	$T_{HON2}$	10, 11	475	500	525	ms	Smoke alarm, temporal horn pattern (Note 2)
Horn Off Time	$T_{HOF1}$	10, 11	475	500	525	ms	Smoke alarm, temporal horn pattern (Note 2)
	$T_{HOF2}$	10, 11	1.43	1.5	1.58	s	Smoke alarm, temporal horn pattern (Note 2)
	$T_{HOF3}$	10, 11	36	38	40	ms	EOL horn off time between pulse trains (5x)
	$T_{HOF4}$	10, 11	37	39	41	s	Chamber fail horn off time between pulse trains (3x)
	$T_{HOF5}$	10, 11	465	490	515	ms	Chamber fail/EOL horn off time between pulses

**Note 1:**  $T_{POSC}$  is 100% production tested. All other timing is verified by functional testing.

**2:** See the timing diagram for smoke alarm temporal pattern.



**AC ELECTRICAL CHARACTERISTICS (CONTINUED)**

**AC Electrical Characteristics:** Unless otherwise indicated, all parameters apply at  $T_A = -10^{\circ}\text{C}$  to  $+60^{\circ}\text{C}$ ,  $V_{DD} = 9\text{V}$ ,  $V_{SS} = 0\text{V}$ .

Parameters	Symbol	Test Pin	Min.	Typ.	Max.	Units	Conditions
<b>Interconnect</b>							
IO Active Delay	$T_{IODLY1A}$	2	2.8	3.0	3.2	s	From start of local alarm to IO active
	$T_{IODLY1B}$	2	0	—	3.2	s	From start of PTT alarm to IO active
Remote Smoke Alarm Delay	$T_{IODLY2}$	2	769	810	851	ms	No local alarm, from IO active to alarm, temporal horn pattern
IO Filter for Remote Smoke Alarm	$T_{IOFILT}$	2	—	—	291	ms	IO pulse width to be filtered IO as input, no local alarm
IO Charge Dump Duration	$T_{IODMP1}$	2	1.9	2.0	2.1	s	At conclusion of local alarm or PTT alarm
<b>Chamber Monitor</b>							
CM Sample Period	$T_{PCM1}$	—	—	5120	—	s	Standby; no alarms

**Note 1:**  $T_{POSC}$  is 100% production tested. All other timing is verified by functional testing.

**2:** See the timing diagram for smoke alarm temporal pattern.

# RE46C182

## AC ELECTRICAL CHARACTERISTICS (CONTINUED)

<b>AC Electrical Characteristics:</b> Unless otherwise indicated, all parameters apply at $T_A = -10^{\circ}\text{C}$ to $+60^{\circ}\text{C}$ , $V_{DD} = 9\text{V}$ , $V_{SS} = 0\text{V}$ .							
Parameters	Symbol	Test Pin	Min.	Typ.	Max.	Units	Conditions
<b>HUSH Timer Operation</b>							
HUSH Timer Period	$T_{\text{TPER}}$	—	8.5	9	9.5	min	No alarm
<b>EOL</b>							
End of Life Age Sample	$T_{\text{EOL}}$	—	346	364	382	h	Standby, EOLEn = 1

**Note 1:**  $T_{\text{POSC}}$  is 100% production tested. All other timing is verified by functional testing.

**2:** See the timing diagram for smoke alarm temporal pattern.

## TEMPERATURE CHARACTERISTICS

<b>Electrical Specifications:</b> Unless otherwise indicated, V <sub>DD</sub> = 9V, V <sub>SS</sub> = 0V						
Parameter	Symbols	Min.	Typ.	Max.	Units	Conditions
<b>Temperature Ranges</b>						
Operating Temperature Range	T <sub>A</sub>	-10	—	+60	°C	
Storage Temperature Range	T <sub>STG</sub>	-55	—	+125	°C	
<b>Thermal Package Resistances</b>						
Thermal Resistance, 16L-PDIP	θ <sub>JA</sub>	—	70	—	°C/W	

NOTES:

# RE46C182

## 2.0 PIN DESCRIPTIONS

The descriptions of the pins are listed in [Table 2-1](#).

**TABLE 2-1: PIN FUNCTION TABLE**

RE46C182 PDIP	Symbol	Function
1	TEST	This input is used to invoke Push-to-Test, Timer mode and Alarm Memory indication. This input has an internal pull-down.
2	IO	This bidirectional pin provides the capability to interconnect many detectors in a single system. This pin has an internal pull-down device and a charge dump device.
3	GLED	Open drain NMOS output, used to drive a visible LED to provide visual indication of an Alarm Memory condition.
4	CHAMBER	Connect to the ionization smoke chamber. This pin provides power to the chamber.
5	RLED	Open-drain NMOS output, used to drive a visible LED. This pin provides the load current for the low battery test and is a visual indicator for Alarm and HUSH mode.
6	V <sub>DD</sub>	Connect to the positive supply voltage.
7	TESTOUT	This output is an indicator of the internal IO dump signal. This pin is also used for Test modes.
8	FEED	Usually connected to the feedback electrode through a current limiting resistor. If not used, this pin must be connected to V <sub>DD</sub> or V <sub>SS</sub> .
9	V <sub>SS</sub>	Connect to the negative supply voltage.
10	HB	This pin is connected to the metal electrode of a piezoelectric transducer.
11	HS	This pin is a complementary output to HB, connected to the ceramic electrode of the piezoelectric transducer.
12	T2	Test input to invoke Test modes. This pin has an internal pull-down.
13	T3	Test output for Test modes.
14	GUARD1	Output of the guard amplifier. This allows for measurement of the DETECT input without loading the ionization chamber.
15	DETECT	Connect to the CEV of the ionization smoke chamber.
16	GUARD2	Output of the guard amplifier. This allows for measurement of the DETECT input without loading the ionization chamber.

## 3.0 DEVICE DESCRIPTION

### 3.1 Standby Internal Timing

The internal oscillator is manufactured to  $\pm 5\%$  tolerance. The oscillator period,  $T_{\text{POSC}}$ , is 625  $\mu\text{s}$ . The internal clock period,  $\text{TPCLK}$ , of 10 ms, is derived from the internal oscillator period.

In Standby, once every 10s, the smoke detection circuitry is powered on for 5 ms. At the conclusion of the 5 ms, the status of the smoke comparator is latched. If a Smoke condition is present, the period to the next detection decreases and additional checks are made.

In Standby, once every 80s, the low battery detection circuitry is powered on for 2.5 or 10 ms. At the conclusion of the 2.5 or 10 ms, the status of the low battery comparator is latched. RLED is enabled for 2.5 or 10 ms every 320s to provide a battery load in the loaded battery test.

In Standby, once every 320s, the chamber test circuitry is powered on for 5 ms. At the conclusion of the 5 ms, the status of the chamber test is latched. See [Section 3.3, Supervisory Tests](#) for details.

### 3.2 Smoke Detection Circuitry

The collection electrode voltage (CEV) of the ionization chamber is compared to the stored reference voltage at the conclusion of the 5 ms smoke sample period. After the first Smoke condition is detected, the smoke detection rate increases to once every 1s. Three consecutive smoke detections will cause the device to go into local alarm, and the horn circuit and IO will be active. RLED will turn on for 10 ms at 1 Hz rate.

In local alarm, the smoke reference voltage (smoke sensitivity) is internally increased to provide alarm hysteresis.

There are three separate smoke sensitivity settings (all user-programmable):

- Standby sensitivity
- Local Alarm (hysteresis) sensitivity
- HUSH sensitivity

During PTT, the standby smoke sensitivity is used in smoke detection; but the chamber voltage is user-programmable.

The guard amplifier and outputs are always active, and will be within 50 mV of the DETECT input to reduce surface leakage. The guard outputs also allow for measurement of the DETECT input without loading the ionization chamber.

### 3.3 Supervisory Tests

Once every 80s, the status of the battery voltage is checked by comparing a fraction of the  $V_{\text{DD}}$  voltage to an internal reference. In each period of 320s the battery is checked four times. Of these four battery checks, three are unloaded and one is loaded with RLED enabled, which provides a battery load. Low battery status is latched at the end of the 10 ms RLED pulse.

If the low battery test fails, the horn will chirp for 10 ms every 40s, and will continue to chirp until the next loaded low battery check is passed. The unloaded low battery checks are skipped in Low Battery condition.

As a user-programmable option, a Low Battery HUSH mode can be selected. If a Low Battery condition exists, upon release of PTT, the unit will enter the Low Battery HUSH mode, and the 10 ms horn chirp will be silenced for 8 hours. At the end of the 8 hours, the audible indication will resume if the Low Battery condition still exists.

In addition, every 320s, a background chamber test is performed by internally lowering the chamber voltage to a predetermined level (user-programmable) for 3.7s. This will emulate a Smoke condition. At the end of this 3.7s period, the smoke detection circuitry is powered on for 5 ms, and the Smoke condition is detected.

If two consecutive chamber tests fail to detect a simulated Smoke condition, the chamber fail latch is set and the failure warning is generated. The horn will chirp three times every 40s. Each chirp is 10 ms long and three chirps are spaced at a 0.5s interval. The chamber fail warning chirp is separated from the low battery warning chirp by about 20s.

The horn will continue this pattern until the chamber fail latch is reset. The chamber fail latch resets when any one of the followings is active:

- Two consecutive chamber tests pass
- Local smoke alarm
- PTT smoke alarm

After the chamber test is completed, the chamber voltage goes back to its normal standby level.

The chamber test is performed approximately 140s after the loaded Low Battery test.

In a Local Alarm, PTT Alarm or Remote Alarm condition, the chamber test is not performed and the low battery chirping is prohibited.

## 3.4 Push-to-Test (PTT)

Push-to-Test (PTT) is an event when TEST is activated ( $V_{IH3}$ ). Release of PTT is an event when TEST is deactivated ( $V_{IL3}$ ). PTT has different functions for different circumstances. In Standby, PTT tests the unit. Upon start of PTT, the chamber voltage is lowered to a predetermined level (user-programmable) to emulate a Smoke condition. The smoke detection rate increases to once every 250 ms. After three consecutive smoke detections, the unit will go into a Local Alarm condition. In alarm, the smoke detection rate decreases to once every 1s. Upon release of PTT, the unit is immediately reset out of local alarm, and the horn is silenced. The chamber voltage goes back to the normal standby level and the detection rate goes back to once every 10s.

When the unit exits a Local Alarm condition, the alarm memory latch is set. PTT activates the alarm memory indication if the alarm memory latch is set and if the alarm memory indication function has been enabled. If the alarm memory indication function has not been enabled and the alarm memory latch is set, PTT tests the unit as described above. The release of PTT will always reset the alarm memory latch.

In Standby and Low Battery conditions, PTT tests the unit and RLED will be constantly enabled. This allows the user to easily identify the low battery unit without waiting for 40s to hear a horn chirp. Upon release of PTT, RLED goes back to the normal standby pulse rate. The Low Battery HUSH mode is then activated, if this function is enabled.

## 3.5 Interconnect Operation

The bidirectional IO pin allows the interconnection of multiple detectors. In a Local Alarm condition, this pin is driven high 3.0s after a Local Alarm condition is sensed through a constant current source. Shorting this output to ground will not cause excessive current. The IO is ignored as input during a local alarm.

The IO also has an NMOS discharge device that is active for 2s after the conclusion of any type of local alarm. This device helps to quickly discharge any capacitance associated with the interconnect line.

If a remote active high signal is detected, the device goes into Remote Alarm and the horn will be active. RLED will be off, indicating a Remote Alarm condition. Internal protection circuitry allows the signaling unit to have higher supply voltage than the signaled unit, without excessive current draw.

The interconnect input has a 291 ms maximum digital filter. This allows for interconnection to other types of alarms (CO, for example) that may have a pulsed interconnect signal.

## 3.6 Reduced Sensitivity Mode (HUSH Mode)

Upon release of PTT, the unit may or may not go into a HUSH mode, depending on the user's selection.

If the Hush-In-Alarm-only option is selected, then only the release of PTT in a Local Alarm condition can initiate a HUSH mode. Upon release of PTT, the unit is immediately reset out of alarm and the horn is silenced.

If the Hush-In-Alarm-only option is not selected, then anytime a release of PTT occurs, the HUSH mode is initiated.

In HUSH mode, the smoke sensitivity is lowered to a predetermined level, which is user-programmable. RLED is turned on for 10 ms every 10s.

After this period times out, the unit goes back to its standby sensitivity.

If the unit is currently in a HUSH mode, then PTT will test the unit with the standby sensitivity. Upon release of PTT, a new HUSH mode will be initiated.

As another user-programmable option, HUSH mode can be terminated earlier by a smart hush function. This function allows the HUSH mode to be canceled by either a high smoke alarm or a remote smoke alarm. High smoke alarm is the local smoke alarm caused by a smoke level that exceeds the reduced sensitivity level.

## 3.7 Alarm Memory

Alarm memory is a user-programmable option. If a unit has entered a local alarm, when exiting that local alarm, the alarm memory latch is set. The GLED can be used to visually identify any unit that had previously been in a Local Alarm condition. The GLED is pulsed on three times every 40s. Each GLED pulse is 250 ms long and 1s spaced from the next pulse. This alarm memory indication period can be 0, 24, 48 hours or no limit, depending on the user's selection.

The user will be able to identify a unit with an active alarm memory at any time before the Alarm Memory latch is reset. Upon start of PTT, the alarm memory indication will be activated. Depending on the user's selection, it can be 4 Hz horn chirp, 2 Hz GLED pulse, or both. Upon release of PTT, the alarm memory latch will be reset.

Depending on the user's programmed selection, the Alarm Memory latch can also be reset at the same time as the Alarm Memory Indication Period (24 or 48 hours). If 0 or no limit is selected as the Alarm Memory Indication Period, then the Alarm Memory latch will be reset only at PTT.

The initial visual GLED indication is not displayed if a Low Battery condition exists.

### 3.8 End of Life (EOL) Indicator

The End of Life (EOL) indicator is a user-programmable function. If the EOL indicator function is enabled, then approximately every 15 days of continuous operation,  $T_{EOL}$ , the circuit will read an age count stored in EEPROM, and will increment this age. After 10 years of operation, an audible indication will be given to signal that the unit should be replaced. The EOL indicator is five 10 ms horn chirps.

### 3.9 Tone Pattern

The temporal horn pattern supports the NFPA 72 National Fire Alarm and Signaling Code for emergency evacuation signals.

### 3.10 Chamber Monitor

The chamber monitor provides a means of monitoring chamber degradation. During calibration, based on the expected or measured clean air value CEV value and the sensitivity setting from [Table 4-2](#), a chamber monitor sensitivity value must be stored in the five CMTR EE bits. These bits represent an alternate sensitivity based on the voltages defined in [Table 4-2](#). During normal standby operation, the chamber will be sampled every 1.42 hours and compared to the CMTR value. If the measurement falls below this level ( $CEV < CM$  measurement for six successive measurements), a chamber failure warning will be signaled. At any time after this, if a single measurement exceeds this level, the warning will stop and will not start again until six more successive failures occur. The chamber monitor is suspended during HUSH, Local Smoke and Remote Smoke conditions and will reset if one of these events occurs.

If the chamber monitor function is not needed, the CMTR bits should all be set to 10,000.

## 4.0 USER PROGRAMMING MODES

Tables 4-1 to 4-6 show the parameters for user smoke calibration.

TABLE 4-1: PARAMETRIC PROGRAMMING

Parametric Programming	Range	Resolution
Standby Smoke Sensitivity ( $V_{STD}$ )	2.9 → 6.0V (Note 1)	100 mV (Note 1)
Hysteresis ( $V_{HYS}$ )	+50 → +225 mV (Note 2)	25 mV (Note 2)
HUSH Smoke Sensitivity ( $V_{HSH}$ )	-1600 mV → -100 mV (Note 3)	100 mV (Note 3)
CHAMBER Voltage at PTT/Chamber Test ( $V_{CHAMBER}$ )	2.10 → 6.75V (Note 4)	150 mV (Note 4)

**Note 1:**  $V_{STD}$  listed is based on  $V_{DD} = 9V$ . The actual range is  $(29/90)V_{DD} \rightarrow (60/90)V_{DD}$ , the resolution is  $V_{DD}/90$ .

**2:**  $V_{HYS}$  is a positive offset from  $V_{STD}$ . The listed value is based on  $V_{DD} = 9V$ . The actual range is  $+(0.5/90)V_{DD} \rightarrow +(2.25/90)V_{DD}$ , the resolution is  $(0.25/90)V_{DD}$ .

**3:**  $V_{HSH}$  is a negative offset from  $V_{STD}$ . The listed value is based on  $V_{DD} = 9V$ . The actual range is  $-(16/90)V_{DD} \rightarrow -(1/90)V_{DD}$ , the resolution is  $V_{DD}/90$ .

**4:** The  $V_{CHAMBER}$  listed value is based on  $V_{DD} = 9V$ . The actual range is  $(21/90)V_{DD} \rightarrow (67.5/90)V_{DD}$ , the resolution is  $(1.5/90)V_{DD}$ .



**TABLE 4-2: STANDBY SENSITIVITY ( $V_{STD}$ ) PROGRAMMING CONFIGURATION  
AT  $V_{DD} = 9V$**

$V_{STD}$ Register STTR [5:1] Configuration					Values
STTR5	STTR4	STTR3	STTR2	STTR1	$V_{STD}$
0	0	0	0	0	4.5V
0	0	0	0	1	4.6V
0	0	0	1	0	4.7V
0	0	0	1	1	4.8V
0	0	1	0	0	4.9V
0	0	1	0	1	5.0V
0	0	1	1	0	5.1V
0	0	1	1	1	5.2V
0	1	0	0	0	5.3V
0	1	0	0	1	5.4V
0	1	0	1	0	5.5V
0	1	0	1	1	5.6V
0	1	1	0	0	5.7V
0	1	1	0	1	5.8V
0	1	1	1	0	5.9V
0	1	1	1	1	6.0V
1	0	0	0	0	2.9V
1	0	0	0	1	3.0V
1	0	0	1	0	3.1V
1	0	0	1	1	3.2V
1	0	1	0	0	3.3V
1	0	1	0	1	3.4V
1	0	1	1	0	3.5V
1	0	1	1	1	3.6V
1	1	0	0	0	3.7V
1	1	0	0	1	3.8V
1	1	0	1	0	3.9V
1	1	0	1	1	4.0V
1	1	1	0	0	4.1V
1	1	1	0	1	4.2V
1	1	1	1	0	4.3V
1	1	1	1	1	4.4V

**TABLE 4-3: HYSTERESIS ( $V_{HYS}$ ) PROGRAMMING CONFIGURATION**  
AT  $V_{DD} = 9V$

$V_{HYS}$ Register HYTR[3:1] Configuration			Values
HYTR3	HYTR2	HYTR1	$V_{HYS}$
0	0	0	150 mV
0	0	1	175 mV
0	1	0	200 mV
0	1	1	225 mV
1	0	0	50 mV
1	0	1	75 mV
1	1	0	100 mV
1	1	1	125 mV

**TABLE 4-4: HUSH SENSITIVITY ( $V_{HSH}$ ) PROGRAMMING CONFIGURATION**  
AT  $V_{DD} = 9V$

$V_{HSH}$ Register TMTR[4:1] Configuration				Values
TMTR4	TMTR3	TMTR2	TMTR1	$V_{HSH}$
0	0	0	0	$V_{STD} - 800$ mV
0	0	0	1	$V_{STD} - 700$ mV
0	0	1	0	$V_{STD} - 600$ mV
0	0	1	1	$V_{STD} - 500$ mV
0	1	0	0	$V_{STD} - 400$ mV
0	1	0	1	$V_{STD} - 300$ mV
0	1	1	0	$V_{STD} - 200$ mV
0	1	1	1	$V_{STD} - 100$ mV
1	0	0	0	$V_{STD} - 1600$ mV
1	0	0	1	$V_{STD} - 1500$ mV
1	0	1	0	$V_{STD} - 1400$ mV
1	0	1	1	$V_{STD} - 1300$ mV
1	1	0	0	$V_{STD} - 1200$ mV
1	1	0	1	$V_{STD} - 1100$ mV
1	1	1	0	$V_{STD} - 1000$ mV
1	1	1	1	$V_{STD} - 900$ mV

**TABLE 4-5: CHAMBER VOLTAGE ( $V_{\text{CHAMBER}}$ ) PROGRAMMING CONFIGURATION  
AT  $V_{\text{DD}} = 9\text{V}$**

$V_{\text{CHAMBER}}$ Register PTTR[5:1] Configuration					Values
PTTR5	PTTR4	PTTR3	PTTR2	PTTR1	$V_{\text{CHAMBER}}$
0	0	0	0	0	4.50V
0	0	0	0	1	4.65V
0	0	0	1	0	4.80V
0	0	0	1	1	4.95V
0	0	1	0	0	5.10V
0	0	1	0	1	5.25V
0	0	1	1	0	5.40V
0	0	1	1	1	5.55V
0	1	0	0	0	5.70V
0	1	0	0	1	5.85V
0	1	0	1	0	6.00V
0	1	0	1	1	6.15V
0	1	1	0	0	6.30V
0	1	1	0	1	6.45V
0	1	1	1	0	6.60V
0	1	1	1	1	6.75V
1	0	0	0	0	2.10V
1	0	0	0	1	2.25V
1	0	0	1	0	2.40V
1	0	0	1	1	2.55V
1	0	1	0	0	2.70V
1	0	1	0	1	2.85V
1	0	1	1	0	3.00V
1	0	1	1	1	3.15V
1	1	0	0	0	3.30V
1	1	0	0	1	3.45V
1	1	0	1	0	3.60V
1	1	0	1	1	3.75V
1	1	1	0	0	3.90V
1	1	1	0	1	4.05V
1	1	1	1	0	4.20V
1	1	1	1	1	4.35V

**TABLE 4-6: FEATURES PROGRAMMING**

Features	Options
Low Battery Detection Selection	6.9V 7.2V 7.5V 7.8V
10 Year End of Life Indicator	Enable/Disable
Low Battery HUSH	Enable/Disable
Alarm Memory Indicator at PTT: Horn Chirping	Enable/Disable
Alarm Memory Indicator at PTT: GLED Flashing	Enable/Disable
Alarm Memory Indicator at Standby Time-Out Period	0/24/48h or no limit
Alarm Memory	Enable/Disable
Smart HUSH	Enable/Disable
HUSH-In-Alarm Only	Enable/Disable
HUSH	Enable/Disable
Low Battery Select	2.5 ms or 10 ms

## 4.1 Calibration and Programming Procedures

Sixteen separate Programming and Test modes are available for user customization. The T2 input is used to enter these modes and step through them. To enter these modes after power-up, T2 must be driven to  $V_{DD}$  and held at that level. To step through the modes, the TEST input must first be driven to  $V_{DD}$ . T2 is then clocked. TEST has to be high when clocking T2. Anytime T2 and TEST are both driven to low, the unit will come out of these modes and go back to the normal operation mode. FEED and IO are reconfigured to become Test mode inputs. A T2 clock occurs when it switches from  $V_{SS}$  to  $V_{DD}$ . The Test mode functions are outlined in the [Table 4-7](#).

**TABLE 4-7: TEST MODE FUNCTIONS**

Mode	Descriptions	T2 Clock	TEST	T2	FEED	IO	T3	TESTOUT
M0 <a href="#">Note 1</a>	Normal Operation	0	PTT/HUSH	0	FEED	IO	not used	IO Dump <a href="#">Note 2</a>
TM0	Horn Test/LED On; IO High/Low	1	HornEnB <a href="#">Note 3</a>	$V_{DD}$	IOHi En IO Dump EnB HB/HS En <a href="#">Note 4</a>	LEDEn	not used	not used
TM1	Load Timer for Spill	2	EOL Timer Clock	$V_{DD}$	HUSH/LB HUSH Timer Clock	Alarm Mem Timer Clock	not used	not used

- Note 1:** After power-up, the unit is in M0, the normal operation mode. When in M0, if T2 is driven to  $V_{DD}$ , the unit will enter TM0.
- 2:** In M0 and TM3, the digital output TESTOUT is driven by the internal IO dump signal.
- 3:** In TM0, if TEST =  $V_{SS}$ , the horn is turned on. IO is in weak pull-down; If TEST =  $V_{DD}$ , the horn is off. FEED controls IO and HB/HS.
- 4:** Valid when TEST =  $V_{DD}$ ;
- 5:** SmkCompOut – digital comparator output (high if DETECT <  $V_{SEN}$ ; low if DETECT >  $V_{SEN}$ ).
- 6:** LBCCompOut – digital comparator output (high if  $V_{DD}$  < LB trip point; low if  $V_{DD}$  > LB trip point).

TABLE 4-7: TEST MODE FUNCTIONS (CONTINUED)

Mode	Descriptions	T2 Clock	TEST	T2	FEED	IO	T3	TESTOUT
TM2	User Feature Programming	3	ProgData	V <sub>DD</sub>	ProgClk	ProgEn	not used	not used
TM3	Speedup Mode	4	PTT/HUSH	V <sub>DD</sub>	CLK	IO	not used	IO Dump <a href="#">Note 2</a>
TM4	Standby Sen Set	5	SmkCompEnB T3EnB	V <sub>DD</sub>	CalClk	ReadReg	V <sub>SEN</sub>	SmkCompOut <a href="#">Note 5</a>
TM5	Hyst Sen Set	6	SmkCompEnB T3EnB	V <sub>DD</sub>	CalClk	ReadReg	V <sub>SEN</sub>	SmkCompOut <a href="#">Note 5</a>
TM6	HUSH Sen Set	7	SmkCompEnB T3EnB	V <sub>DD</sub>	CalClk	ReadReg	V <sub>SEN</sub>	SmkCompOut <a href="#">Note 5</a>
TM7	PTT/Chamber Test Set	8	SmkCompEnB T3EnB	V <sub>DD</sub>	CalClk	ReadReg	V <sub>SEN</sub>	SmkCompOut <a href="#">Note 5</a>
TM8	Program Calibration	9	not used	V <sub>DD</sub>	not used	ProgEn	not used	not used
TM9	not used	10	—	—	—	—	—	—
TM10	Serial Read/Write Calibration	11	ProgData	V <sub>DD</sub>	ProgClk	ProgEn	not used	Serial Out
TM11	not used	12	—	—	—	—	—	—
TM12	Standby Sen Check	13	SmkCompEnB T3EnB	V <sub>DD</sub>	not used	not used	V <sub>SEN</sub>	SmkCompOut <a href="#">Note 5</a>
TM13	Hyst Sen Check	14	SmkCompEnB T3EnB	V <sub>DD</sub>	not used	not used	V <sub>SEN</sub>	SmkCompOut <a href="#">Note 5</a>
TM14	HUSH Sen Check	15	SmkCompEnB T3EnB	V <sub>DD</sub>	not used	not Used	V <sub>SEN</sub>	SmkCompOut <a href="#">Note 5</a>
TM15	PTT/Chamber Test CHAMBER Voltage Check	16	SmkCompEnB T3EnB	V <sub>DD</sub>	not used	not used	V <sub>SEN</sub>	SmkCompOut <a href="#">Note 5</a>
TM16	not used	17	—	—	—	—	—	—
TM17	LB Test	18	not used	V <sub>DD</sub>	not used	LB Test En RLED En	not used	LBCompOut <a href="#">Note 6</a>
TM18	Serial Read/Write Feature and Calibration	19	ProgData	V <sub>DD</sub>	ProgClk	ProgEn	not used	Serial Out
TM19	User EE Lock Bit	20	LockSetEn	V <sub>DD</sub>	Load EEPROM	ProgEn	not used	Lock Out

**Note 1:** After power-up, the unit is in M0, the normal operation mode. When in M0, if T2 is driven to V<sub>DD</sub>, the unit will enter TM0.

**2:** In M0 and TM3, the digital output TESTOUT is driven by the internal IO dump signal.


**3:** In TM0, if TEST = V<sub>SS</sub>, the horn is turned on. IO is in weak pull-down; If TEST = V<sub>DD</sub>, the horn is off. FEED controls IO and HB/HS.

**4:** Valid when TEST = V<sub>DD</sub>;

**5:** SmkCompOut – digital comparator output (high if DETECT < V<sub>SEN</sub>; low if DETECT > V<sub>SEN</sub>).

**6:** LBCompOut – digital comparator output (high if V<sub>DD</sub> < LB trip point; low if V<sub>DD</sub> > LB trip point).

---




A separate Calibration mode is entered for each Measurement mode (Normal, Hysteresis, HUSH and PTT/Chamber Test) so that independent limits can be set for each.

The detailed procedure is described in the following steps:

4. Apply four clock pulses to the T2 input ( $V_{DD}$  to  $V_{SS}$  and back to  $V_{DD}$ ) to enter TM4 mode. This initiates the Calibration mode for the normal sensitivity setting. Drive TEST from  $V_{DD}$  to  $V_{SS}$  to turn on the smoke comparator and enable the T3 switch. The standby smoke sensitivity  $V_{SEN}$  will appear at T3. The smoke comparator output will appear at TESTOUT. Clock FEED to increase or decrease the  $V_{SEN}$  levels as needed. The IO input is pulsed low-to-high to save the result.
5. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ . Apply another clock pulse to the T2 input to enter TM5 mode. This initiates the Calibration mode for the hysteresis setting. Drive TEST from  $V_{DD}$  to  $V_{SS}$  to turn on the smoke comparator and enable the T3 switch. The local alarm smoke sensitivity  $V_{SEN}$  will appear at T3. The smoke comparator output will appear at TESTOUT. Clock FEED to increase or decrease the  $V_{SEN}$  levels as needed. The IO input is pulsed low-to-high to save the result.

6. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ . Apply another clock pulse to the T2 input to enter TM6 mode. This initiates the Calibration mode for the HUSH sensitivity setting. Drive TEST from  $V_{DD}$  to  $V_{SS}$  to turn on the smoke comparator and enable the T3 switch. The HUSH smoke sensitivity  $V_{SEN}$  will appear at T3. The smoke comparator output will appear at TESTOUT. Clock FEED to increase or decrease the  $V_{SEN}$  levels as needed. The IO input is pulsed low-to-high to save the result
7. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ . Apply another clock pulse to the T2 input to enter TM7 mode. This initiates the Calibration mode for the CHAMBER voltage at PTT/ Chamber Test. Drive TEST from  $V_{DD}$  to  $V_{SS}$  to turn on the smoke comparator and enable the T3 switch. The standby smoke sensitivity  $V_{SEN}$  will appear at T3. The smoke comparator output will appear at TESTOUT. Clock FEED to increase or decrease the CHAMBER voltages as needed. The IO input is pulsed low-to-high to save the result.
8. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ . Apply another clock pulse to the T2 input to enter in TM8 mode. Pulse IO to save all results into memory. Before this step, no settings are stored into memory. Power down the part to take effect.





### 4.3 Serial Read/Write Calibration

As an alternative to the steps in [Section 4.2, Smoke Calibration](#), the sensitivity settings can be entered directly from a Serial Read/Write Calibration mode (if the system has been well characterized).

To enter this mode, follow these steps:

1. Power up with the bias condition shown in [Figure 4-1](#) to enter M0. At power-up:  
 $TEST = IO = FEED = T2 = V_{SS}$ ,  
 $DETECT = V_{DD}$ .
2. Drive the T2 input from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$  to enter TM0.
3. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ .
4. Apply 10 clock pulses to the T2 input ( $V_{DD}$  to  $V_{SS}$  and back to  $V_{DD}$ ) to enter TM10 mode. This enables the Serial Read/Write Calibration mode.
5. TEST now acts as a data input (High =  $V_{DD}$ , Low =  $V_{SS}$ ). FEED acts as the clock input (High =  $V_{DD}$ , Low =  $V_{SS}$ ). Clock in the sensitivity settings.

The data sequence should be as follows:

- |       |                                                 |
|-------|-------------------------------------------------|
| 5 bit | Standby Sensitivity (LSB first)                 |
| 3 bit | Hysteresis (LSB first)                          |
| 4 bit | HUSH Sensitivity (LSB first)                    |
| 5 bit | CHAMBER voltage in PTT/Chamber Test (LSB first) |
6. After all 17 bits have been entered, pulse IO to store into the EEPROM memory. Power down the part to take effect.

# RE46C182

## REGISTER 4-1: CALIBRATION CONFIGURATION REGISTER

	W-x
	PTTR5
	bit 17


W-x	W-x	W-x	W-x	W-x	W-x	W-x	W-x
PTTR4	PTTR3	PTTR2	PTTR1	TMTR4	TMTR3	TMTR2	TMTR1
bit 16							bit 9

W-x	W-x	W-x	W-x	W-x	W-x	W-x	W-x
HYTR3	HYTR2	HYTR1	STTR5	STTR4	STTR3	STTR2	STTR1
bit 8							bit 1

### Legend:

R = Readable bit      W = Writable bit      U = Unimplemented bit, read as '0'  
 -n = Value at POR      '1' = Bit is set      '0' = Bit is cleared      x = Bit is unknown

bit 17      **PTTR5:** MSB (See [Table 4-5](#))  
 bit 16      **PTTR4:** 4SB  
 bit 15      **PTTR3:** 3SB  
 bit 14      **PTTR2:** 2SB  
 bit 13      **PTTR1:** LSB  
 bit 12      **TMTR4:** MSB (See [Table 4-4](#))  
 bit 11      **TMTR3:** 3SB  
 bit 10      **TMTR2:** 2SB  
 bit 9      **TMTR1:** LSB  
 bit 8      **HYTR3:** MSB (See [Table 4-3](#))  
 bit 7      **HYTR2:** 2SB  
 bit 6      **HYTR1:** LSB  
 bit 5      **STTR5:** MSB (See [Table 4-2](#))  
 bit 4      **STTR4:** 4SB  
 bit 3      **STTR3:** 3SB  
 bit 2      **STTR2:** 2SB  
 bit 1      **STTR1:** LSB

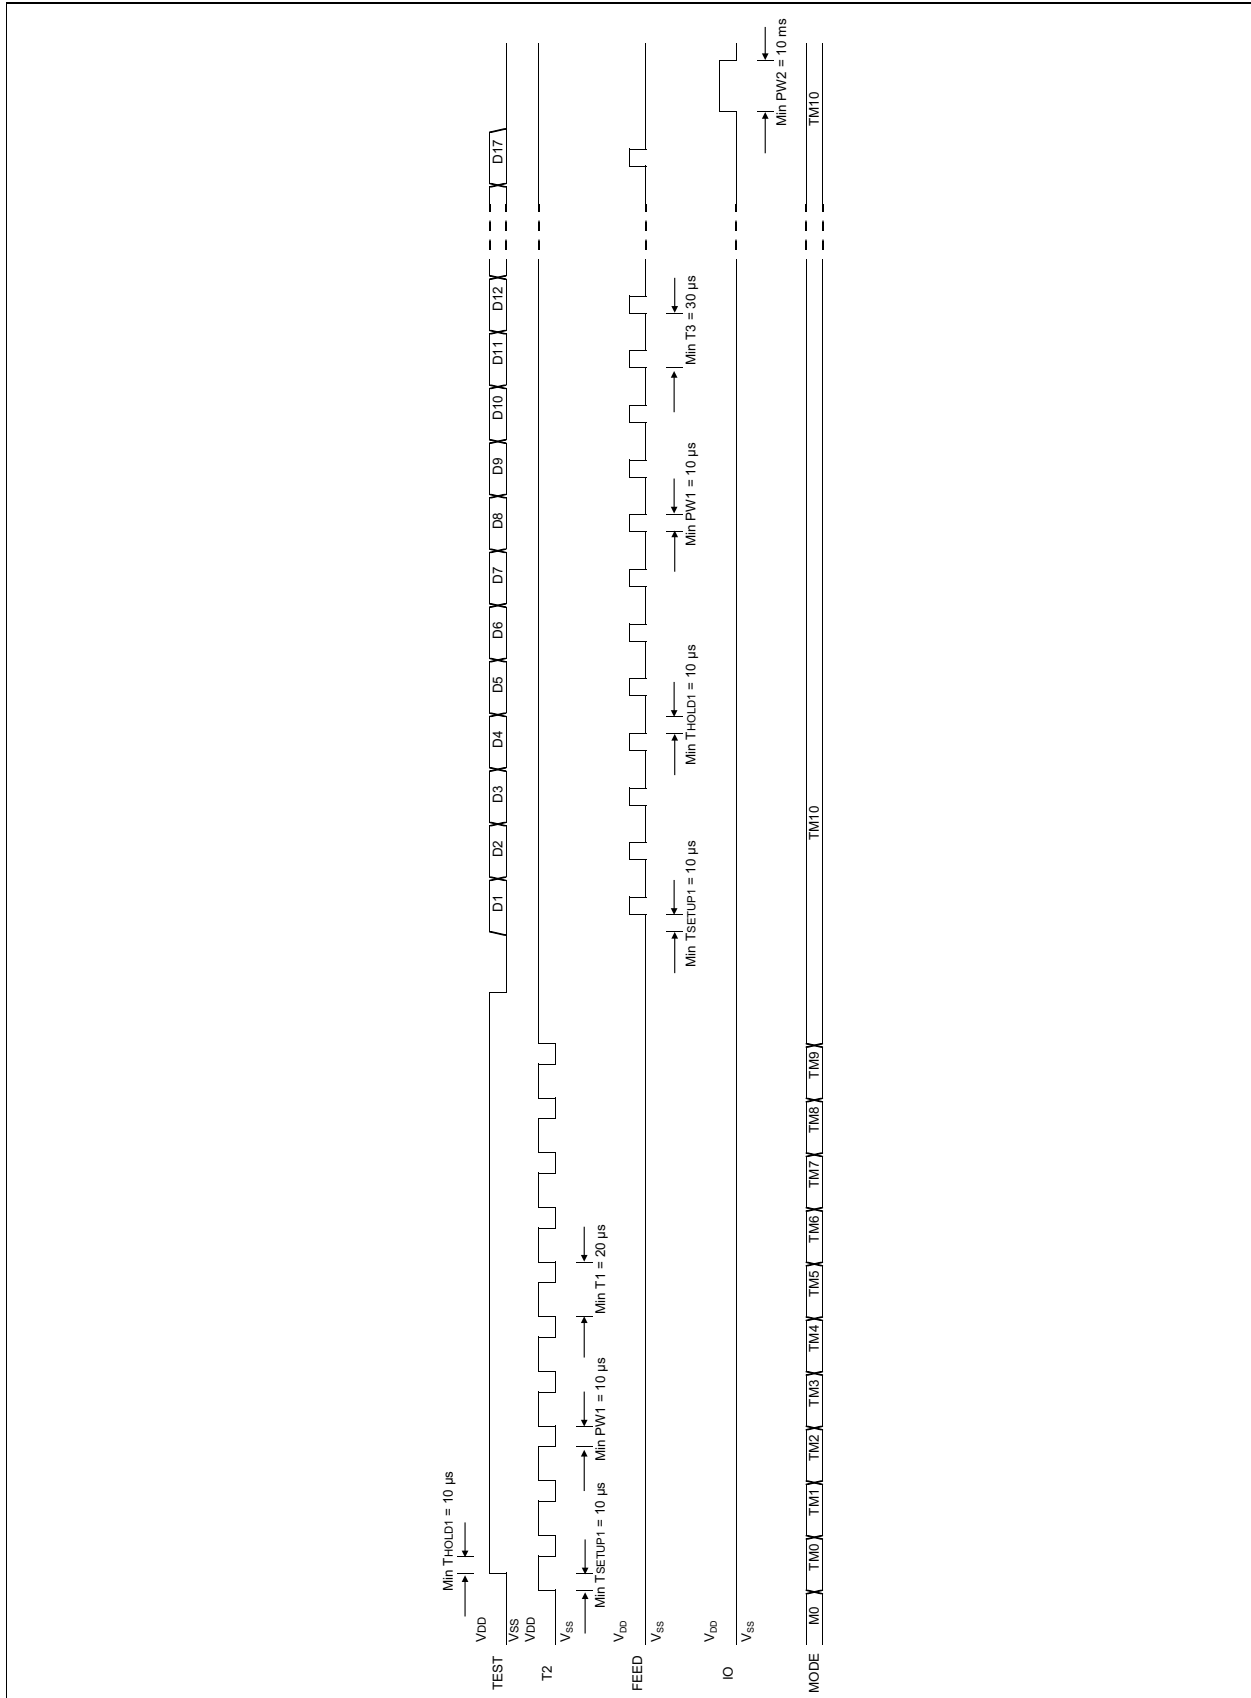

**FIGURE 4-3:** Timing Diagram for Mode TM10.

## 4.4 User Feature Selections

User feature selections can be clocked in serially using TEST as data input, and FEED, as a clock input, then stored in the internal EEPROM.

The detailed steps are as follows:

1. Power up with the bias condition shown in [Figure 4-1](#). At power-up:  
TEST = IO = FEED = T2 = V<sub>SS</sub>,  
DETECT = V<sub>DD</sub>. Now in mode M0.
2. Drive the T2 input from V<sub>SS</sub> to V<sub>DD</sub> and hold at V<sub>DD</sub> to enter TM0.
3. Drive TEST from V<sub>SS</sub> to V<sub>DD</sub> and hold at V<sub>DD</sub>.
4. Apply two clock pulses to the T2 input (V<sub>DD</sub> to V<sub>SS</sub> and then back to V<sub>DD</sub>) to enter TM2.
5. Using TEST as data and FEED as clock, shift in values of 18 bits as selected from [Register 4-2](#).
6. After shifting in data, pull IO input to V<sub>DD</sub>, then V<sub>SS</sub> (minimum pulse-width of 10 ms) to store shift register contents in the memory.
7. If any changes are required, power down the part and return to Step 1. All bit values must be reentered.

**REGISTER 4-2: USER FEATURE CONFIGURATION REGISTER**

	W-x	W-x
	LBHshEn	LBTR2
	bit 18	bit 17

W-x	W-x	W-x	W-x	W-x	W-x	W-x	W-x
LBTR1	CMTR5	CMTR4	CMTR3	CMTR2	CMTR1	AMHCEn	AMLEDEn
bit 16							bit 9

W-x	W-x	W-x	W-x	W-x	W-x	W-x	W-x
AMTO2	AMTO1	AMEn	EOLEn	SmrtH	HIAO	HushEnB	LBSEL
bit 8							bit 1

**Legend:**

R = Readable bit      W = Writable bit      U = Unimplemented bit, read as '0'  
 -n = Value at POR      '1' = Bit is set      '0' = Bit is cleared      x = Bit is unknown

- bit 18      **LBHshEn:** Low Battery Hush Enable Bit  
             1 = Enable  
             0 = Disable
- bit 17      **LBTR2:** MSB
- bit 16      **LBTR1:** LSB  
             00 = 7.5V  
             01 = 7.8V  
             10 = 6.9V  
             11 = 7.2V
- bit 15      **CMTR5:** MSB (see STTR values in [Table 4-2](#))
- bit 14      **CMTR4:** 4SB
- bit 13      **CMTR3:** 3SB
- bit 12      **CMTR2:** 2SB
- bit 11      **CMTR1:** LSB
- bit 10      **AMHCEn:** Alarm Memory PTT Indicator Horn Chirp Enable Bit  
             1 = Enable  
             0 = Disable
- bit 9      **AMLEDEn:** Alarm Memory PTT Indicator LED Flashing Enable Bit  
             1 = Enable  
             0 = Disable

**REGISTER 4-2: USER FEATURE CONFIGURATION REGISTER (CONTINUED)**

bit 8	<b>AMTO2:</b> MSB
bit 7	<b>AMTO1:</b> LSB 00 =24 Hours Time-out 01 =48 Hours Time-out 10 =0 Hours Time-out 11 =Never Time-out
bit 6	<b>AMEn:</b> Alarm Memory Enable Bit 1 = Enable 0 = Disable
bit 5	<b>EOLEn:</b> End of Life Indicator Enable Bit 1 = Enable 0 = Disable
bit 4	<b>SmrtH:</b> Smart HUSH Bit 1 = Enable (HUSH is canceled by either high smoke, or remote smoke) 0 = Disable (HUSH is never canceled until time-out)
bit 3	<b>HIAO:</b> HUSH-in-Alarm -Only Bit 1 = Enable (Hush is activated upon release of PTT during local smoke only) 0 = Disable (Hush is activated upon release of PTT at any time)
bit 2	<b>HushEnB:</b> HUSH Enable Bit 1 = Enable (HUSH is disabled) 0 = Disable (HUSH is enabled)
bit 1	<b>LBSEL:</b> Low Battery Select Bit 1 = 2.5 ms 0 = 10 ms

The minimum pulse-width for FEED is 10  $\mu$ s, while the minimum pulse-width for TEST is 100  $\mu$ s.

For example, for the following options, the sequence would be:

Data	—	1	1	0	1	1	1	1	0	1
Bit	—	18	17	16	15	14	13	12	11	10
Data	—	0	0	0	1	0	0	1	0	0
Bit	—	9	8	7	6	5	4	3	2	1
<hr/>										
Low Battery HUSH Enable							=	Yes		
Low Battery Trip Point							=	6.9V		
Chamber Monitor Sensitivity							=	4.3V		
(11110)										
Alarm Memory PTT Indicator Horn Chirp Enable							=	Yes		
Alarm Memory PTT Indicator LED Flashing Enable							=	No		
Alarm Memory LED Indicator Time-Out							=	24h		
Alarm Memory Enable							=	Yes		
End of Life Enable							=	No		
Smart HUSH							=	No		
HUSH-In-Alarm Only							=	Yes		
Hush Enable							=	Yes		
Low Battery Select							=	10 ms		

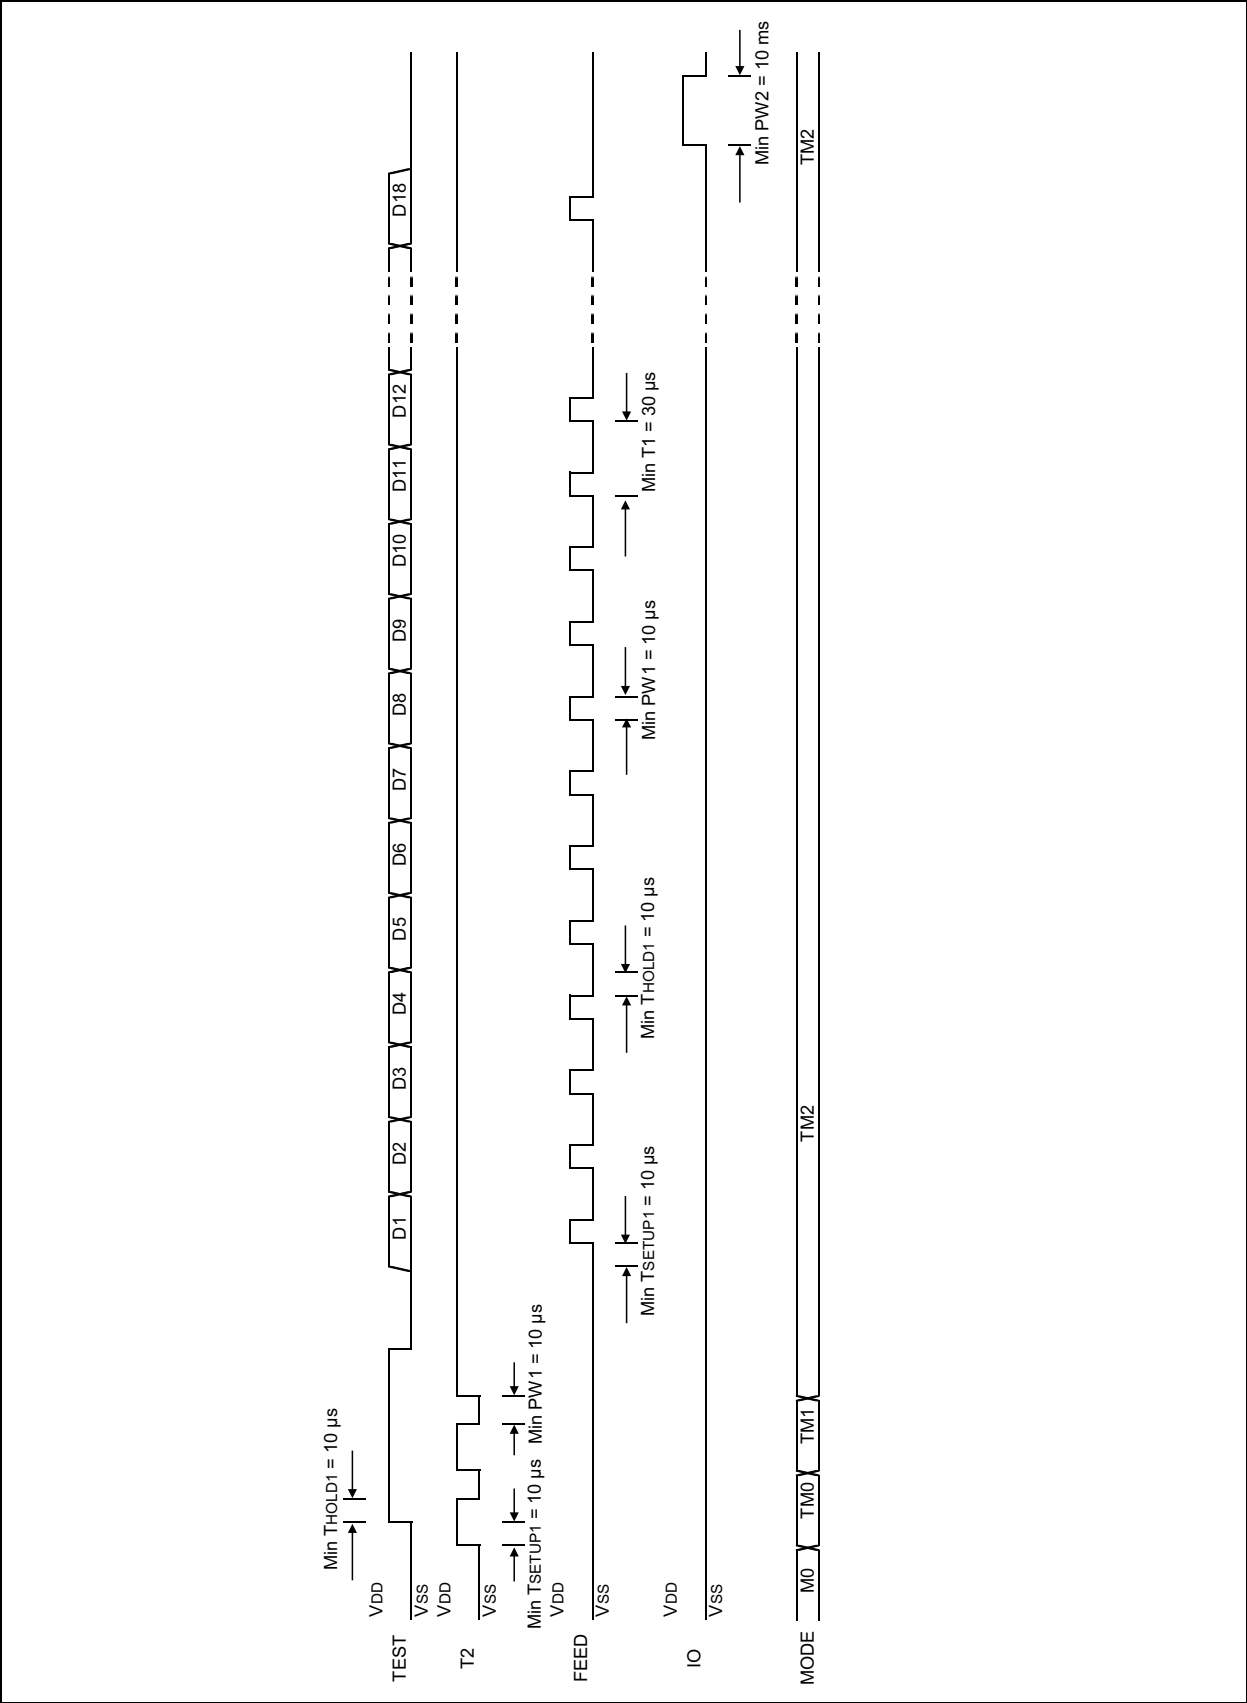


FIGURE 4-4: Timing Diagram for Mode TM2.

## 4.5 Sensitivity Verification

After all sensitivity levels and CHAMBER voltage at PTT/Chamber Test have been entered and stored into the memory, additional Test modes are available to verify if the sensitivities are functioning as expected.

[Table 4-8](#) describes several verification tests.

**TABLE 4-8: SENSITIVITY VERIFICATION DESCRIPTION**

Sensitivity	Test Description
Standby Sensitivity	Clock T2 to Mode TM12 (12 clocks). With appropriate smoke level in the chamber, pull TEST to $V_{SS}$ and hold for at least 1 ms. The TESTOUT output will indicate the detection status (High = smoke detected).
Hysteresis	Clock T2 to Mode TM13 (13 clocks). Pulse TEST and monitor TESTOUT.
HUSH Sensitivity	Clock T2 to Mode TM14 (14 clocks). Pulse TEST and monitor TESTOUT.
CHAMBER voltage at PTT/Chamber Test	Clock T2 to Mode TM15 (15 clocks). Pulse TEST and monitor TESTOUT.

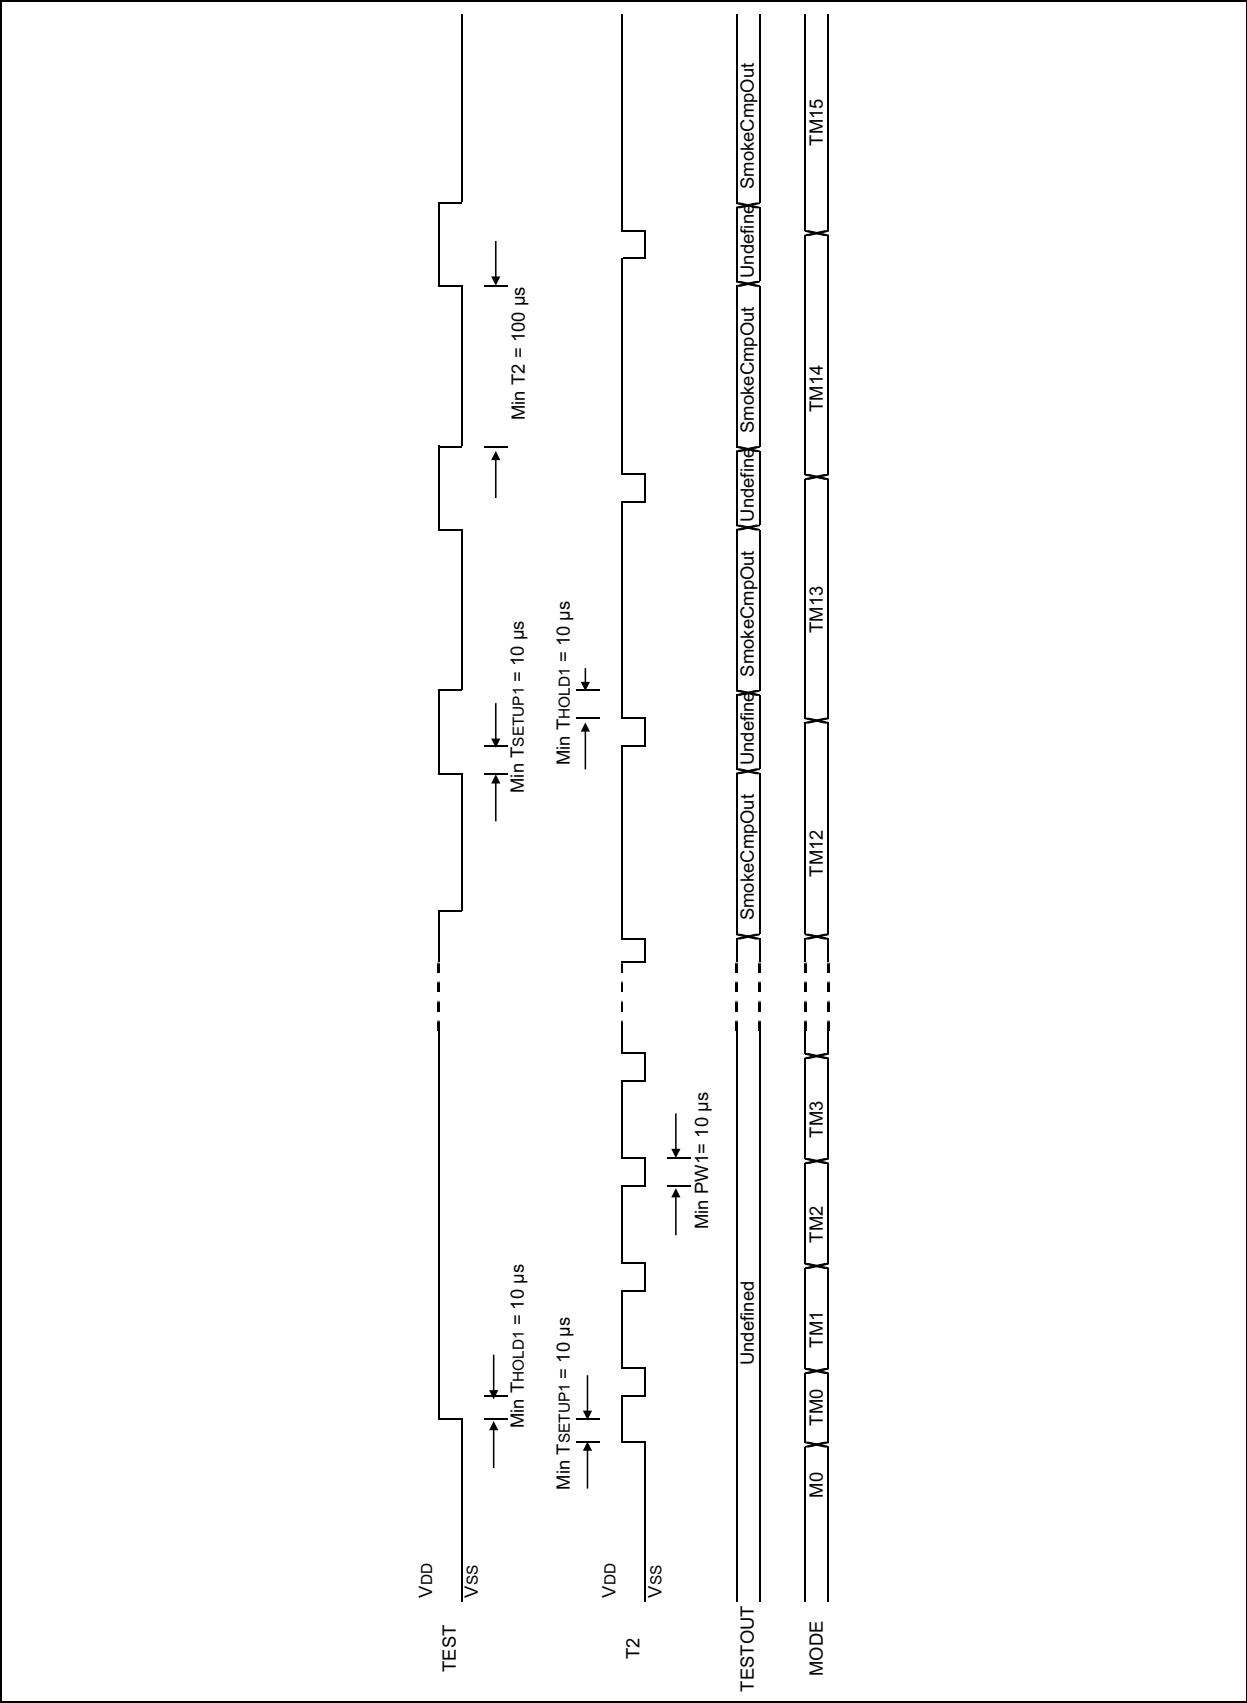


FIGURE 4-5: Timing Diagram for Sensitivity Verification in Mode TM12 ~ TM15.



## 4.6 Serial Read/Write Calibration and User Features

As an alternative to the steps in [Section 4.2, Smoke Calibration](#) and [Section 4.4, User Feature Selections](#), the sensitivity settings and user feature selections can be entered directly from a Serial Read/Write Calibration mode.

To enter this mode, follow these steps:

1. Power up with the bias condition shown in [Figure 4-1](#) to enter M0. At power-up:

TEST = IO = FEED = T2 =  $V_{SS}$ ,

DETECT =  $V_{DD}$ .

2. Drive the T2 input from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$  to enter TM0.
3. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ .
4. Apply 18 clock pulses to the T2 input ( $V_{DD}$  to  $V_{SS}$  and then back to  $V_{DD}$ ) to enter the TM18 mode. This enables the Serial Read/Write Calibration and User Features modes.

5. TEST now acts as a data input (High =  $V_{DD}$ , Low =  $V_{SS}$ ). FEED acts as the clock input (High =  $V_{DD}$ , Low =  $V_{SS}$ ). Clock in the sensitivity settings. The data sequence should be as follows:

D1 ~ D18      User Features (18 bits, LSB first)

D19 ~ D35      Calibration (17 bits, LSB First)

6. After all 35 bits have been entered, pulse IO to store into the EEPROM memory.
7. Use test mode TM19 to set the lock bit to unlocked. This will insure TM18 can be used to read back the data to verify the TM18 write completed properly.

### REGISTER 4-3: SERIAL READ/WRITE REGISTER

	W-x	W-x	W-x
	PTTR5	PTTR4	PTTR3
	bit 35		bit 33

W-x	W-x	W-x	W-x	W-x	W-x	W-x	W-x
PTTR2	PTTR1	TMTR4	TMTR3	TMTR2	TMTR1	HYTR3	HYTR2
bit 32							bit 25

W-x	W-x	W-x	W-x	W-x	W-x	W-x	W-x
HYTR1	STTR5	STTR4	STTR3	STTR2	STTR1	LBHshEn	LBTR2
bit 24							bit 17

W-x	W-x	W-x	W-x	W-x	W-x	W-x	W-x
LBTR1	CMTR5	CMTR4	CMTR3	CMTR2	CMTR1	AMHCEn	AMLEDEn
bit 16							bit 9

W-x	W-x	W-x	W-x	W-x	W-x	W-x	W-x
AMTO2	AMTO1	AMEn	EOLEn	Smrth	HIAO	HushEnB	LBSEL
bit 8							bit 1

#### Legend:

R = Readable bit

W = Writable bit

U = Unimplemented bit, read as '0'

-n = Value at POR

'1' = Bit is set

'0' = Bit is cleared

x = Bit is unknown

bit 35      **PTTR5:** MSB (See [Table 4-5](#))

bit 34      **PTTR4:** 4SB

bit 33      **PTTR3:** 3SB

# RE46C182


---

## REGISTER 4-3: SERIAL READ/WRITE REGISTER (CONTINUED)

bit 32	<b>PTTR2:</b> 2SB
bit 31	<b>PTTR1:</b> LSB
bit 30	<b>TMTR4:</b> MSB (See <a href="#">Table 4-4</a> )
bit 29	<b>TMTR3:</b> 3SB
bit 28	<b>TMTR2:</b> 2SB
bit 27	<b>TMTR1:</b> LSB
bit 26	<b>HYTR3:</b> MSB (See <a href="#">Table 4-3</a> )
bit 25	<b>HYTR2:</b> 2SB
bit 24	<b>HYTR1:</b> LSB
bit 23	<b>STTR5:</b> MSB (See <a href="#">Table 4-2</a> )
bit 22	<b>STTR4:</b> 4SB
bit 21	<b>STTR3:</b> 3SB
bit 20	<b>STTR2:</b> 2SB
bit 19	<b>STTR1:</b> LSB
bit 18	<b>LBHshEn:</b> Low Battery HUSH Enable Bit 1 = Enable 0 = Disable
bit 17	<b>LBTR2:</b> MSB
bit 16	<b>LBTR1:</b> LSB 00 = 7.5V 01 = 7.8V 10 = 6.9V 11 = 7.2V
bit 15	<b>CMTR5:</b> MSB
bit 14	<b>CMTR4:</b> 4SB
bit 13	<b>CMTR3:</b> 3SB
bit 12	<b>CMTR2:</b> 2SB
bit 11	<b>CMTR1:</b> LSB
bit 10	<b>AMHCEn:</b> Alarm Memory PTT Indicator Horn Chirp Enable Bit 1 = Enable 0 = Disable
bit 9	<b>AMLEDEn:</b> Alarm Memory PTT Indicator LED Flashing Enable Bit 1 = Enable 0 = Disable
bit 8	<b>AMTO2:</b> MSB
bit 7	<b>AMTO1:</b> LSB 00 =24 Hours Time-out 01 =48 Hours Time-out 10 =0 Hours Time-out 11 =Never Time-out
bit 6	<b>AMEn:</b> Alarm Memory Enable Bit 1 = Enable 0 = Disable
bit 5	<b>EOLEn:</b> End of Life Indicator Enable Bit 1 = Enable 0 = Disable

## REGISTER 4-3: SERIAL READ/WRITE REGISTER (CONTINUED)

- bit 4      **SmrtH:** Smart HUSH Bit  
1 = Enable (HUSH is canceled by either high smoke, or remote smoke)  
0 = Disable (HUSH is never canceled until time-out)
- bit 3      **HIAO:** HUSH-in-Alarm-Only Bit  
1 = Enable (HUSH is activated upon release of PTT during local smoke only)  
0 = Disable (HUSH is activated upon release of PTT at any time)
- bit 2      **HushEnB:** HUSH Enable Bit  
1 = Enable (HUSH is disabled)  
0 = Disable (HUSH is enabled)
- bit 1      **LBSEL:** Low Battery Select Bit  
1 = 2.5 ms  
0 = 10 ms

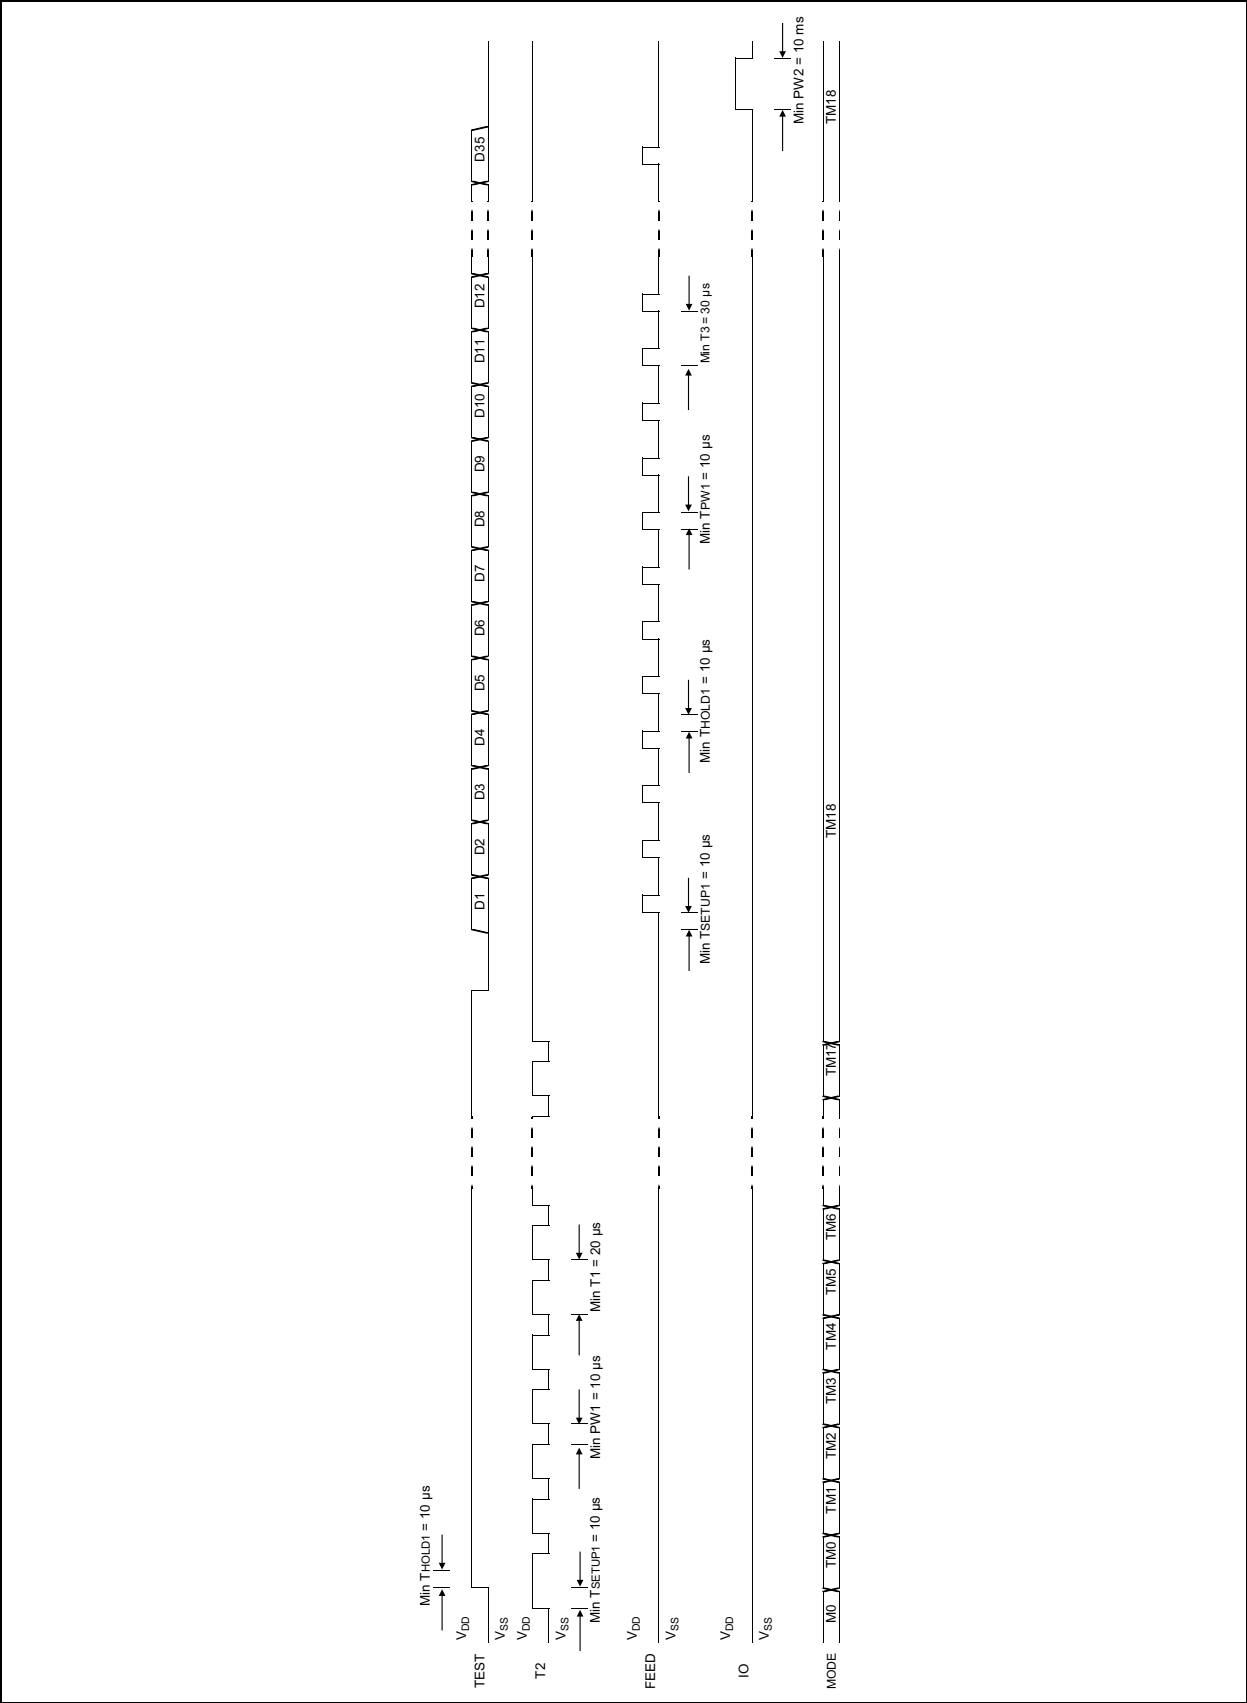

**FIGURE 4-6:** Timing Diagram for Serial Read/Write Calibration and User Features in Mode TM18.

## 4.7 Horn Test

Test mode TM0 allows the horn to be enabled indefinitely for audibility testing.


To enter this mode, follow the next steps:

1. Power up with the bias condition shown in [Figure 4-1](#) to enter M0. At power-up:  
TEST = IO = FEED = T2 =  $V_{SS}$ ,  
DETECT =  $V_{DD}$ .
2. Drive the T2 input from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$  to enter TM0.
3. To disable the horn, drive TEST from  $V_{SS}$  to  $V_{DD}$ .

## 4.8 Low Battery Test

Test mode TM17 allows the low battery trip point to be tested. To enter this mode, follow these steps:

1. Power up with the bias condition shown in [Figure 4-1](#) to enter M0. At power-up:  
TEST = IO = FEED = T2 =  $V_{SS}$ ,  
DETECT =  $V_{DD}$ .
2. Drive the T2 input from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$  to enter TM0.
3. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ .
4. Apply 17 clock pulses to the T2 input ( $V_{DD}$  to  $V_{SS}$  and then back to  $V_{DD}$ ) to enter TM17 mode.
5. Drive IO from  $V_{SS}$  to  $V_{DD}$  to enable the low battery testing and turn on the RLED. Sweep  $V_{DD}$  from high to low and monitor the TESTOUT output. The TESTOUT output will indicate the Low Battery status (High = Low Battery detected).

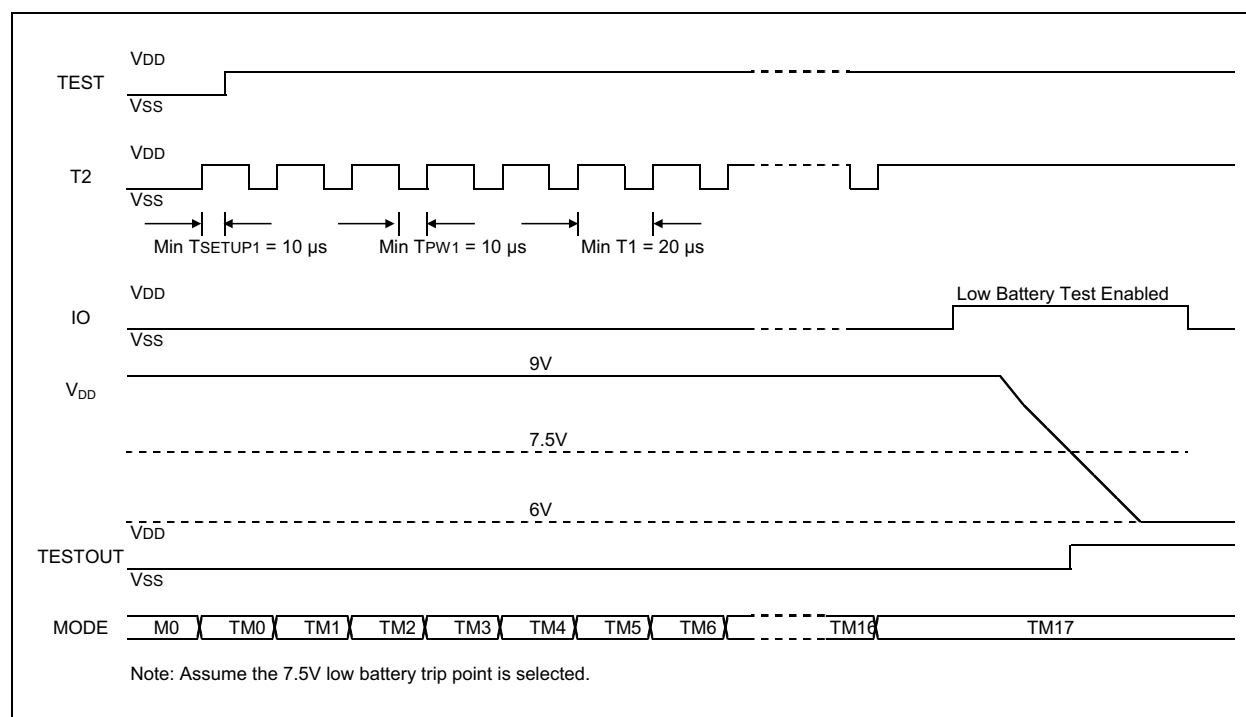


**FIGURE 4-7:** Timing Diagram for Low Battery Test in Mode TM17.

## 4.9 In-module Chamber Monitor Test Mode

Before performing the procedure below, program STTR[5:1], CMTR[5:1] and PTTR[5:1] so that (1) no alarm will occur in standby, (2) chamber test will pass, (3) chamber monitor test will fail. Figure 4-8 is the timing diagram for this procedure.

1. Power up the smoke detector module as shown in the typical application drawing. At power up:  $V_{DD} = 9V$ ,  $TEST = FEED = T2 = V_{SS} = 0V$ . The module is now in mode M0.
2. At least 1 second after power up, drive T2 from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$  to enter TM0.
3. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ .
4. Apply one clock pulse to T2 ( $V_{DD}$  to  $V_{SS}$  and back to  $V_{DD}$ ). This enters TM1 where the pre-loading of chamber monitor counter occurs.
5. Stop driving CHAMBER. Apply a pulse on T2. This enters test mode TM2. Then drive TEST from  $V_{DD}$  to  $V_{SS}$  and hold at  $V_{SS}$ . Then drive T2 from  $V_{DD}$  to  $V_{SS}$  and hold at  $V_{SS}$ . This enters mode M0, standby normal operation mode. Minimum  $ts2$  should be allowed between CHAMBER rising edge and last T2 falling edge. Approximately 1.37 hours later, the three chamber monitor failure chirps will occur.

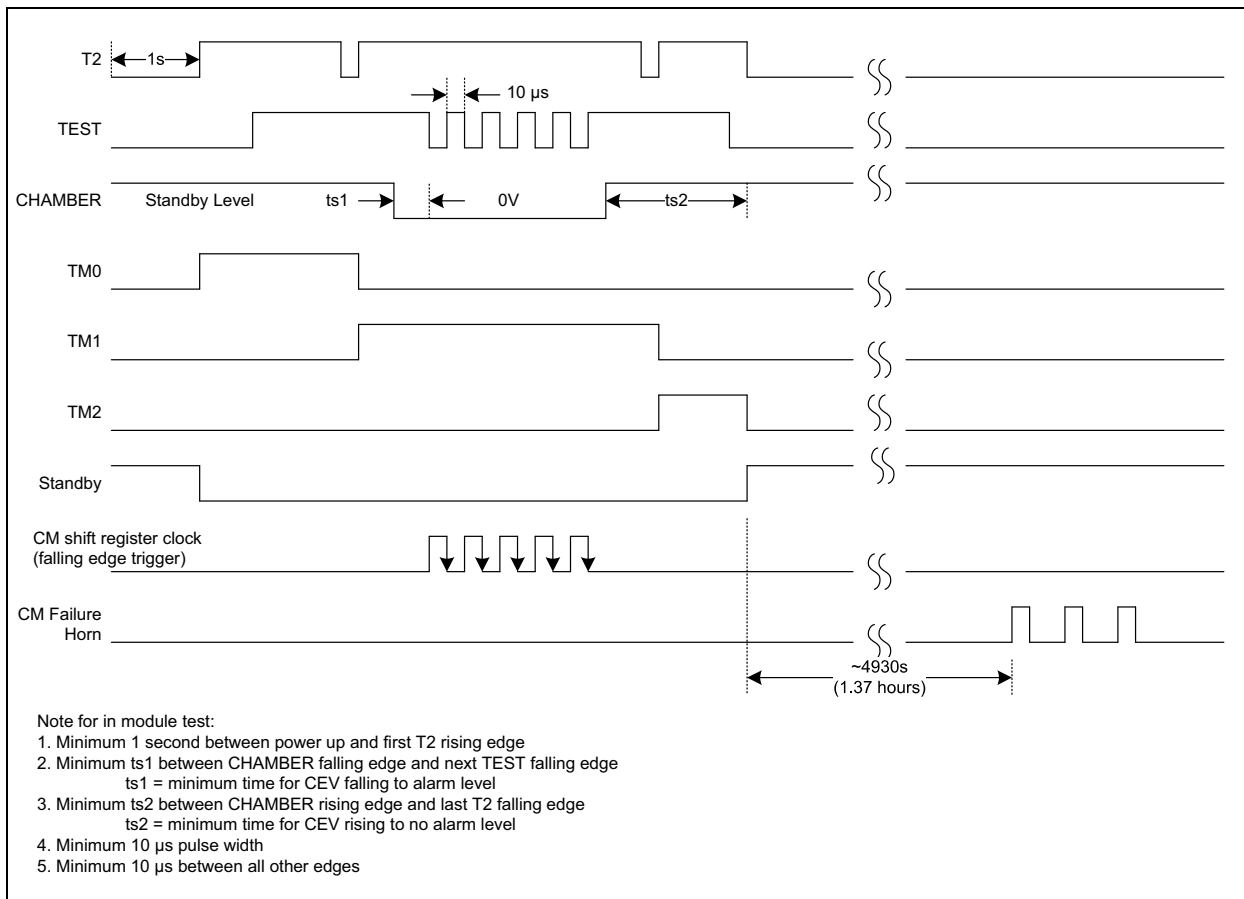


**FIGURE 4-8:** Module Chamber Monitor Test Mode.

## 4.10 User Lock Bit Programming

Test mode TM19 allows users to program the user EE lock bit. Once the user EE lock bit is set, the programmed user EE data can not be changed unless the lock bit is reset.

To enter this mode, follow the next steps:

1. Power up with the bias condition shown in [Figure 4-1](#) to enter M0. At power-up:  
TEST = IO = FEED = T2 =  $V_{SS}$ ,  
DETECT =  $V_{DD}$ .
2. Drive the T2 input from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$  to enter TM0.
3. Drive TEST from  $V_{SS}$  to  $V_{DD}$  and hold at  $V_{DD}$ .
4. Apply 19 clock pulses to the T2 input ( $V_{DD}$  to  $V_{SS}$  and then back to  $V_{DD}$ ) to enter TM19 mode.
5. Hold TEST at  $V_{DD}$ . Pulse FEED once to load EEPROM data. Then pulse IO once to set the lock bit and store into the EEPROM memory.
6. To reset the lock bit from Step 5, drive TEST to  $V_{SS}$  and pulse IO once.

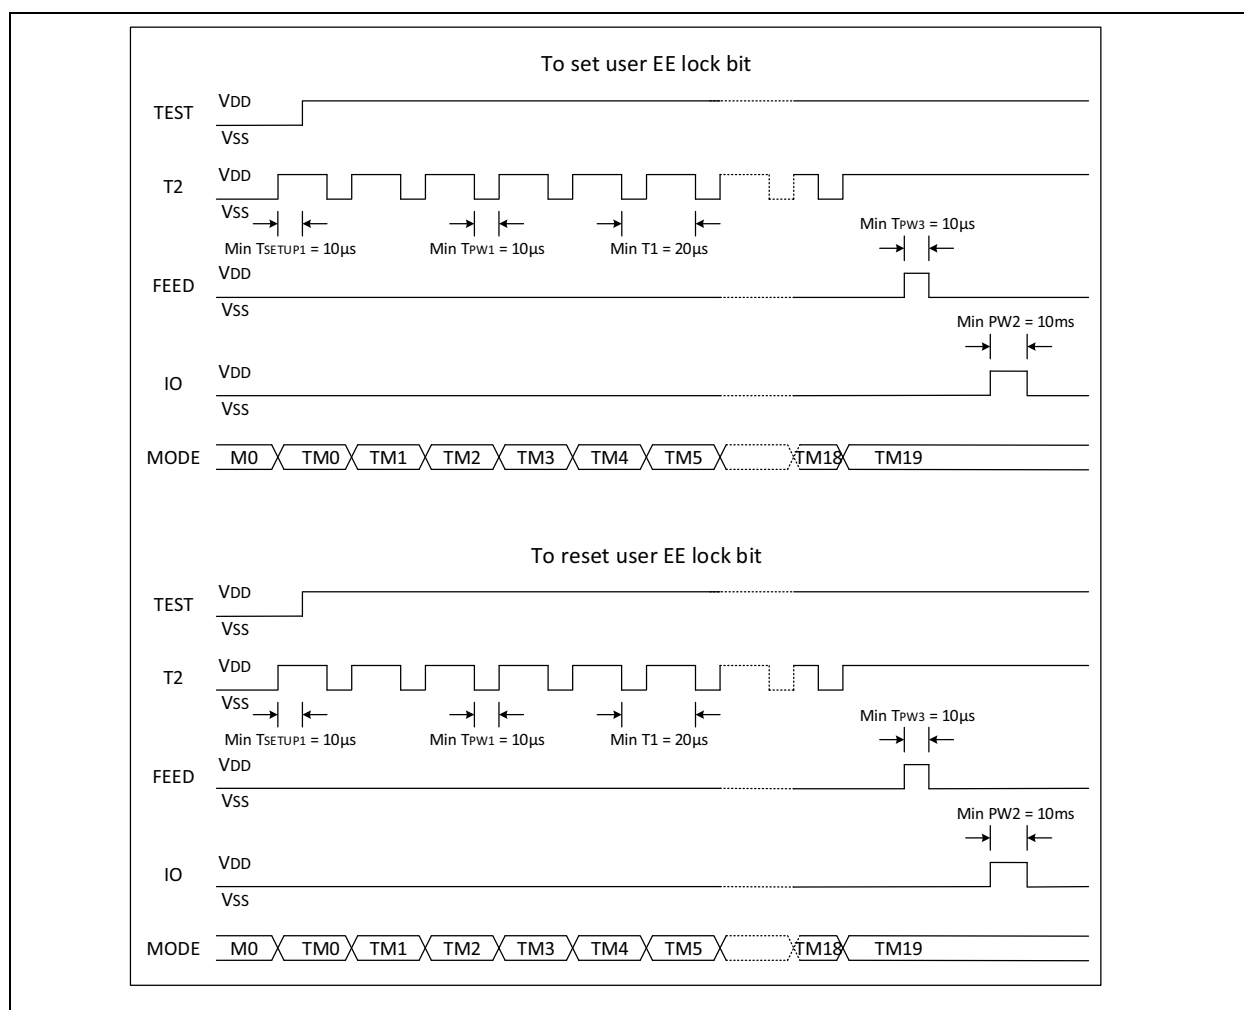

**FIGURE 4-9:** Timing Diagram for User Lock Bit Programming in Mode TM19.

NOTES:



## 5.0 APPLICATION NOTES

### 5.1 Standby Current Calculation

A calculation of the standby current is shown in [Table 5-1](#), based on the following conditions:

$V_{DD}$	=	9V
LED current in loaded battery check	=	10 mA
EOLen	=	1

**TABLE 5-1: STANDBY CURRENT CALCULATION**

$I_{DD}$ Component	Current ( $\mu A$ )	Duration (s)	Period (s)	Factor	Average Current ( $\mu A$ )
Fixed $I_{DD}$	3.8	Always	Always	1	3.8
Smoke Check	9.6	0.005	10	0.0005	0.0048
Low Battery Check (unloaded)	21.4	0.01	80	0.00013	0.0028
Low Battery Check (loaded)	10000	0.01	320	3.10E-05	0.31
Chamber Test (smoke check)	9.6	0.005	320	1.60E-05	0.00015
Chamber Test (chamber low)	3.2	3.7	320	0.012	0.038
End of Life (reading EE and counting)	35	0.14	1310400	1.10E-07	3.74E-06
End of Life (writing EE)	100	0.01	1310400	7.40E-09	7.63E-07
<b>Total</b>					<b>4.16</b>

#### 5.1.1 FIXED $I_{DD}$

The fixed  $I_{DD}$  is the current from the constantly active internal oscillator, bias circuit and guard amplifier.

#### 5.1.2 SMOKE CHECK

The current drawn from the smoke detection circuitry during the 5 ms smoke check period.

#### 5.1.3 LOW BATTERY CHECK (UNLOADED)

The current drawn by the low battery detection circuitry during the 10 ms unloaded low battery check period.

#### 5.1.4 LOW BATTERY CHECK (LOADED)

The current drawn by the RLED during the 10 ms loaded low battery check period.

#### 5.1.5 CHAMBER TEST (SMOKE CHECK)

The current drawn by the smoke detection circuitry during the 5 ms smoke check period, while the chamber is pulled low.

#### 5.1.6 CHAMBER TEST (CHAMBER LOW)

The current drawn to pull the chamber low when the chamber test is performed.

#### 5.1.7 END OF LIFE (READING EE AND COUNTING)

The current drawn to read EOL bits from EE and then increased by 1.

#### 5.1.8 END OF LIFE (WRITING EE)

The current drawn to write EOL bits back to EE.

#### 5.1.9 TOTAL CURRENT

The average total current drawn in Standby.

5.2 FUNCTIONAL TIMING DIAGRAMS

Figures 5-1 to 5-6 show the timing diagrams for the smoke detector functions described in [Section 3.0, Device Description](#).


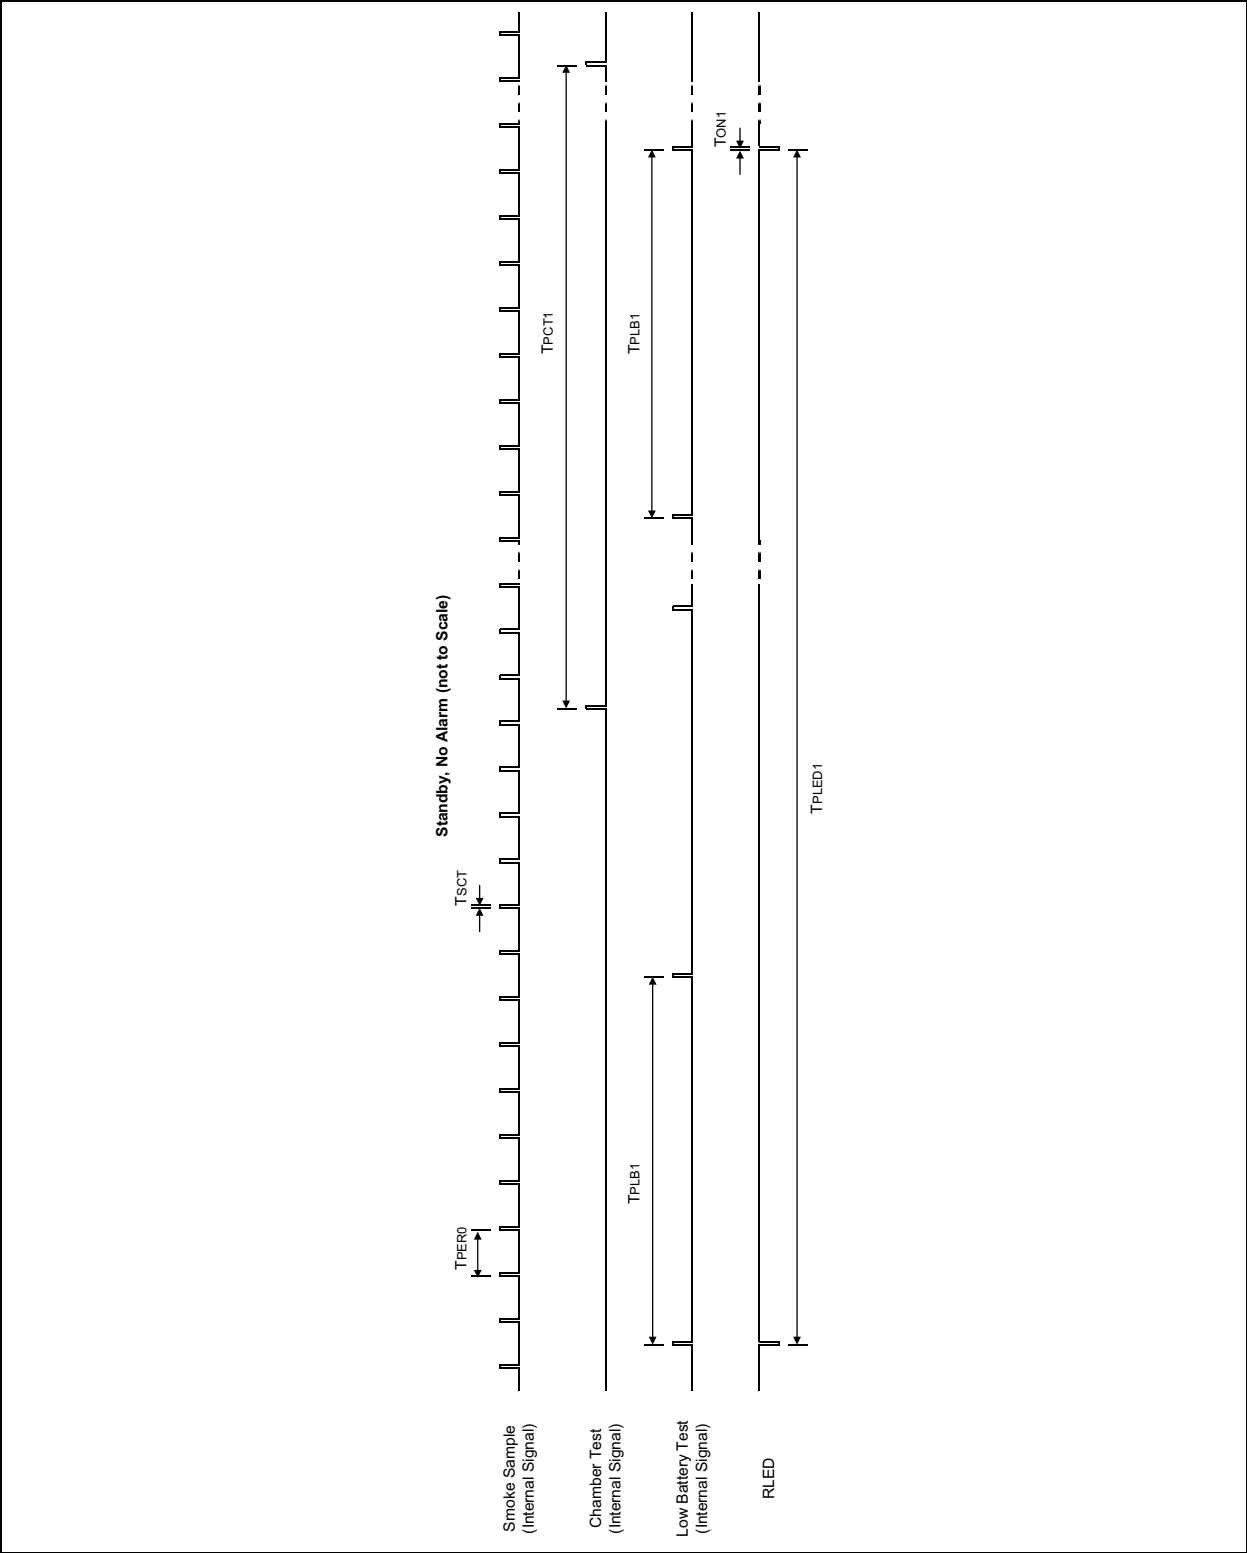


FIGURE 5-1: Timing Diagram – Standby, No Alarm.

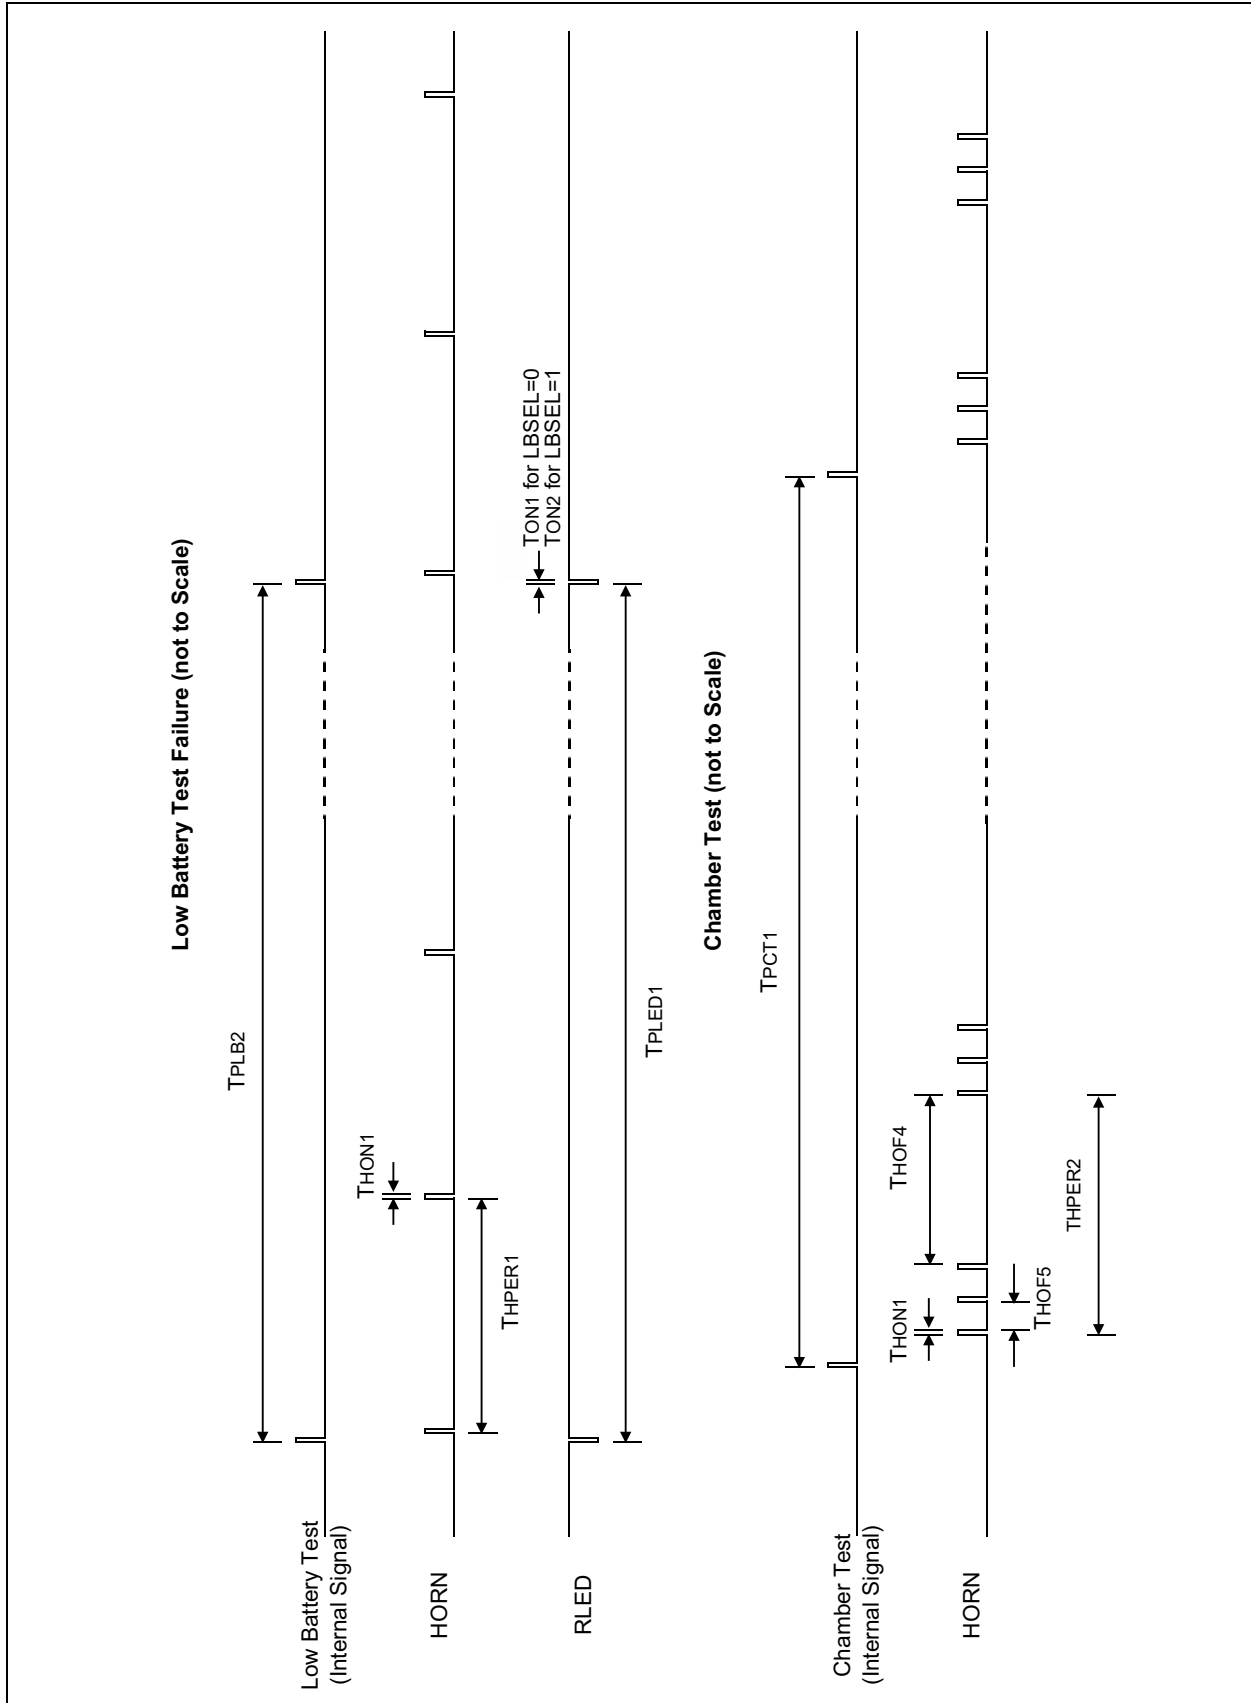

**FIGURE 5-2:** Timing Diagram – Low Battery Test Failure and Chamber Test Failure.

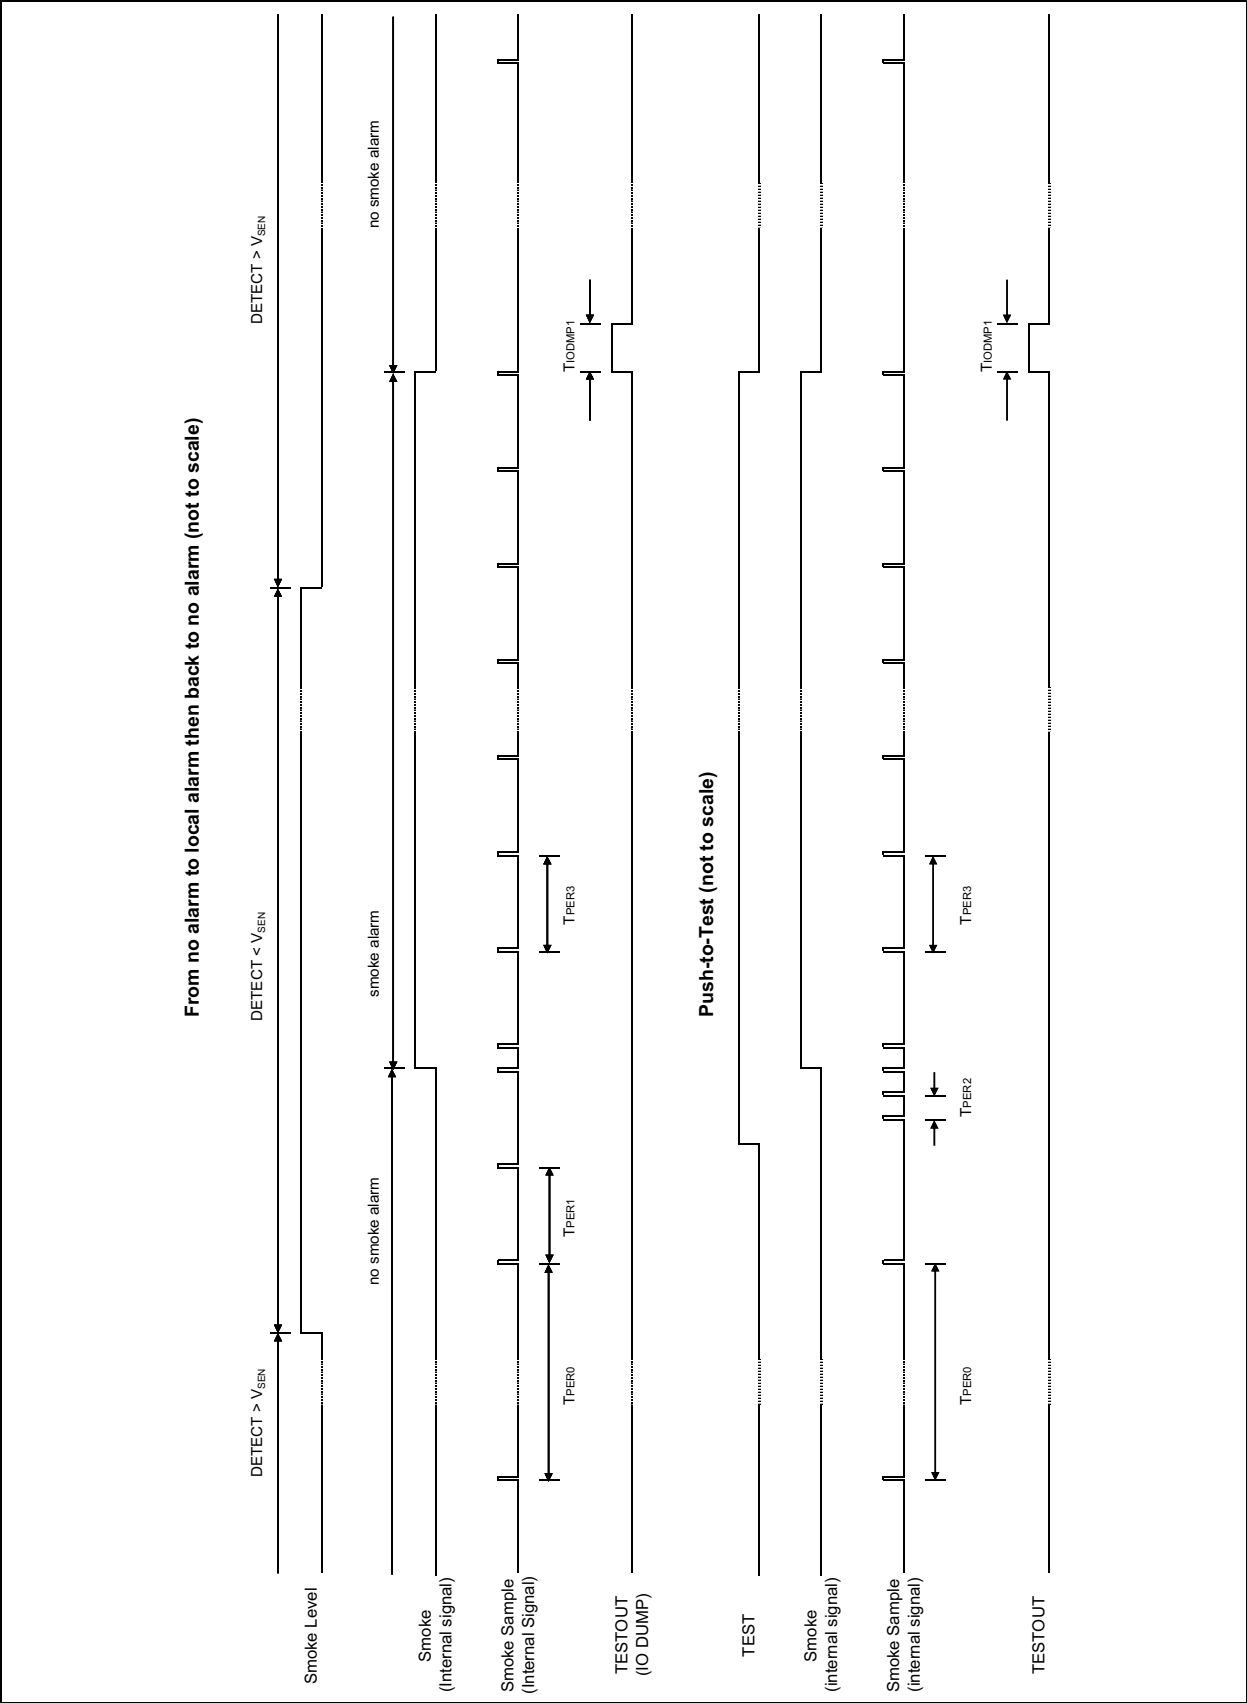


FIGURE 5-3: Timing Diagram – From Standby to Local Smoke and Push-To-Test.

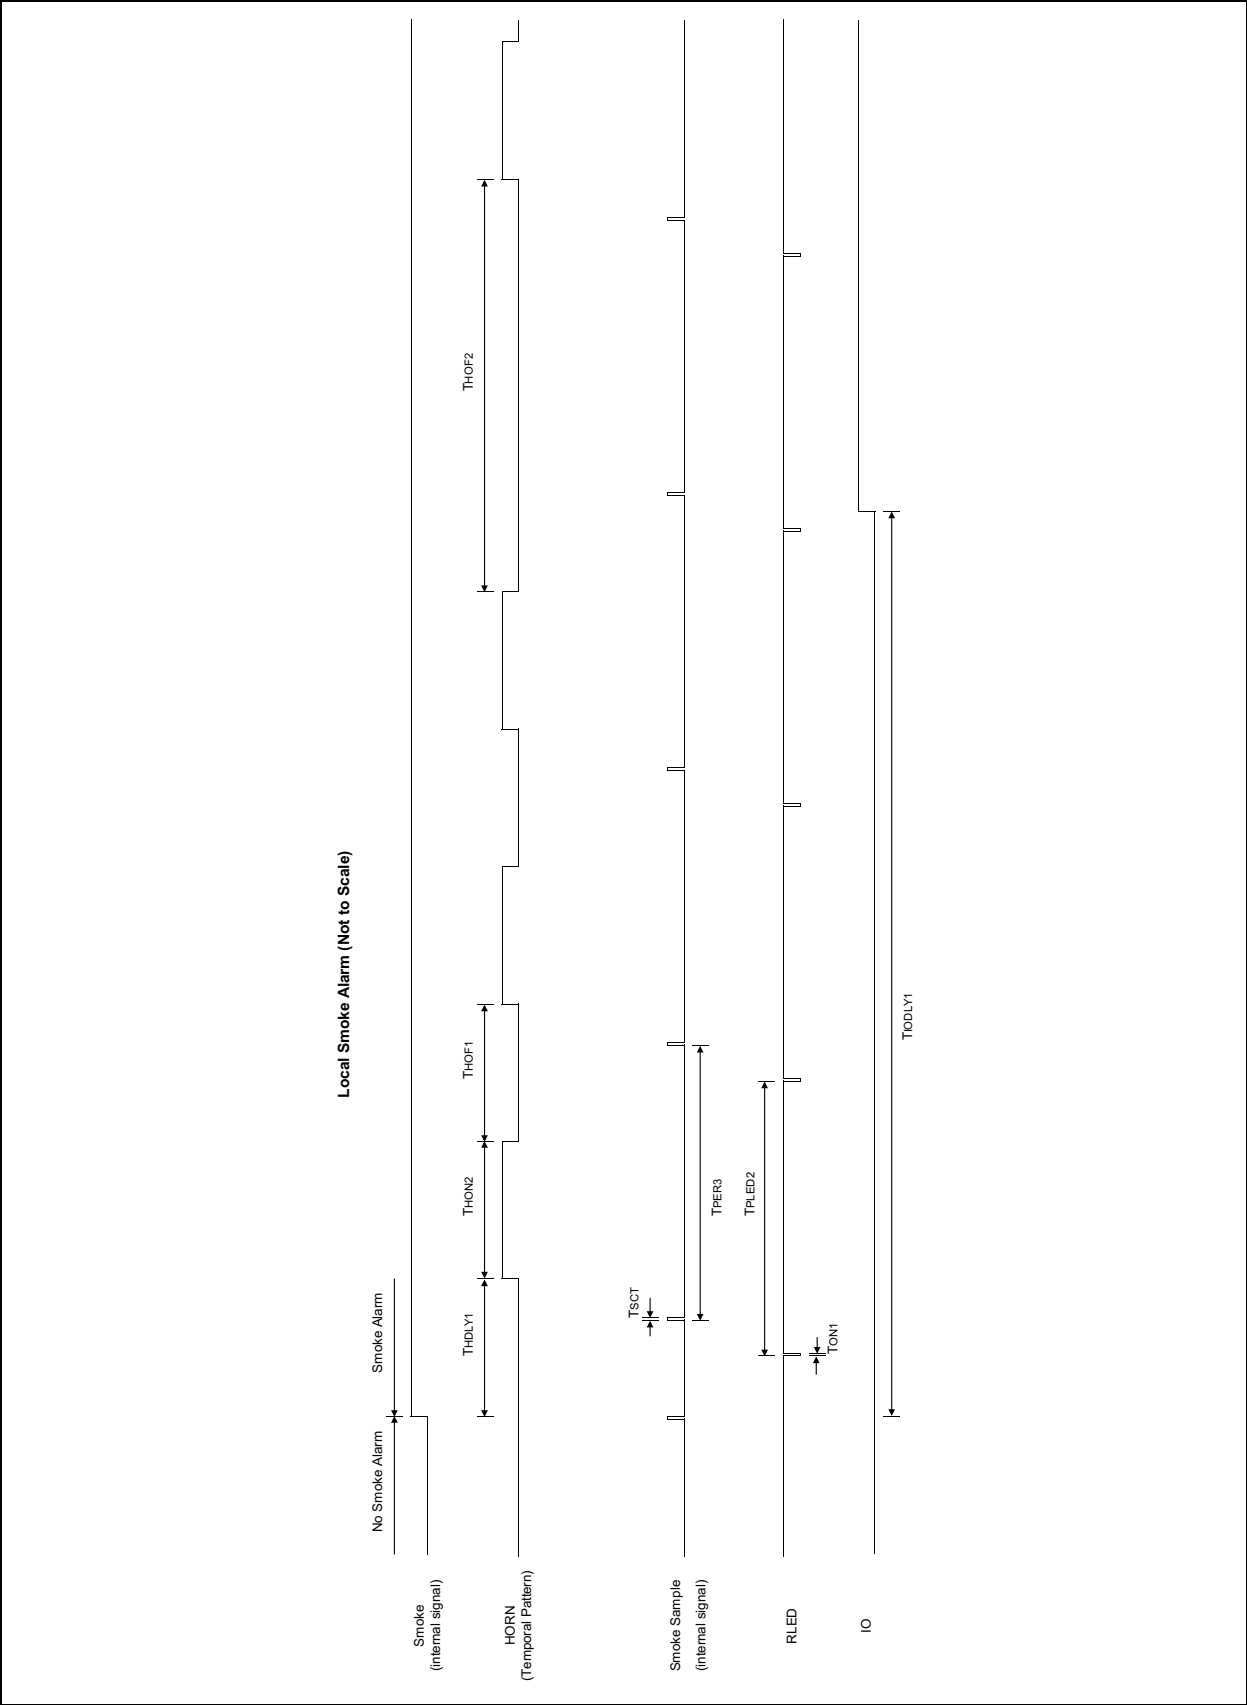


FIGURE 5-4: Timing Diagram – Local Smoke Alarm.


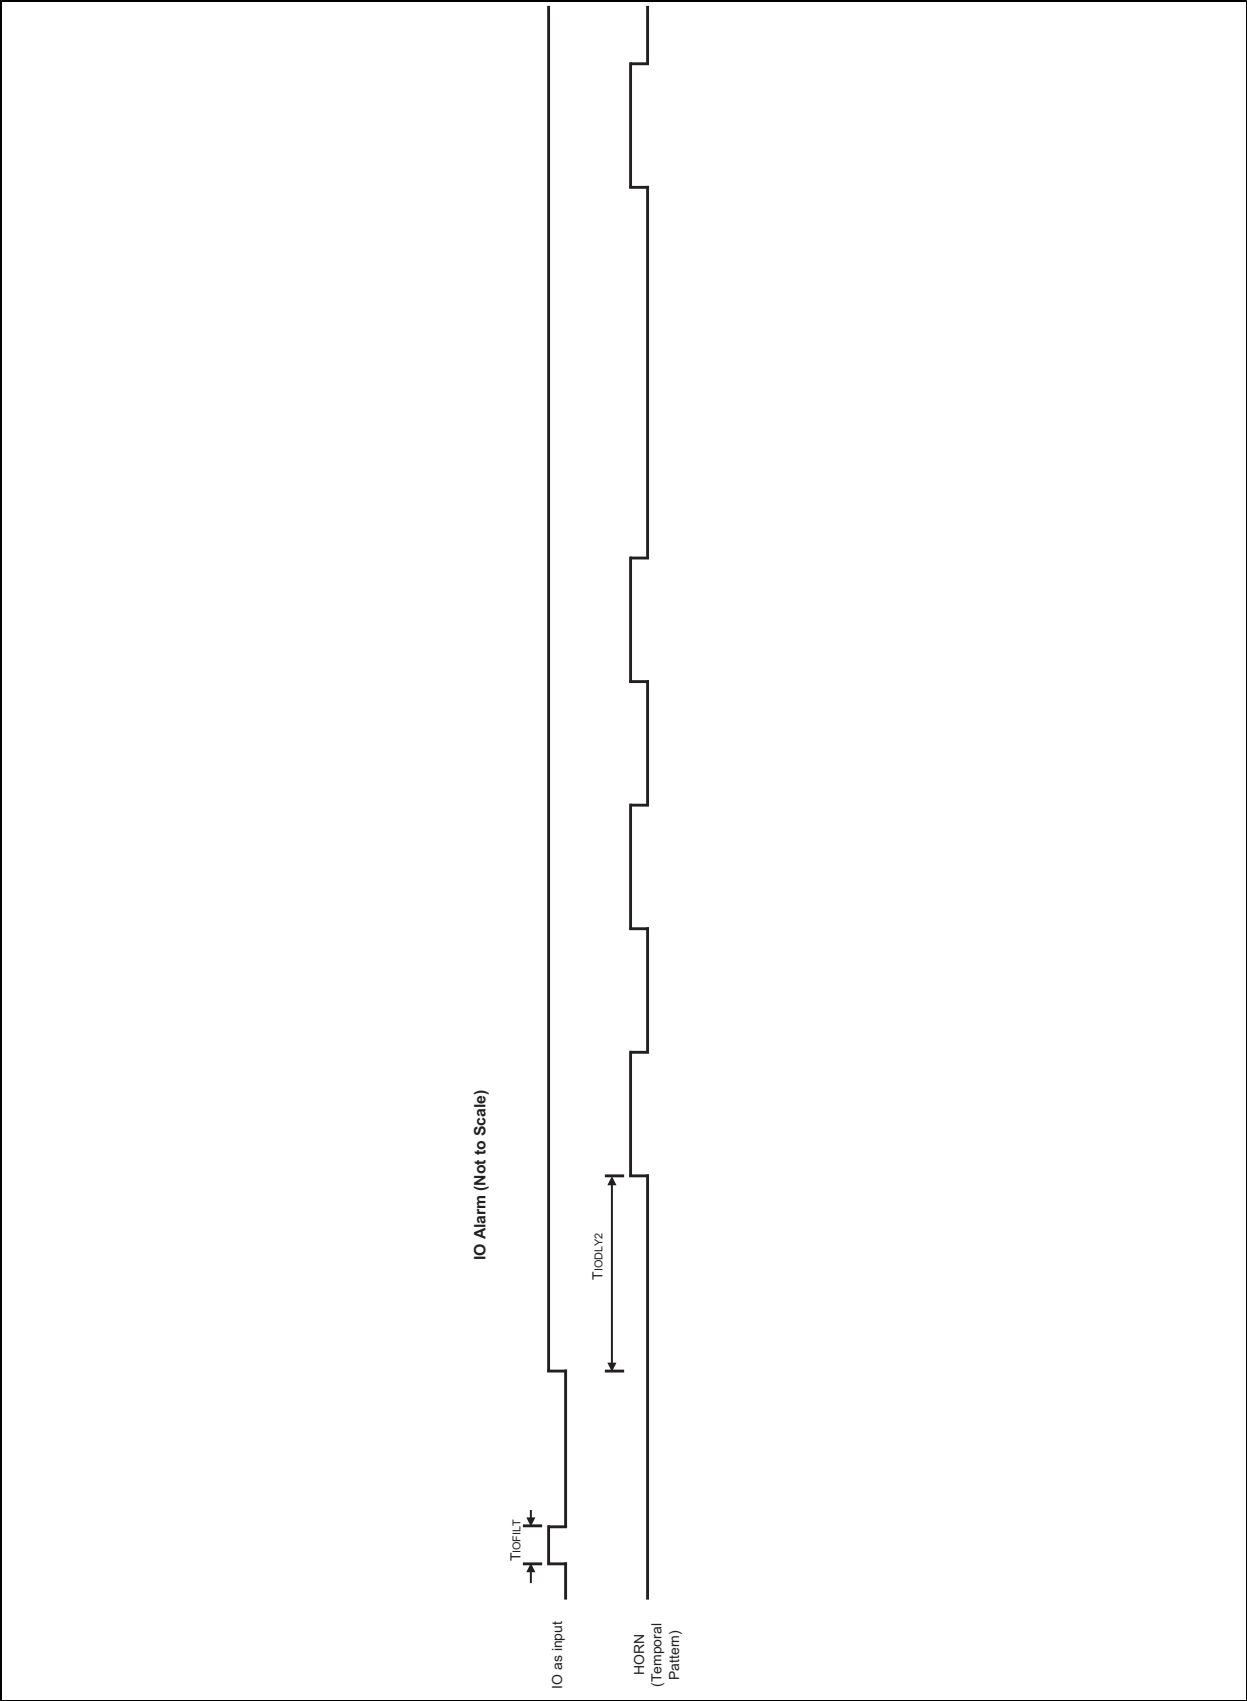


FIGURE 5-5: Timing Diagram – IO Smoke Alarm.



**FIGURE 5-6:** Timing Diagram – Alarm Memory and HUSH Timer.


NOTES:

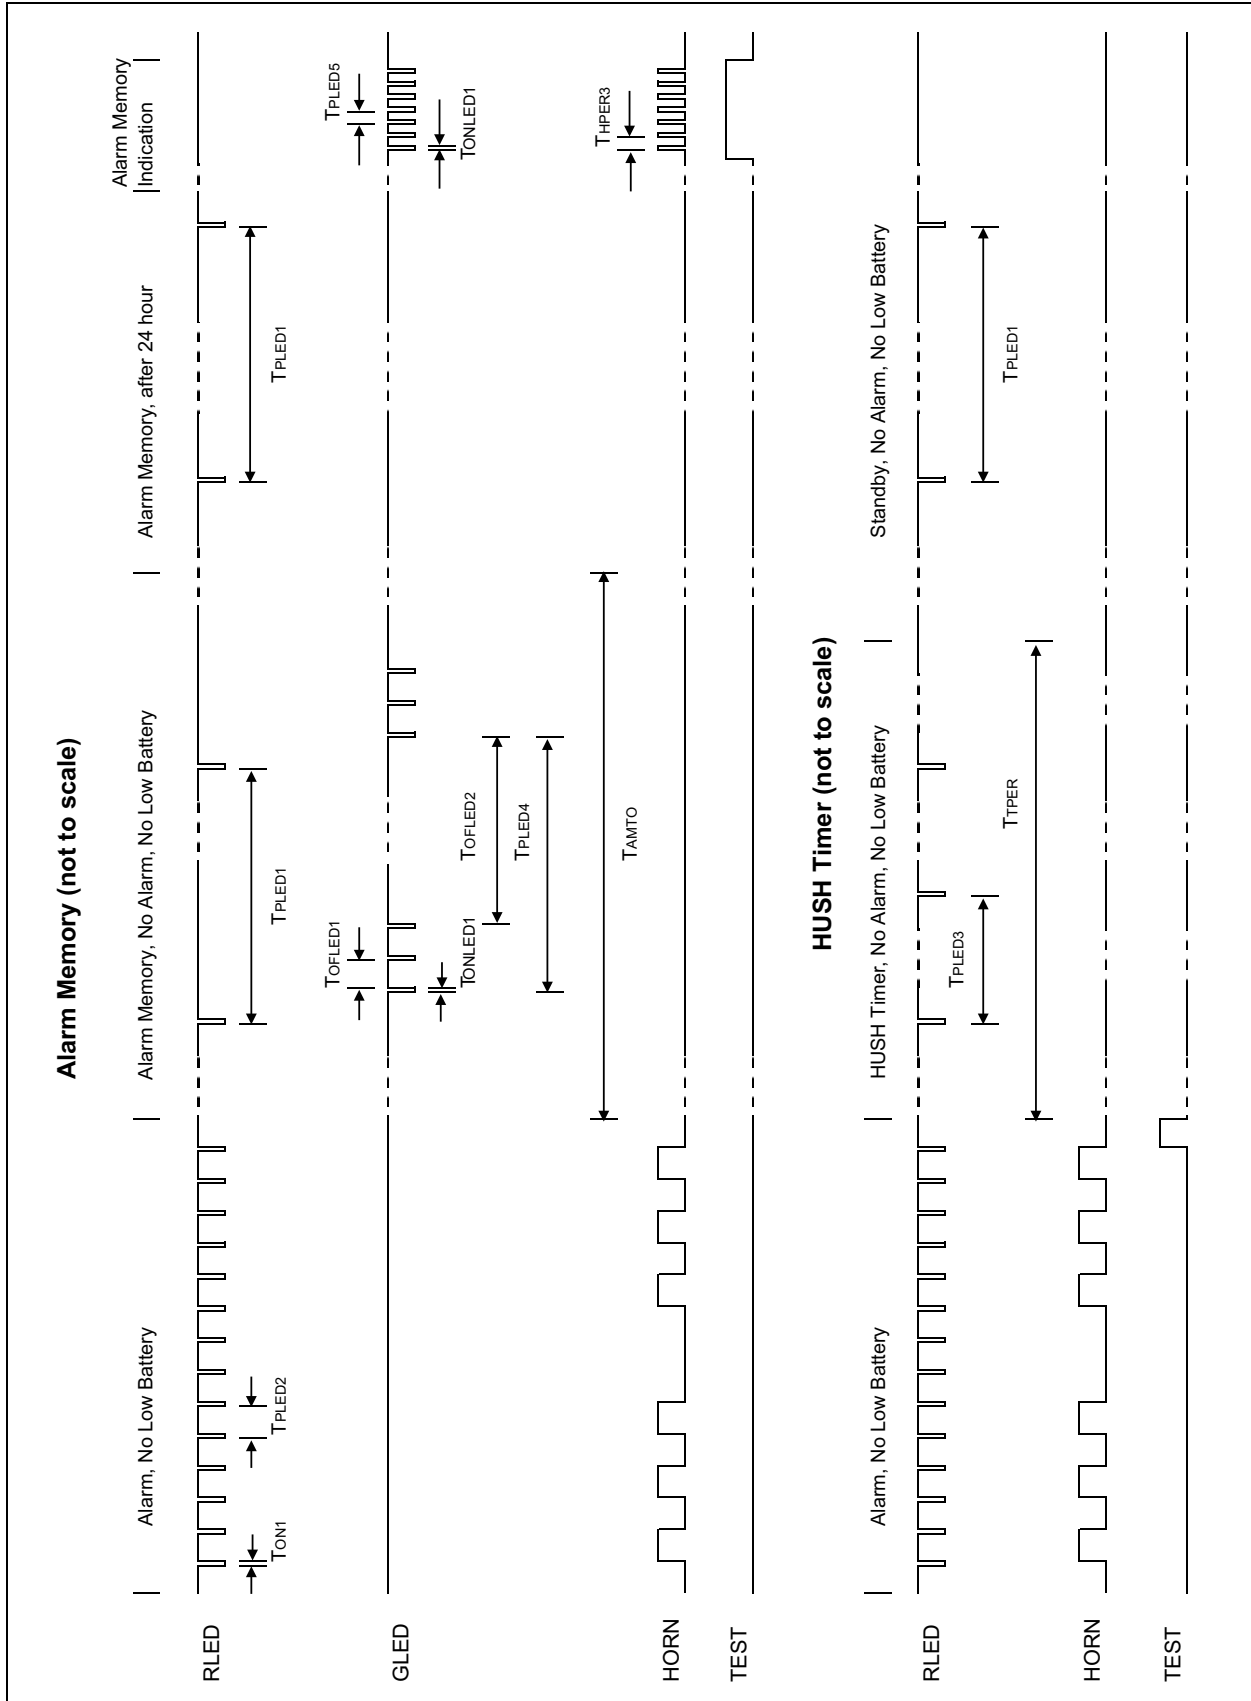


## 6.0 PACKAGING INFORMATION

### 6.1 Package Marking Information

16-Lead PDIP (300 mil)

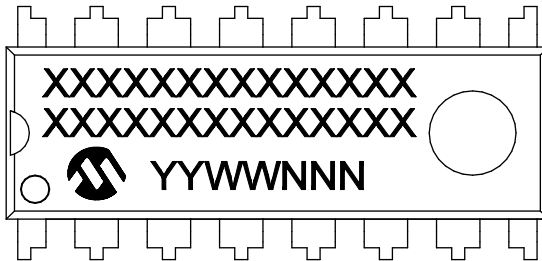

Example

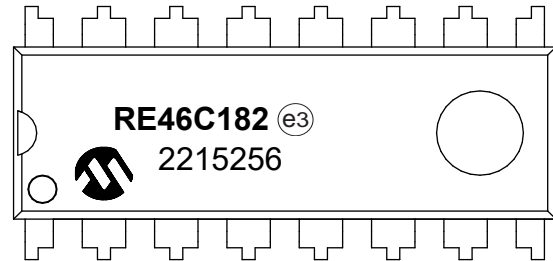


<b>Legend:</b>	XX...X	Customer-specific information
	Y	Year code (last digit of calendar year)
	YY	Year code (last 2 digits of calendar year)
	WW	Week code (week of January 1 is week '01')
	NNN	Alphanumeric traceability code
	e3	Pb-free JEDEC® designator for Matte Tin (Sn)
	*	This package is Pb-free. The Pb-free JEDEC designator (e3) can be found on the outer packaging for this package.
<b>Note:</b>	In the event the full Microchip part number cannot be marked on one line, it will be carried over to the next line, thus limiting the number of available characters for customer-specific information.	

# RE46C182

## 16-Lead Plastic Dual In-Line (P) – 300 mil Body [PDIP]

**Note:** For the most current package drawings, please see the Microchip Packaging Specification located at <http://www.microchip.com/packaging>

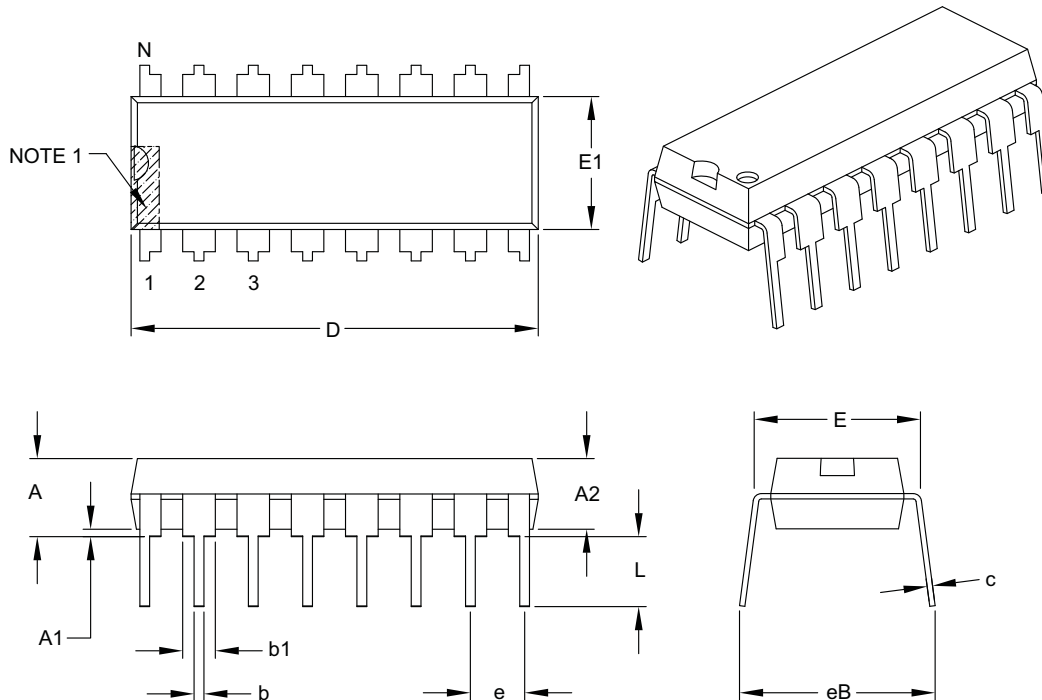

Units		INCHES		
Dimension Limits		MIN	NOM	MAX
Number of Pins	N	16		
Pitch	e	.100 BSC		
Top to Seating Plane	A	–	–	.210
Molded Package Thickness	A2	.115	.130	.195
Base to Seating Plane	A1	.015	–	–
Shoulder to Shoulder Width	E	.290	.310	.325
Molded Package Width	E1	.240	.250	.280
Overall Length	D	.735	.755	.775
Tip to Seating Plane	L	.115	.130	.150
Lead Thickness	c	.008	.010	.015
Upper Lead Width	b1	.045	.060	.070
Lower Lead Width	b	.014	.018	.022
Overall Row Spacing §	eB	–	–	.430

### Notes:

- Pin 1 visual index feature may vary, but must be located within the hatched area.
- § Significant Characteristic.
- Dimensions D and E1 do not include mold flash or protrusions. Mold flash or protrusions shall not exceed .010" per side.
- Dimensioning and tolerancing per ASME Y14.5M.

BSC: Basic Dimension. Theoretically exact value shown without tolerances.

Microchip Technology Drawing C04-017B

## APPENDIX A: REVISION HISTORY

### Revision A (May 2022)

- Original release of this document.

NOTES:

## PRODUCT IDENTIFICATION SYSTEM

To order or obtain information, e.g., on pricing or delivery, refer to the factory or the listed sales office.

<u>PART NO.</u>				
	X	XX		
Device	Package	Number of Pins		
Device	RE46C182:	CMOS Programmable Ionization Smoke Detector ASIC		
Package	E	= Plastic Dual In-Line, 16-Lead (PDIP)		
Number of Pins	16-Lead			

**Examples:**  
a) RE46C182E16: 16LD PDIP package

NOTES:

---

**Note the following details of the code protection feature on Microchip products:**

- Microchip products meet the specifications contained in their particular Microchip Data Sheet.
  - Microchip believes that its family of products is secure when used in the intended manner, within operating specifications, and under normal conditions.
  - Microchip values and aggressively protects its intellectual property rights. Attempts to breach the code protection features of Microchip product is strictly prohibited and may violate the Digital Millennium Copyright Act.
  - Neither Microchip nor any other semiconductor manufacturer can guarantee the security of its code. Code protection does not mean that we are guaranteeing the product is “unbreakable”. Code protection is constantly evolving. Microchip is committed to continuously improving the code protection features of our products.
- 

This publication and the information herein may be used only with Microchip products, including to design, test, and integrate Microchip products with your application. Use of this information in any other manner violates these terms. Information regarding device applications is provided only for your convenience and may be superseded by updates. It is your responsibility to ensure that your application meets with your specifications. Contact your local Microchip sales office for additional support or, obtain additional support at <https://www.microchip.com/en-us/support/design-help/client-support-services>.

THIS INFORMATION IS PROVIDED BY MICROCHIP “AS IS”. MICROCHIP MAKES NO REPRESENTATIONS OR WARRANTIES OF ANY KIND WHETHER EXPRESS OR IMPLIED, WRITTEN OR ORAL, STATUTORY OR OTHERWISE, RELATED TO THE INFORMATION INCLUDING BUT NOT LIMITED TO ANY IMPLIED WARRANTIES OF NON-INFRINGEMENT, MERCHANTABILITY, AND FITNESS FOR A PARTICULAR PURPOSE, OR WARRANTIES RELATED TO ITS CONDITION, QUALITY, OR PERFORMANCE.

IN NO EVENT WILL MICROCHIP BE LIABLE FOR ANY INDIRECT, SPECIAL, PUNITIVE, INCIDENTAL, OR CONSEQUENTIAL LOSS, DAMAGE, COST, OR EXPENSE OF ANY KIND WHATSOEVER RELATED TO THE INFORMATION OR ITS USE, HOWEVER CAUSED, EVEN IF MICROCHIP HAS BEEN ADVISED OF THE POSSIBILITY OR THE DAMAGES ARE FORESEEABLE. TO THE FULLEST EXTENT ALLOWED BY LAW, MICROCHIP’S TOTAL LIABILITY ON ALL CLAIMS IN ANY WAY RELATED TO THE INFORMATION OR ITS USE WILL NOT EXCEED THE AMOUNT OF FEES, IF ANY, THAT YOU HAVE PAID DIRECTLY TO MICROCHIP FOR THE INFORMATION.

Use of Microchip devices in life support and/or safety applications is entirely at the buyer’s risk, and the buyer agrees to defend, indemnify and hold harmless Microchip from any and all damages, claims, suits, or expenses resulting from such use. No licenses are conveyed, implicitly or otherwise, under any Microchip intellectual property rights unless otherwise stated.

For information regarding Microchip’s Quality Management Systems, please visit [www.microchip.com/quality](http://www.microchip.com/quality).

**Trademarks**

The Microchip name and logo, the Microchip logo, Adaptec, AnyRate, AVR, AVR logo, AVR Freaks, BesTime, BitCloud, CryptoMemory, CryptoRF, dsPIC, flexPWR, HELDO, IGLOO, JukeBlox, KeeLoq, Klear, LANCheck, LinkMD, maxStylus, maxTouch, MediaLB, megaAVR, Microsemi, Microsemi logo, MOST, MOST logo, MPLAB, OptoLyzr, PIC, picoPower, PICSTART, PIC32 logo, PolarFire, Prochip Designer, QTouch, SAM-BA, SenGenuity, SpyNIC, SST, SST Logo, SuperFlash, Symmetricom, SyncServer, Tachyon, TimeSource, tinyAVR, UNI/O, Vectron, and XMEGA are registered trademarks of Microchip Technology Incorporated in the U.S.A. and other countries.

AgileSwitch, APT, ClockWorks, The Embedded Control Solutions Company, EtherSynch, Flashtec, Hyper Speed Control, HyperLight Load, IntelliMOS, Libero, motorBench, mTouch, Powermite 3, Precision Edge, ProASIC, ProASIC Plus, ProASIC Plus logo, QuietWire, SmartFusion, SyncWorld, Temux, TimeCesium, TimeHub, TimePictra, TimeProvider, TrueTime, WinPath, and ZL are registered trademarks of Microchip Technology Incorporated in the U.S.A.

Adjacent Key Suppression, AKS, Analog-for-the-Digital Age, Any Capacitor, AnyIn, AnyOut, Augmented Switching, BlueSky, BodyCom, CodeGuard, CryptoAuthentication, CryptoAutomotive, CryptoCompanion, CryptoController, dsPICDEM, dsPICDEM.net, Dynamic Average Matching, DAM, ECAN, Espresso T1S, EtherGREEN, GridTime, IdealBridge, In-Circuit Serial Programming, ICSP, INICnet, Intelligent Paralleling, Inter-Chip Connectivity, JitterBlocker, Knob-on-Display, maxCrypto, maxView, memBrain, Mindi, MiWi, MPASM, MPF, MPLAB Certified logo, MPLIB, MPLINK, MultiTRAK, NetDetach, NVm Express, NVMe, Omniscient Code Generation, PICDEM, PICDEM.net, PICKit, PICTail, PowerSmart, PureSilicon, QMatrix, REAL ICE, Ripple Blocker, RTAX, RTG4, SAM-ICE, Serial Quad I/O, simpleMAP, SimpliPHY, SmartBuffer, SmartHLS, SMART-I.S., storClad, SQL, SuperSwitcher, SuperSwitcher II, Switchtec, SynchroPHY, Total Endurance, TSHARC, USBCheck, VariSense, VectorBlox, VeriPHY, ViewSpan, WiperLock, XpressConnect, and ZENA are trademarks of Microchip Technology Incorporated in the U.S.A. and other countries.

SQTP is a service mark of Microchip Technology Incorporated in the U.S.A.

The Adaptec logo, Frequency on Demand, Silicon Storage Technology, Symmcom, and Trusted Time are registered trademarks of Microchip Technology Inc. in other countries.

GestIC is a registered trademark of Microchip Technology Germany II GmbH & Co. KG, a subsidiary of Microchip Technology Inc., in other countries.

All other trademarks mentioned herein are property of their respective companies.

© 2022, Microchip Technology Incorporated and its subsidiaries.

All Rights Reserved.

ISBN: 978-1-6683-0391-7

## Worldwide Sales and Service

### AMERICAS

**Corporate Office**  
2355 West Chandler Blvd.  
Chandler, AZ 85224-6199  
Tel: 480-792-7200  
Fax: 480-792-7277  
Technical Support:  
<http://www.microchip.com/support>  
Web Address:  
[www.microchip.com](http://www.microchip.com)

**Atlanta**  
Duluth, GA  
Tel: 678-957-9614  
Fax: 678-957-1455

**Austin, TX**  
Tel: 512-257-3370

**Boston**  
Westborough, MA  
Tel: 774-760-0087  
Fax: 774-760-0088

**Chicago**  
Itasca, IL  
Tel: 630-285-0071  
Fax: 630-285-0075

**Dallas**  
Addison, TX  
Tel: 972-818-7423  
Fax: 972-818-2924

**Detroit**  
Novi, MI  
Tel: 248-848-4000

**Houston, TX**  
Tel: 281-894-5983

**Indianapolis**  
Noblesville, IN  
Tel: 317-773-8323  
Fax: 317-773-5453  
Tel: 317-536-2380

**Los Angeles**  
Mission Viejo, CA  
Tel: 949-462-9523  
Fax: 949-462-9608  
Tel: 951-273-7800

**Raleigh, NC**  
Tel: 919-844-7510

**New York, NY**  
Tel: 631-435-6000

**San Jose, CA**  
Tel: 408-735-9110  
Tel: 408-436-4270

**Canada - Toronto**  
Tel: 905-695-1980  
Fax: 905-695-2078

### ASIA/PACIFIC

**Australia - Sydney**  
Tel: 61-2-9868-6733

**China - Beijing**  
Tel: 86-10-8569-7000

**China - Chengdu**  
Tel: 86-28-8665-5511

**China - Chongqing**  
Tel: 86-23-8980-9588

**China - Dongguan**  
Tel: 86-769-8702-9880

**China - Guangzhou**  
Tel: 86-20-8755-8029

**China - Hangzhou**  
Tel: 86-571-8792-8115

**China - Hong Kong SAR**  
Tel: 852-2943-5100

**China - Nanjing**  
Tel: 86-25-8473-2460

**China - Qingdao**  
Tel: 86-532-8502-7355

**China - Shanghai**  
Tel: 86-21-3326-8000

**China - Shenyang**  
Tel: 86-24-2334-2829

**China - Shenzhen**  
Tel: 86-755-8864-2200

**China - Suzhou**  
Tel: 86-186-6233-1526

**China - Wuhan**  
Tel: 86-27-5980-5300

**China - Xian**  
Tel: 86-29-8833-7252

**China - Xiamen**  
Tel: 86-592-2388138

**China - Zhuhai**  
Tel: 86-756-3210040

### ASIA/PACIFIC

**India - Bangalore**  
Tel: 91-80-3090-4444

**India - New Delhi**  
Tel: 91-11-4160-8631

**India - Pune**  
Tel: 91-20-4121-0141

**Japan - Osaka**  
Tel: 81-6-6152-7160

**Japan - Tokyo**  
Tel: 81-3-6880-3770

**Korea - Daegu**  
Tel: 82-53-744-4301

**Korea - Seoul**  
Tel: 82-2-554-7200

**Malaysia - Kuala Lumpur**  
Tel: 60-3-7651-7906

**Malaysia - Penang**  
Tel: 60-4-227-8870

**Philippines - Manila**  
Tel: 63-2-634-9065

**Singapore**  
Tel: 65-6334-8870

**Taiwan - Hsin Chu**  
Tel: 886-3-577-8366

**Taiwan - Kaohsiung**  
Tel: 886-7-213-7830

**Taiwan - Taipei**  
Tel: 886-2-2508-8600

**Thailand - Bangkok**  
Tel: 66-2-694-1351

**Vietnam - Ho Chi Minh**  
Tel: 84-28-5448-2100

### EUROPE

**Austria - Wels**  
Tel: 43-7242-2244-39  
Fax: 43-7242-2244-393

**Denmark - Copenhagen**  
Tel: 45-4485-5910  
Fax: 45-4485-2829

**Finland - Espoo**  
Tel: 358-9-4520-820

**France - Paris**  
Tel: 33-1-69-53-63-20  
Fax: 33-1-69-30-90-79

**Germany - Garching**  
Tel: 49-8931-9700

**Germany - Haan**  
Tel: 49-2129-3766400

**Germany - Heilbronn**  
Tel: 49-7131-72400

**Germany - Karlsruhe**  
Tel: 49-721-625370

**Germany - Munich**  
Tel: 49-89-627-144-0  
Fax: 49-89-627-144-44

**Germany - Rosenheim**  
Tel: 49-8031-354-560

**Israel - Ra'anana**  
Tel: 972-9-744-7705

**Italy - Milan**  
Tel: 39-0331-742611  
Fax: 39-0331-466781

**Italy - Padova**  
Tel: 39-049-7625286

**Netherlands - Drunen**  
Tel: 31-416-690399  
Fax: 31-416-690340

**Norway - Trondheim**  
Tel: 47-7288-4388

**Poland - Warsaw**  
Tel: 48-22-3325737

**Romania - Bucharest**  
Tel: 40-21-407-87-50

**Spain - Madrid**  
Tel: 34-91-708-08-90  
Fax: 34-91-708-08-91

**Sweden - Gothenberg**  
Tel: 46-31-704-60-40

**Sweden - Stockholm**  
Tel: 46-8-5090-4654

**UK - Wokingham**  
Tel: 44-118-921-5800  
Fax: 44-118-921-5820