



**Features** 

- Measures ranges of 1A to 1200A
- 0.2% typical accuracy
- Supports user selectable 50 or 100 mV external shunts
- Bright 1" red LED display, readable at distance of 80 feet (~24 m)
- Adjustable display brightness
- Wide common-mode input range (±48V)
- Digital filter for optimizing measurements in electrically noisy environments
- Operates from an external 12VDC power supply
- Mounts with adhesive strips (supplied) or screws
- Two-year warranty


### PRODUCT OVERVIEW

DMS01-AM-RS12-C is a robust, highly configurable, digital panel meter that provides precise measurement and display of DC current and supports a wide range of external shunts. DIP switches simplify selection and setup of shunt current / voltage input ranges and features a highly visible red 1" (25mm) tall,  $3\frac{1}{2} - 4\frac{1}{2}$  digit seven-segment LED display with adjustable brightness. Independent offset and scale adjustment trim-potentiometers optimize precision for specialized applications and the internal digital filter enhances performance in electrically noisy environments. An external 12VDC power source provides power to the meter. An internal DC-DC converter accommodates a  $\pm 48V$  common-mode measurement range with respect to the power supply input and supports both high or low side measurement, simplifying a wide range of measurement applications. This digital panel meter ideal for laboratory instrumentation, factory automation, and any application that requiring precise current monitoring.

### ORDERING INFORMATION

DMS01-AM-RS12-C Digital DC Shunt Ammeter, 1" Red Display, 12VDC Power

ACCESSORIES		
Shunts		
Murata Model #	Full-scale Amps / Output Voltage	Resistance (mΩs at 25°C)
3020-01097-0	5A / 50mV	10.0000
3020-01107-0	10A / 100mV	10.0000
3020-01098-0	20A / 50mV	2.5000
3020-01096-0	50A / 50mV	1.0000
3020-01099-0	100A / 50mV	0.5000
3020-01108-0	100A / 100mV	1.0000
3020-01100-0	150A / 50mV	0.3300
3020-01101-0	200A / 50mV	0.2500
3020-01102-0	300A / 50mV	0.1670
3020-01103-0	500A / 50mV	0.1000
3020-01104-0	800A / 50mV	0.0625
3020-01105-0	1000A / 50mV	0.0500
3020-01106-0	1200A / 50mV	0.0417

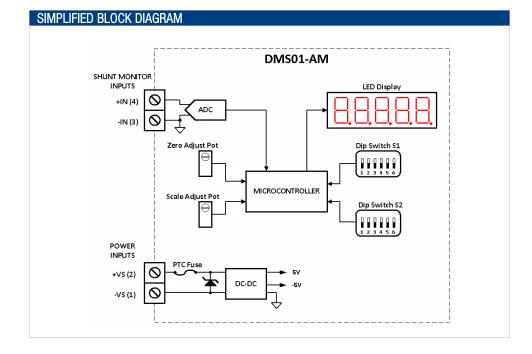





Parameter	Min	Max	Units	
Supply Voltage (Operating)	11	12	13	V
Absolute Maximum Supply Voltage	-1		+14	V
Supply Current <sup>1</sup> (Operating at maximum intensity)			100	mA
(Operating at minimum intensity)			60	mA
Digits	Dependent	3.5 – 4.5 Lupon on shunt resi	stor settings	
Digit Height	·	1 (25.4)	-	inch (mm)
Display Update Rate		2		Sa/s
Decimal Selection	auto			
Display Color	Red (627nm pk)			
Over-range indication	Flashing display			
Measurement range (50mV range)	-50		+50	mV
(100mV range)	-100		+100	mV
Accuracy		0.2%	1%	
Zero-Offset (50mV range)	-2		+2	count
(100mV range)	-2		+2	count
Current Range Options	See current range selection table			
Input Impedance		5G		Ω
Offset Trim Range		±1.5		% full-scale
Scale Trim Range		±1		%
Temperature Drift (0 to +50°C)		±0.08		count/°C
Absolute Maximum Input Voltage (+VIN to -VIN)	-16		+16	V
Common-Mode Input Range (-VIN) to (-VS)	-48		+48	V

<sup>&</sup>lt;sup>1</sup> based on a display value of "1.888"


PHYSICAL/ENVIRONMENTAL						
Parameter	Min	Тур	Max	Units		
Operating Temperature	0		+50	С		
Storage Temperature	-40		+75	С		
Humidity (Non-condensing)			85	%RH		
Weight		6.14 (174)		oz (g)		
User Controls						
Brightness		single-turn potentiometer				
Offset and Gain Adjustment	QTY 2 12-turn trim potentiometers					
Dipswitches (QTY 2), configuration of:	·					
- Input voltage range						
- Digital filter enable	"S1" and "S2" 6-position each					
- Current range						
- Scale and offset trim enable						
Overall Dimensions	5.86 (149) L x 3.36 (86) W x 1.43 (37) H inch (m					
Terminal Blocks	Min	Тур	Max	Units		
Wire Size	24		14	AWG		
Insulation Strip Length		0.25 (6)		inch (mm)		
Screw Tightening torque		56.6 (0.4)		oz-in (N-m)		

### **OPERATION**

#### Measurement Type and Capabilities

- The DMS01-AM measures DC current using an external shunt resistor with two user-selectable input ranges of ±50mV and ±100mV.
- > Measurements are displayed between 3-1/2 and 4-1/2 digits of resolution depending on the current range selected.
- 21 current range options can be selected based on dipswitch settings.
- The meter's measurement terminals are electrically isolated from the power terminals through a DC-DC converter, providing a high common-mode input range (±48V) for the input (relative to the power terminals), simplifying a wide range of measurement applications.
- > Meter requires and external 12VDC power supply (not included).

### REAR PANEL LAYOUT, SCREW TERMINAL CONNECTIONS & CONTROLS



Terminal Block					
Terminal #	Name	Function			
1	-VS	Power Supply Terminals (+12VDC)			
2	+VS	rower supply reminals (+12VDC)			
3	-IN	Measurement Input Terminals (Shunt			
4	+IN	Connections)			


**Brightness Adjust** — This single-turn potentiometer supports adjustment of the meter's LED display brightness for maximum readability. Turning the pot clockwise increases brightness, while turning it counterclockwise decreases brightness.


Offset Adjust – This 12-turn potentiometer supports the adjustment of meter offset. In the vast majority of applications, this function is not needed as the meter's offset is precisely adjusted to zero at factory calibration. Turning the pot clockwise will give a negative offset, while turning it counterclockwise gives a positive offset.


Scale Adjust – This 12-turn potentiometer supports the adjustment of the meter's scale. In the vast majority of applications, this function is not needed as the meter's scale is precisely adjusted at factory calibration. Turning the pot clockwise decreases the gain, while turning it counterclockwise increases the gain.

S1, S2 – These two 6-position dipswitches are used to configure the meter's various options. Details may be found in the Meter Configuration section of this datasheet.

### **CONNECTION EXAMPLES**

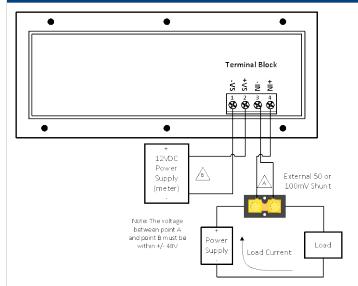





The above example illustrates an application where the total load current of the system needs to be measured. Therefore, the shunt is connected in series with the system load, at the same time, the shunt measurement points connected to terminals 3 & 4, as shown. The potential difference (VDC) across these points is converted and displayed as DC current, and indicates total system load. This is a high-side installation. See <u>Figure 1 & 2</u> above for and example of low-side installation.





### ### ##############################	Range Selection	00		,	١		DIDOV	MITOLI	
±1.000 OFF ON OFF OFF OFF OFF OFF OFF OFF OFF	Current Range		SW3			SW6	S2		Description
### ### ##############################			OFF	OFF		OFF	ON 1 2 3 4 5 6	1 2 3 4 5 6	The ammeter uses 5 switches
### ### ##############################	±1.000	OFF	ON	OFF	OFF	OFF	ON 1 2 3 4 5 6		S2) to control the different current
#10.00 OFF OFF OFF ON OFF ON OFF #100000 #1000000 #1000000 #1000000 #1000000 #1000000 #1000000 #1000000 #1000000 #100000 #100000 #1000000 #1000000 #1	±2.000	OFF	OFF	ON	OFF	OFF	1 2 3 4 5 6		switches are set to off or if switche are set beyond the 1200A range t
#15.00 OFF ON OFF ON OFF ON OFF # # # # # # # # # # # # # # # # # #	±5.000	OFF	ON	ON	OFF	OFF		1 2 3 4 5 6	meter will display the voltage acro the shunt.
#20.00 OFF OFF ON ON OFF POPP ON ON OFF POPP ON ON OFF POPP ON ON ON OFF POPP ON ON ON OFF POPP ON ON ON ON OFF OFF ON	±10.00	OFF	OFF	OFF	ON	OFF		1 2 3 4 5 6	_
#30.00 OFF ON ON ON OFF OFF ON OFF OFF ON OFF ON OFF ON OFF OFF	±15.00	OFF	ON	OFF	ON	OFF	<b>1</b> 2 3 4 5 6	1 2 3 4 5 6	
#50.00 OFF OFF OFF OFF ON ON OFF OFF	±20.00	OFF	OFF	ON	ON	OFF		1 2 3 4 5 6	
#75.00 OFF ON OFF OFF ON PRODUCT OFF ON PRODUCT OFF ON PRODUCT OFF ON OFF ON PRODUCT OFF ON ON ON PRODUCT OFF OFF OFF OFF OFF OFF OFF OFF OFF OF	±30.00	OFF	ON	ON	ON	OFF	1 2 3 4 5 6	1 2 3 4 5 6	-
### ### ##############################	±50.00	OFF	OFF	OFF	OFF	ON	1 2 3 4 5 6		_
# 100.0 OFF ON ON ON OFF ON ON ON ON ON OFF ON	±75.00	OFF	ON	OFF	OFF	ON			-
### ### ##############################	±80.00	OFF	OFF	ON	OFF	ON	1 2 3 4 5 6	1 2 3 4 5 6	_
$\pm 200.0$ OFF       ON       OFF       OFF       OFF       OFF       ON       ON       ON       ON       ON       ON       OFF       OFF       OFF       ON       ON       ON       OFF       OFF       ON       OFF       OFF       ON       ON       ON       ON       OFF       ON       OFF       ON       OFF       ON       OFF       ON       ON       ON       ON       ON       ON       ON       OFF       ON       ON       ON       ON<	±100.0	OFF	ON	ON	OFF	ON			
	±150.0	OFF	OFF	OFF	ON	ON		1 2 3 4 5 6	
	±200.0	OFF	ON	OFF	ON	ON	1 2 3 4 5 6	1 2 3 4 5 6	_
$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	±250.0	OFF	OFF	ON	ON	ON	1 2 3 4 5 6		_
	±300.0	OFF	ON	ON	ON	ON			
$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	±400.0	ON	OFF	OFF	OFF	OFF	1 2 3 4 5 6		
$\pm 800.0$ ON ON OFF OFF OFF OFF OFF ON OFF $\begin{bmatrix} 2N & 1 & 1 & 1 & 1 & 1 & 1 & 1 & 1 & 1 & $	±500.0	ON	ON	OFF	OFF	OFF		ON 4 5 6	
$\pm 1000$ ON OFF OFF ON OFF $\begin{bmatrix} 0 \\ 1 \\ 2 \\ 3 \\ 4 \\ 5 \\ 6 \end{bmatrix}$	±600.0	ON	OFF	ON	OFF	OFF	1 2 3 4 5 6		
	±800.0	ON	ON	ON	OFF	OFF	1 2 3 4 5 6	ON	
ON CON	±1000	ON	OFF	OFF	ON	OFF			
±1200 ON ON OFF		ON	ON	OFF	ON	OFF	1 2 3 4 5 6		





METER CONFIGURATION	N						
Current Range Selection							
Input Range	SW1	Dipswitch S1	Description				
±50mV	OFF	ON	SW1 on S1 controls the meter's input range. In the OFF position the input range is ±50mV, while in the ON position the meter's range is				
±100mV	ON	ON 1 2 3 4 5 6	±100mV.				
Current Range Selection							
Input Range	SW1	Dipswitch S1	Description				
±50mV	OFF	ON 1 2 3 4 5 6	SW1 on S1 controls the meter's input range. In the OFF position the				
±100mV	ON	ON 1 2 3 4 5 6	input range is $\pm 50$ mV, while in the ON position the meter's range is $\pm 100$ mV.				
Digital Filter On/Off Selec	Digital Filter On/Off Selection						
Digital Filter	SW2	Dipswitch S1	Description				
OFF	OFF	ON 1 2 3 4 5 6	SW2 on S1 controls the meter's digital filter. In the OFF position, the filter is disabled and readings are updated at maximum speed. In the				
ON	ON	ON 1 2 3 4 5 6	ON position, the filter is enabled, and readings are processed through a moving average filter, which results in more stable readings, but a slower response.				
Scale and Offset Trim Ad	just Enable On/Off						
Trim Enable	SW2	Dipswitch S2	Description				
OFF	OFF	ON 1 2 3 4 5 6	The DMS01 ammeter provides two potentiometers for adjustment of the measurement scale and offset controls which can be enabled by SW2 on S2. When the switch is set to the OFF position the trim is				
ON	ON	ON	disabled. When the switch is set to the ON position the trim is enabled.				



### **TECHNICAL NOTES**



#### 1. Calibration

The DMS01-AM is calibrated at the factory at the time of manufacture. When the Trim Enable switch (SW2 on S2) is turned off, the unit ignores the scale and offset potentiometer settings and reverts to factory calibration. When the Trim Enable switch is turned ON, the unit's effective calibration may be changed by the user and may no longer be within datasheet specifications.

### 2. Protection and Fusing

The DMS01-AM contains an internal PTC fuse as well as other protective elements that are intended for protection against brief electrical transients and misconnect conditions. Additional external protective components such as fuses and transient suppressors may be required depending on the application in which the meter is deployed.

### 3. Noisy Power Supplies


In systems with noisy power supplies, connecting an external, non-polarized capacitor across the +VS and -VS inputs can help reduce measurement errors. In certain situations, the use of twisted pair or shield wiring may be required.

#### 4. Installation


IMPORTANT! To ensure safe and reliable operation, DMS01 meters must be installed and serviced by qualified technical personnel. Contact Murata Power Solutions if there is any doubt regarding their installation or operation.

### 5. Over-range Limit

The meter will flash on and off when the input of the meter exceeds its minimum or maximum input voltage/current.

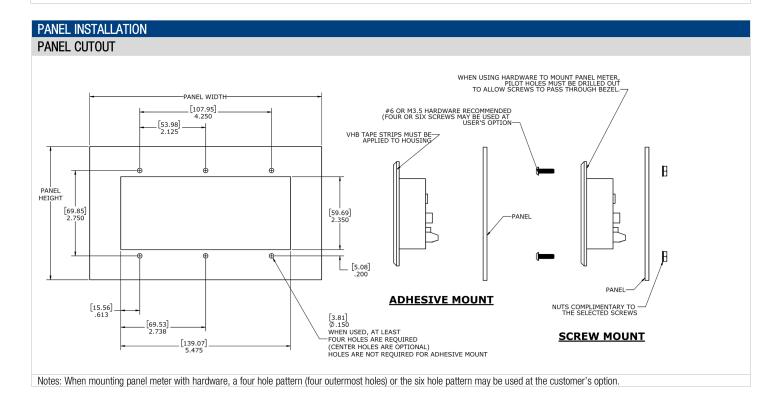



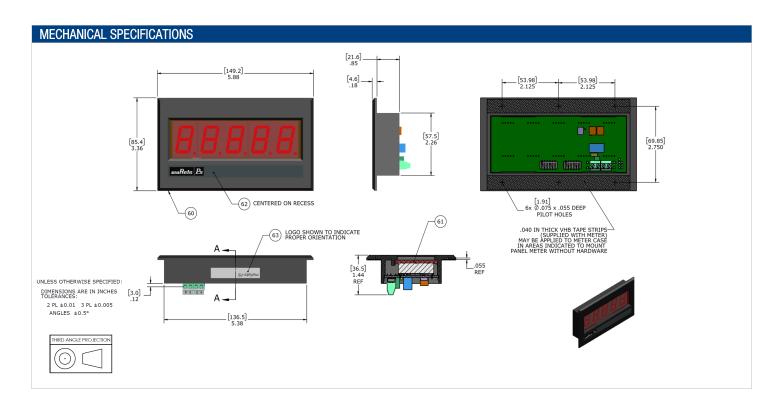

APPLICATION NOTES						
Document Number	Description	URL Link to Document				
DMS-AN25	Application Note: DMS01 Meter Measurement and Calibration	Click to open application note				

Murata Power Solutions, Inc. 129 Flanders Rd. Westborough, Ma 01581, USA. ISO 9001 and 14001 REGISTERED



This product is subject to the following operating requirements and the Life and Safety Critical Application Sales Policy:

Refer to: https://www.murata-ps.com/requirements/

Murata Power Solutions, inc. makes no representation that the use of its products in the circuits described herein, or the use of other technical information contained herein, will not infringe upon existing or future patent rights. The descriptions contained herein do not imply the granting of licenses to make, use, or sell equipment constructed in accordance therewith. Specifications are subject to change without notice.

©2020 Murata Power Solutions, Inc..

# **Mouser Electronics**

**Authorized Distributor** 

Click to View Pricing, Inventory, Delivery & Lifecycle Information:

Murata:

DMS01-AM-RS12-C